


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



7071044 (S/N 1007)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2019	Feb 2020		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC72567	KC83896	
Sample Date		Client Info		21 Feb 2020	03 Dec 2019	
Machine Age	hrs	Client Info		4362	2278	
Oil Age	hrs	Client Info		2084	2278	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	1	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	3	8	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m		0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	<1	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	2	5	
Calcium	ppm	ASTM D5185m	2	<1	0	
Phosphorus	ppm	ASTM D5185m		1	3	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	<1	
Sodium	ppm	ASTM D5185m		- <1	1	
Potassium	ppm	ASTM D5185m	>20	<1	1	
Water	%	ASTM D6304	>0.05	0.006	0.005	
ppm Water	ppm	ASTM D6304	>500	61.0	58.2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1106	1771	
Particles >6µm		ASTM D7647	>1300	437	312	
Particles >14µm		ASTM D7647	>80	61	18	
Particles >21µm		ASTM D7647	>20	19	10	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/13	15/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Asid Number (AN)	I/OII/-	ACTM DODAE	0.4	0.502	0.400	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.423

0.503



OIL ANALYSIS REPORT

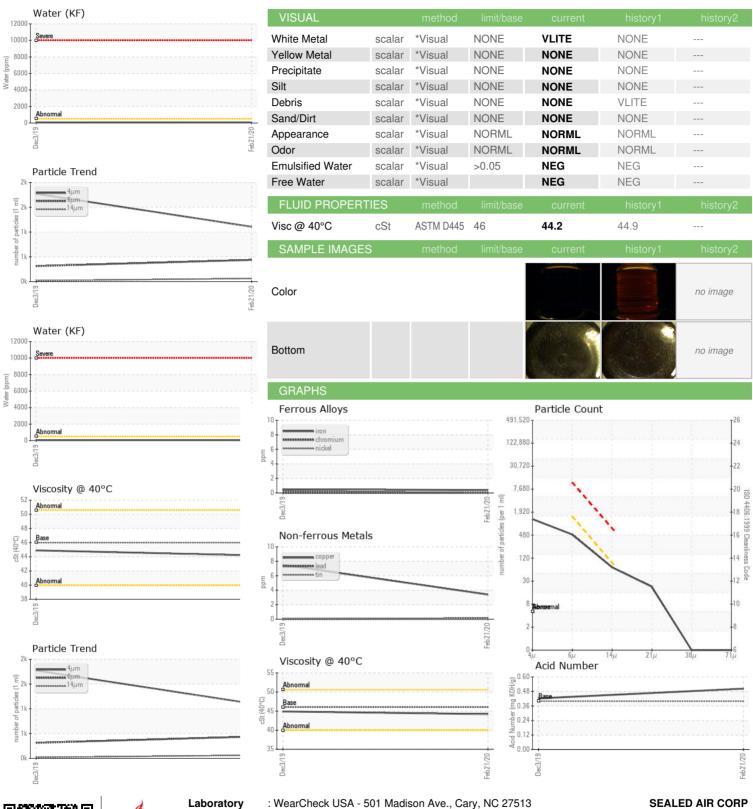





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC72567 +04924988

: IND 2

: 8945080

Recieved Diagnosed Diagnostician

: 03 Mar 2020 : 04 Mar 2020 : Don Baldridge

13555 MCCRACKEN RD GARFIELD HEIGHTS, OH US 44128

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: