


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

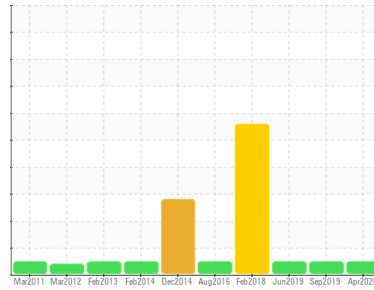

Machine Id
A-81
Component
Wind Turbine Gearbox
Fluid
MITSUBISHI Daphne Alpha Winforce (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		MHI017688	MHI019052	MHI023810
Sample Date	Client Info		09 Apr 2020	27 Sep 2019	07 Jun 2019
Machine Age	hrs	Client Info	0	0	88841
Oil Age	hrs	Client Info	95185	91018	0
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>200	11	13	23	
Iron	ppm	ASTM D5185m	>200	25	29	25
Chromium	ppm	ASTM D5185m		<1	<1	<1
Nickel	ppm	ASTM D5185m		<1	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m		0	<1	0
Lead	ppm	ASTM D5185m		0	0	0
Copper	ppm	ASTM D5185m	>75	3	5	3
Tin	ppm	ASTM D5185m		0	<1	<1
Antimony	ppm	ASTM D5185m		0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<1	<1	191
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		<1	<1	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		1	<1	0
Phosphorus	ppm	ASTM D5185m		296	367	370
Zinc	ppm	ASTM D5185m		4	0	1
Sulfur	ppm	ASTM D5185m		3684	4784	5831






CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>+30	2	3	1
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.1	0.002	0.007	0.007
ppm Water	ppm	ASTM D6304	>1000	17.2	73.6	70

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2634	13774	2247
Particles >6µm	ASTM D7647	>5000	562	874	533
Particles >14µm	ASTM D7647	>640	39	28	39
Particles >21µm	ASTM D7647	>160	8	9	11
Particles >38µm	ASTM D7647	>40	0	1	1
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	19/16/12	21/17/12	18/16/12

OIL ANALYSIS REPORT

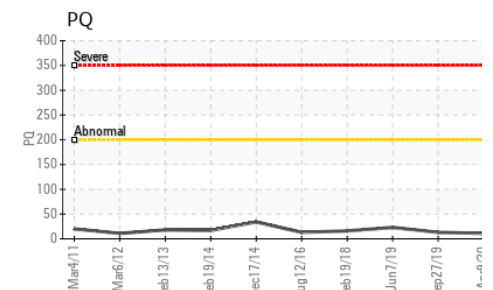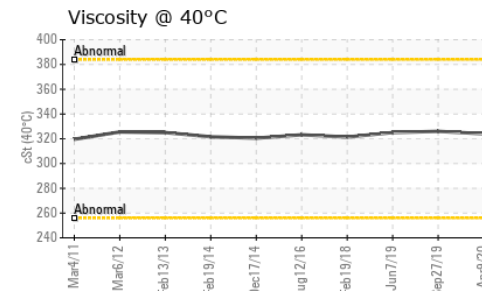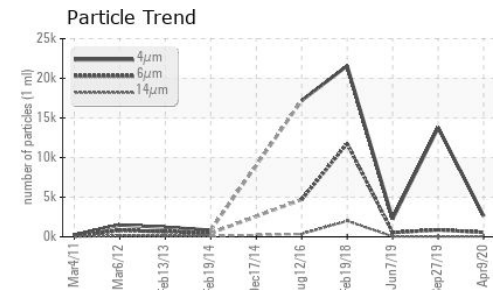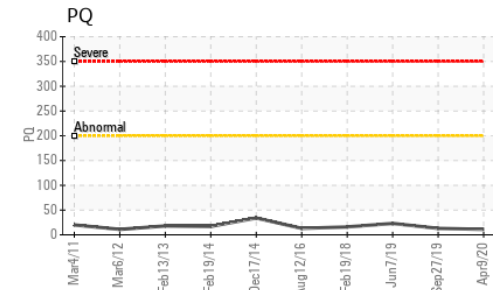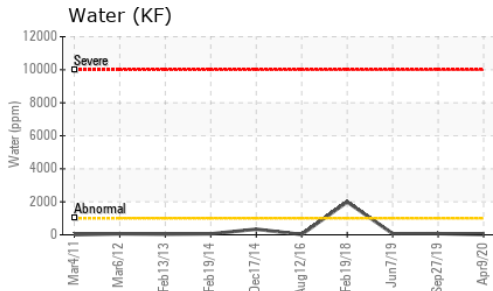


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.873	0.829	0.800






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		324	326	325

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

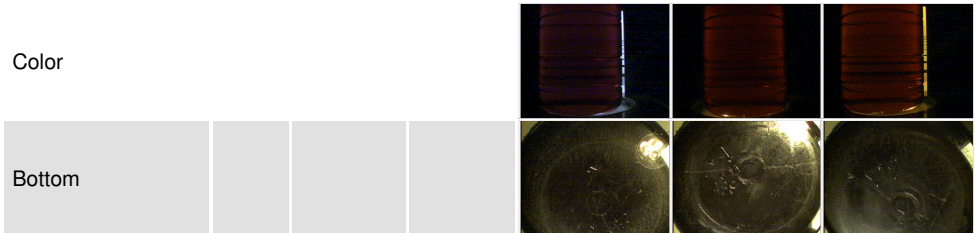

GRAPHS

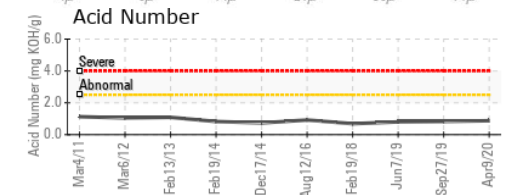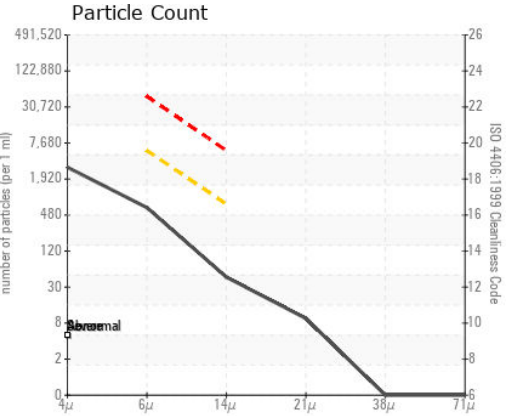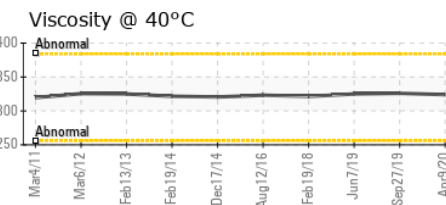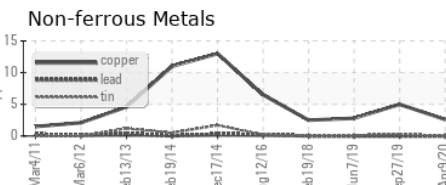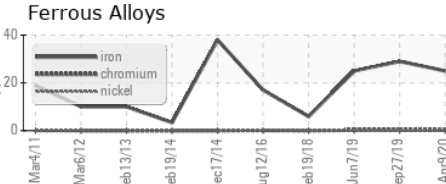

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MHI017688 **Received** : 20 Apr 2020
Lab Number : 04958624 **Tested** : 21 Apr 2020
Unique Number : 8998731 **Diagnosed** : 21 Apr 2020 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCont)

DIAMOND WTG - ARAGONNE MESA SITE - MPS AM
 PO BOX 372
 SANTA ROSA, NM
 US 88435
 Contact: BOBBY VILLANUEVA
 bobby.villanueva@diamondwtg.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
F: x: