OIL ANALYSIS REPORT

Sample Rating Trend

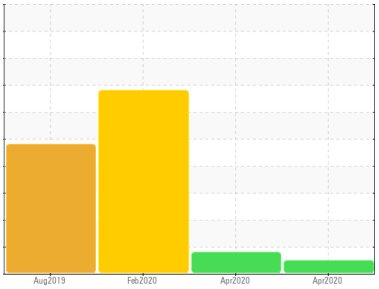

NORMAL

Area
P2
Machine Id
3521-A EVAPORATOR
Component
Gearbox
Fluid
MOBIL MOBILGEAR 600 XP ISO 150 (15 QTS)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor. (Customer Sample Comment: Cleaned oil in gearbox with oil filtration cart due to last oil sample result. Resampled.)

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0425052**	WC0425049	WC0425043
Sample Date		Client Info		**27 Apr 2020**	17 Apr 2020	24 Feb 2020
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**100**	60	150
Oil Changed		Client Info		**Not Changd**	Not Changd	Not Changd
Sample Status				**NORMAL**	ABNORMAL	SEVERE

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	**2**	11	512
Chromium	ppm	ASTM D5185m	>15	**<1**	<1	5
Nickel	ppm	ASTM D5185m	>15	**0**	<1	3
Titanium	ppm	ASTM D5185m		**0**	0	1
Silver	ppm	ASTM D5185m		**<1**	0	0
Aluminum	ppm	ASTM D5185m	>25	**0**	0	2
Lead	ppm	ASTM D5185m	>100	**<1**	0	2
Copper	ppm	ASTM D5185m	>200	**<1**	<1	<1
Tin	ppm	ASTM D5185m	>25	**0**	0	0
Antimony	ppm	ASTM D5185m		**3**	8	207
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**25**	23	21
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**<1**	0	<1
Manganese	ppm	ASTM D5185m		**<1**	<1	6
Magnesium	ppm	ASTM D5185m		**<1**	0	1
Calcium	ppm	ASTM D5185m		**<1**	<1	3
Phosphorus	ppm	ASTM D5185m		**327**	300	361
Zinc	ppm	ASTM D5185m		**0**	2	3
Sulfur	ppm	ASTM D5185m		**13649**	12476	14638

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	**2**	<1	4
Sodium	ppm	ASTM D5185m		**1**	<1	4
Potassium	ppm	ASTM D5185m	>20	**<1**	4	10
Water	%	ASTM D6304	>0.2	**0.010**	0.010	0.007
ppm Water	ppm	ASTM D6304	>2000	**106.1**	105.1	70.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	**12368**	65381	382771
Particles >6µm		ASTM D7647	>5000	**1298**	8997	55783
Particles >14µm		ASTM D7647	>640	**50**	244	570
Particles >21µm		ASTM D7647	>160	**11**	46	143
Particles >38µm		ASTM D7647	>40	**2**	4	3
Particles >71µm		ASTM D7647	>10	**1**	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	**21/17/13**	23/20/15	26/23/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.754**	0.745	0.669

OIL ANALYSIS REPORT

Water (KF)

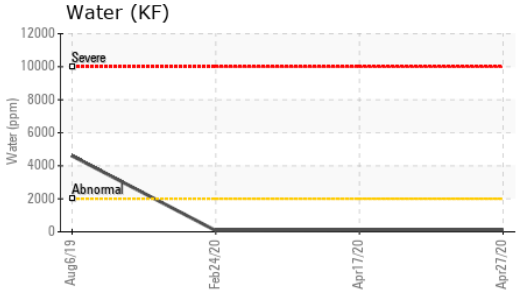

Particle Trend

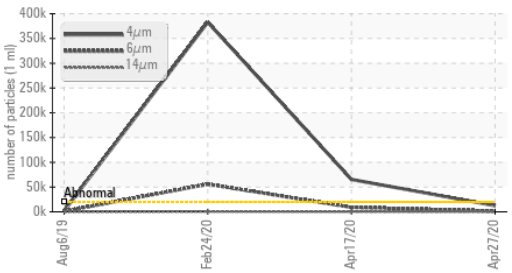

Water (KF)

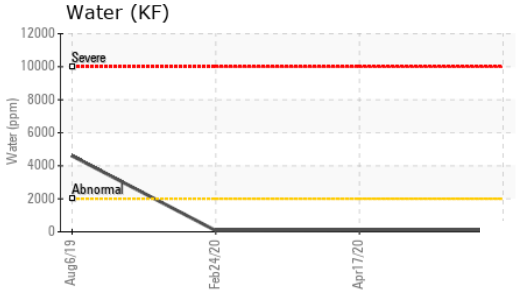

Viscosity @ 40°C

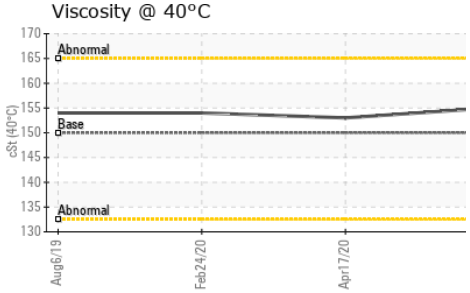

Particle Trend

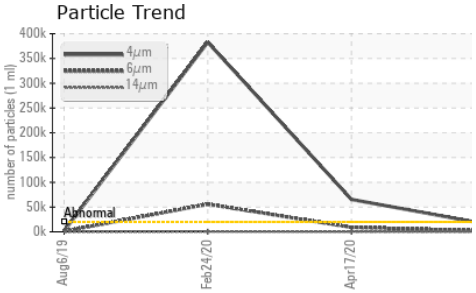

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	**155**	153	154

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

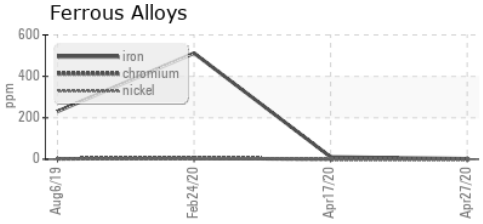

Non-ferrous Metals

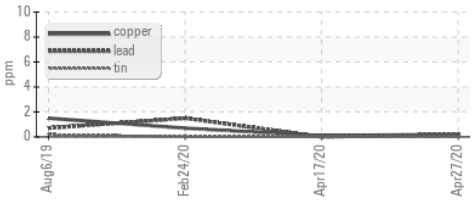

Viscosity @ 40°C

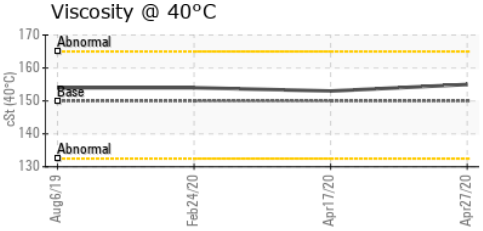

Particle Count

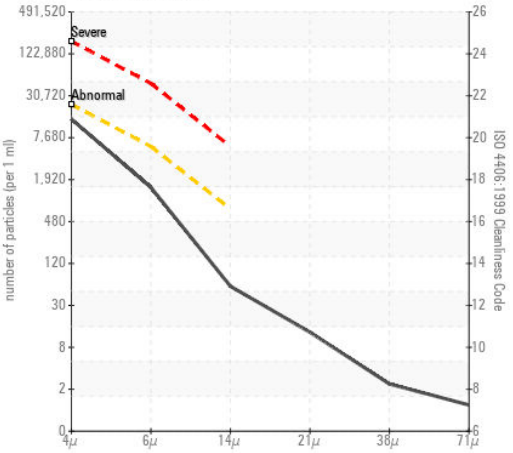

Acid Number

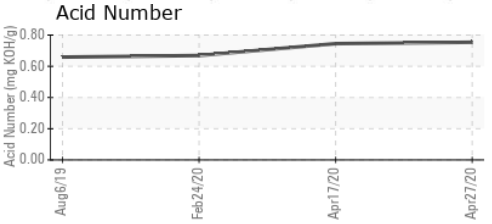

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0425052 **Recieved** : 29 Apr 2020
Lab Number : 04965691 **Diagnosed** : 30 Apr 2020
Unique Number : 9010832 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AJINOMOTO USA
4020 AJINOMOTO DRIVE
RALEIGH, NC
US 27610
Contact: Michael Thompson
thompsonm@ajiusa.com
T: (919)723-2142
F: