OIL ANALYSIS REPORT

Sample Rating Trend

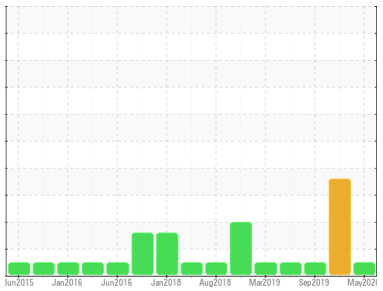

NORMAL

Machine Id
KAESER C-6E (S/N 1006)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number		Client Info		**WC0465730**	WC0390907	WCI2351486
Sample Date		Client Info		**06 May 2020**	08 Jan 2020	16 Sep 2019
Machine Age	hrs	Client Info		**142076**	138668	137649
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**Changed**	N/A	N/A
Sample Status				**NORMAL**	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	**0**	2	<1
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	<1	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**0**	<1	<1
Lead	ppm	ASTM D5185m	>10	**0**	<1	<1
Copper	ppm	ASTM D5185m	>50	**5**	▲ 40	8
Tin	ppm	ASTM D5185m	>10	**0**	<1	<1
Antimony	ppm	ASTM D5185m		**0**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		**<1**	1	0
Barium	ppm	ASTM D5185m	90	**0**	0	<1
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	<1	<1
Magnesium	ppm	ASTM D5185m	90	**0**	4	0
Calcium	ppm	ASTM D5185m	2	**<1**	<1	0
Phosphorus	ppm	ASTM D5185m		**9**	11	35
Zinc	ppm	ASTM D5185m		**0**	0	0
Sulfur	ppm	ASTM D5185m		**9816**	15803	6392

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	**1**	1	1
Sodium	ppm	ASTM D5185m		**0**	0	0
Potassium	ppm	ASTM D5185m	>20	**0**	0	0

FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647	>10000	**2077**	▲ 105081	3793
Particles >6µm		ASTM D7647	>2500	**987**	▲ 60500	1028
Particles >14µm		ASTM D7647	>320	**224**	▲ 14090	147
Particles >21µm		ASTM D7647	>80	**61**	▲ 5790	55
Particles >38µm		ASTM D7647	>20	**0**	▲ 521	10
Particles >71µm		ASTM D7647	>4	**0**	▲ 24	4
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**18/17/15**	▲ 24/23/21	19/17/14

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.439**	0.352	0.456

OIL ANALYSIS REPORT

Particle Trend

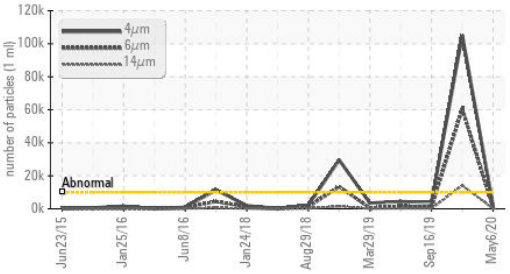

Acid Number

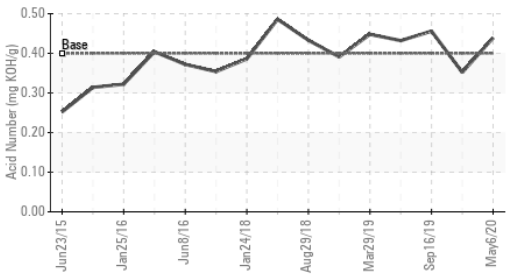

Viscosity @ 40°C

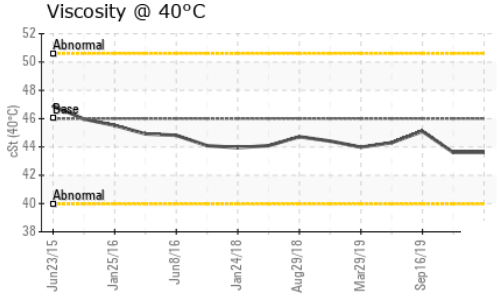

Particle Trend

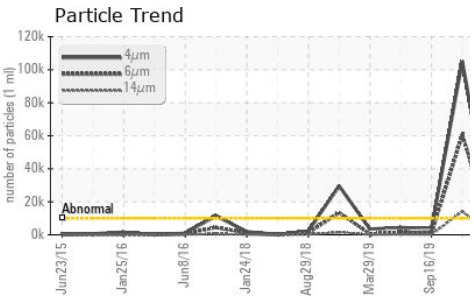

VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	**43.6**	43.6	45.1

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
Color					
Bottom					

GRAPHS

Ferrous Alloys

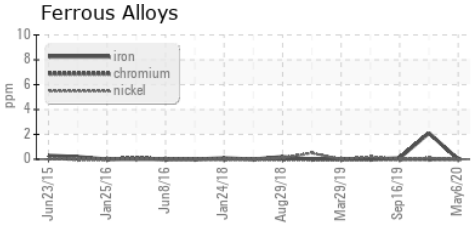

Non-ferrous Metals

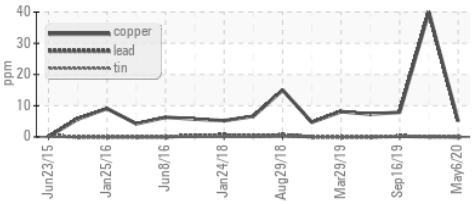

Viscosity @ 40°C

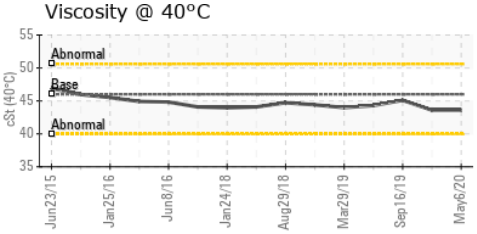

Particle Count

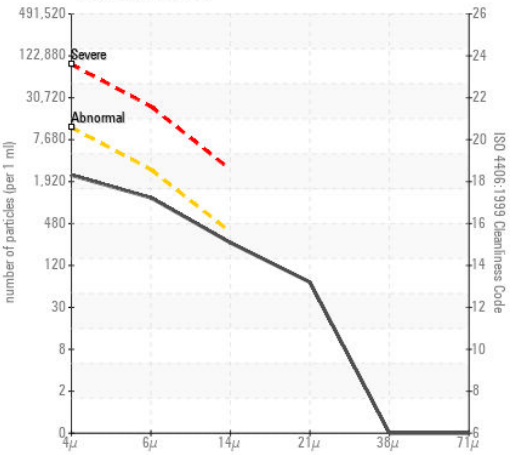

Acid Number

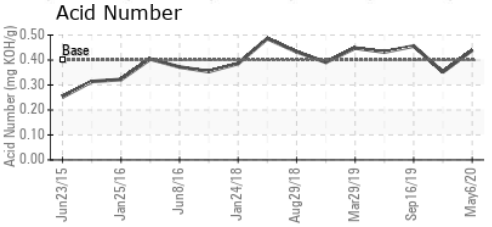

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0465730 **Received** : 20 May 2020
Lab Number : 04981688 **Diagnosed** : 21 May 2020
Unique Number : 9036835 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

2290 CALLAHAN RD
LONGVIEW, TX
US 75607
Contact: ROB WALLIN
rwallin@westlake.com
T: (903)242-7576
F: (903)758-9521