




# OIL ANALYSIS REPORT

Sample Rating Trend

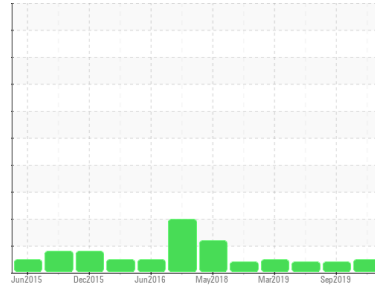

**NORMAL**



Machine Id  
**KAESER C-1 (S/N 1044)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number	Client Info			<b>WC0465728</b>	WCI2335369	WC04753356
Sample Date	Client Info			<b>07 May 2020</b>	16 Sep 2019	18 Jun 2019
Machine Age	hrs	Client Info		<b>32046</b>	27455	24491
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m	>50	<b>4</b>	10	3
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	2	<b>&lt;1</b>	0	2
Phosphorus	ppm	ASTM D5185m		<b>2</b>	0	16
Zinc	ppm	ASTM D5185m		<b>0</b>	<1	2
Sulfur	ppm	ASTM D5185m		<b>8094</b>	6928	8620

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	3	3
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	2
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	<1


FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		<b>683</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>126</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>8</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>2</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/14/10</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.584</b>	0.530	0.502




# OIL ANALYSIS REPORT


**Particle Trend**

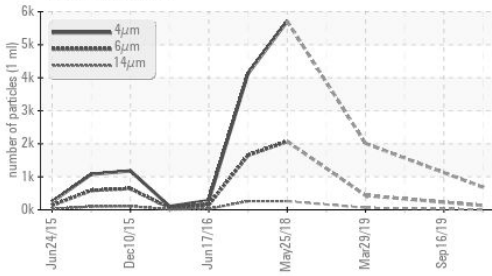


**Acid Number**

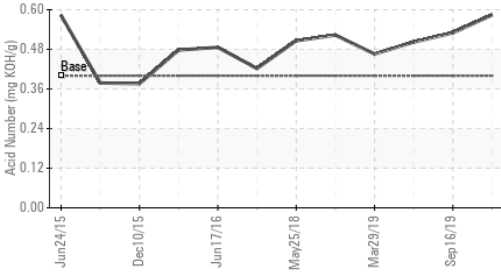

**Viscosity @ 40°C**

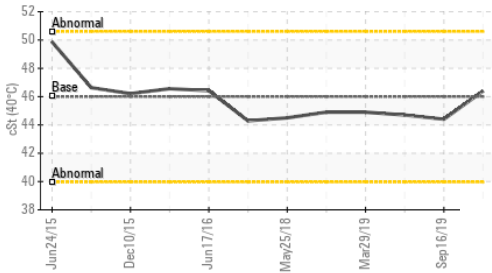


**Particle Trend**

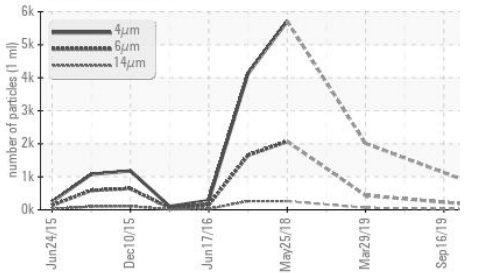




VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ HEAVY
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	<b>46.4</b>	44.4	44.7

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

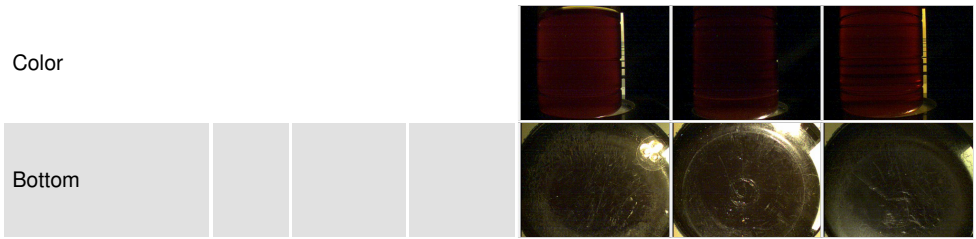

## GRAPHS

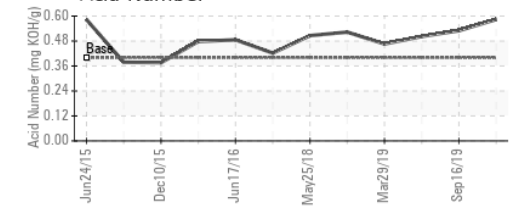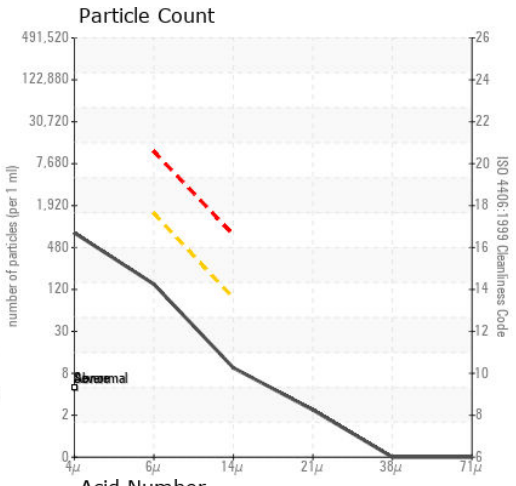

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0465728 **Received** : 20 May 2020  
**Lab Number** : **04981691** **Diagnosed** : 21 May 2020  
**Unique Number** : 9036838 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**WESTLAKE CHEMICAL**  
 2290 CALLAHAN RD  
 LONGVIEW, TX  
 US 75607  
 Contact: ROB WALLIN  
 rwallin@westlake.com  
 T: (903)242-7576  
 F: (903)758-9521

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)