




PROBLEM SUMMARY

Sample Rating Trend


ISO

Area
PASTA [95628425]
 Machine Id
STORAGE CONVEYING WEST (S/N 31351)
 Component
Blower
 Fluid
GEAR OIL ISO 320 (--- GAL)

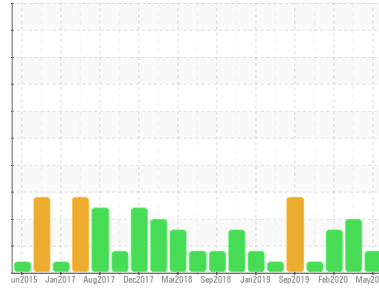

COMPONENT CONDITION SUMMARY

▲ Particle Trend

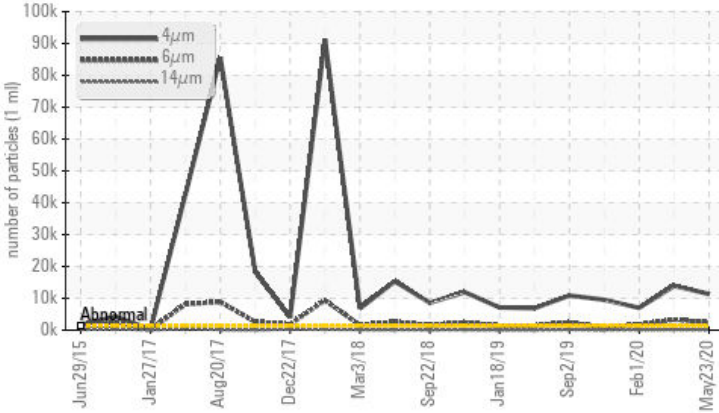

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>1300	▲ 11339	▲ 13906	▲ 6989
Particles >6µm	ASTM D7647	>320	▲ 2413	▲ 3311	▲ 1735
Oil Cleanliness	ISO 4406 (c)	>17/15/13	▲ 21/18/13	▲ 21/19/14	▲ 20/18/14

Customer Id: KRASPR
 Sample No.: USP206184
 Lab Number: 05000127
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

20 Mar 2020 Diag: Jonathan Hester

ADDITIVES



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Feb 2020 Diag: Jonathan Hester

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Nov 2019 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

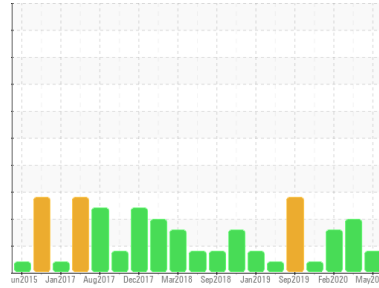

ISO



Area
PASTA [95628425]
 Machine Id
STORAGE CONVEYING WEST (S/N 31351)
 Component
Blower
 Fluid
GEAR OIL ISO 320 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP206184	USP206143	USP205097
Sample Date	Client Info	23 May 2020	20 Mar 2020	01 Feb 2020
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Changed	Changed	Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	3	2	2
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	<1	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	<1	0	<1
Lead	ppm	ASTM D5185m >20	<1	0	0
Copper	ppm	ASTM D5185m >20	0	<1	0
Tin	ppm	ASTM D5185m >20	0	0	0
Antimony	ppm	ASTM D5185m	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 50	0	<1	<1
Barium	ppm	ASTM D5185m 15	0	<1	0
Molybdenum	ppm	ASTM D5185m 15	1	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 50	<1	0	0
Calcium	ppm	ASTM D5185m 50	<1	<1	<1
Phosphorus	ppm	ASTM D5185m 350	153	172	295
Zinc	ppm	ASTM D5185m 100	1	0	0
Sulfur	ppm	ASTM D5185m 12500	0	▲ 6	6

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<1	1	<1
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	5	0	0
Water	%	ASTM D6304	0.003	0.001	0.00
ppm Water	ppm	ASTM D6304	28.5	11.9	0.00

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	▲ 11339	▲ 13906	▲ 6989
Particles >6µm	ASTM D7647 >320	▲ 2413	▲ 3311	▲ 1735
Particles >14µm	ASTM D7647 >80	80	▲ 142	▲ 94
Particles >21µm	ASTM D7647 >20	14	▲ 26	▲ 21
Particles >38µm	ASTM D7647 >4	2	1	1
Particles >71µm	ASTM D7647 >3	1	0	0
Oil Cleanliness	ISO 4406 (c) >17/15/13	▲ 21/18/13	▲ 21/19/14	▲ 20/18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	0.538	0.649	1.029




OIL ANALYSIS REPORT

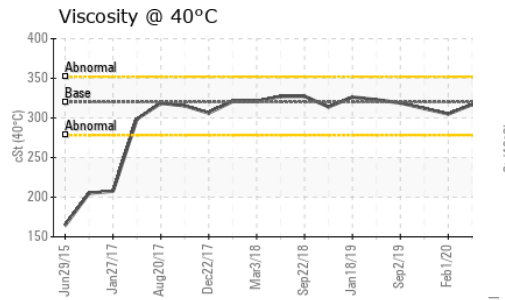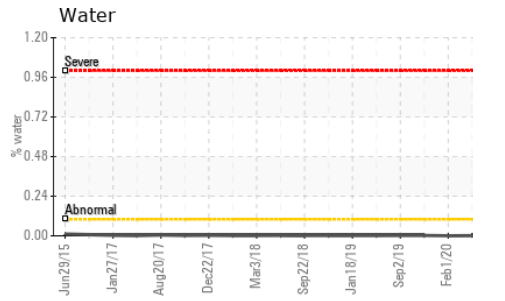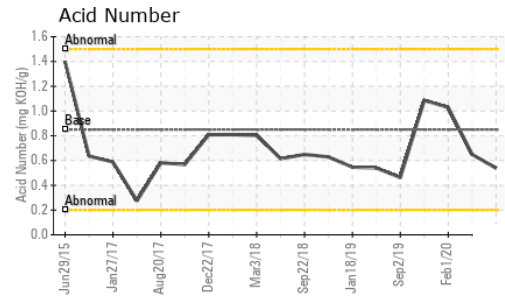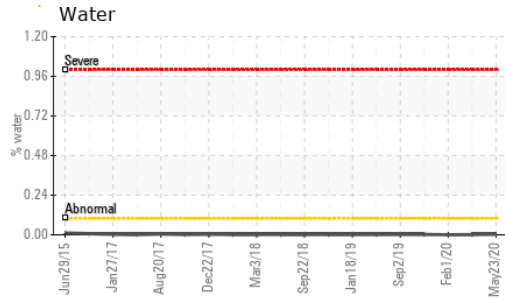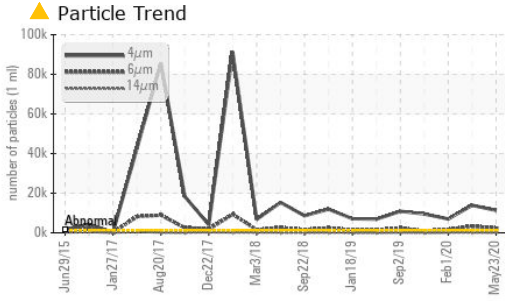





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	VLITE	NONE
Yellow Metal	scalar	*Visual	NONE	VLITE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	317	305

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

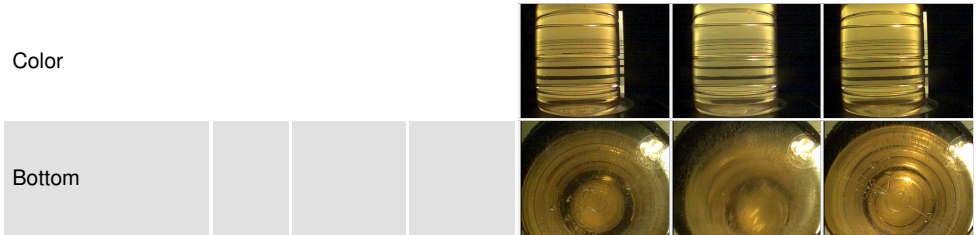

GRAPHS

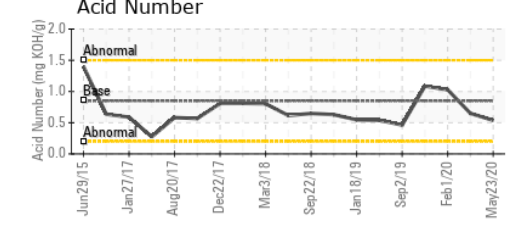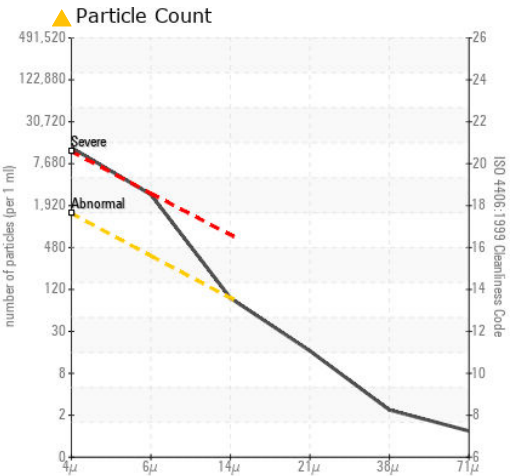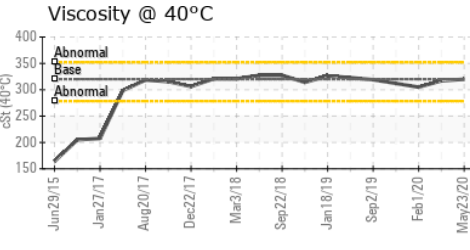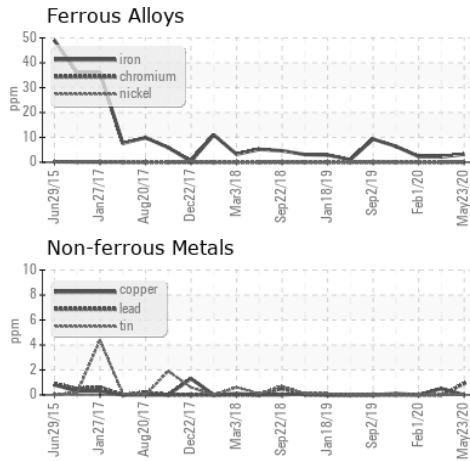

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP206184
 Lab Number : 05000127
 Unique Number : 9065280
 Test Package : IND 2

KraftHeinz - Springfield - Plant 8311 USP
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Paul Pierce
 paul.pierces@kraftheinz.com
 T: 1(417)576-7628
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)