

OIL ANALYSIS REPORT

Sample Rating Trend





 $^{\text{Machine Id}}_{6987206}$ (S/N 1132)

Component

Compressor

{not provided} (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Feb2020		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC84003		
Sample Date		Client Info		08 Feb 2020		
Machine Age	hrs	Client Info		4077		
Oil Age	hrs	Client Info		4077		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.006		
ppm Water	ppm	ASTM D6304	>500	68.6		
FLUID CLEANLIN	IESS _	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		208		
Particles >6µm		ASTM D7647	>1300	62		
Particles >14µm		ASTM D7647	>80	14		
Particles >21µm		ASTM D7647	>20	12		
Particles >38µm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	13/11		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A sial Nivershau (ANI)	m = 1/011/-	ACTM DOCAT		0.510		


Acid Number (AN)

mg KOH/g ASTM D8045

0.519



OIL ANALYSIS REPORT

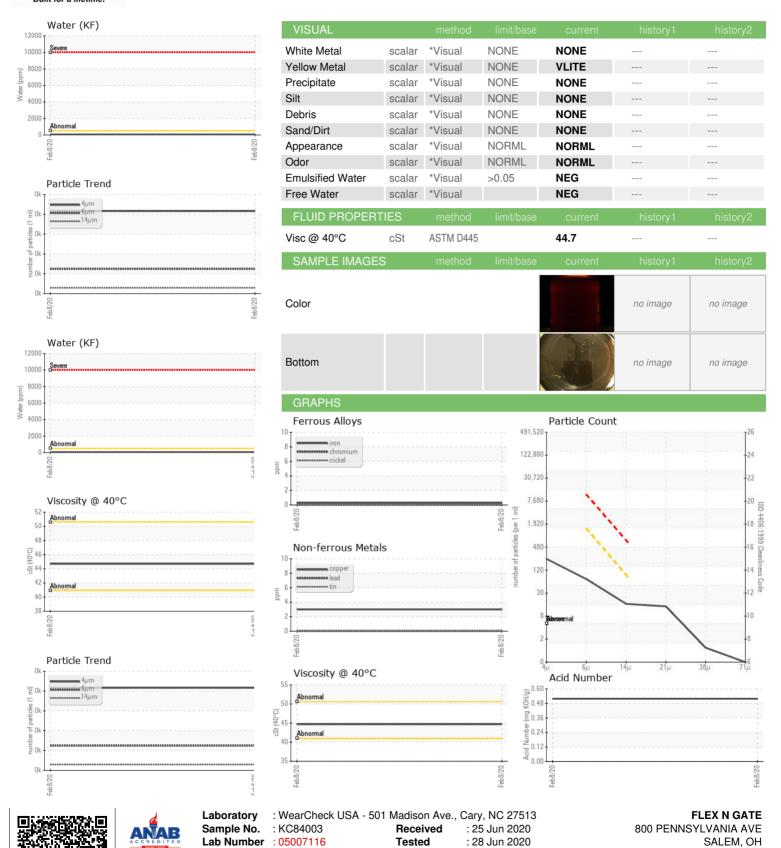

Certificate L2367

Unique Number : 9077270

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2

: 28 Jun 2020 - Don Baldridge

Diagnosed

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 44460

T:

F:

Contact: Service Manager