




# OIL ANALYSIS REPORT

Sample Rating Trend

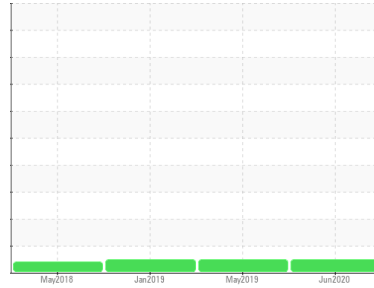

**NORMAL**



Machine Id  
**KAESER CSD 75 6019866 (S/N 1348)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC84378</b>	KC74855	KC75450
Sample Date	Client Info			<b>23 Jun 2020</b>	29 May 2019	07 Jan 2019
Machine Age	hrs	Client Info		<b>5353</b>	3459	2617
Oil Age	hrs	Client Info		<b>1894</b>	800	1900
Oil Changed	Client Info			<b>Changed</b>	Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	1	1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	2	2
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>3</b>	6	3
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>29</b>	21	34
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>8</b>	0	0
Zinc	ppm	ASTM D5185m		<b>15</b>	21	12

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>7</b>	2	<1
Sodium	ppm	ASTM D5185m		<b>10</b>	5	4
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	7	7
Water	%	ASTM D6304	>0.05	<b>0.020</b>	0.017	0.011
ppm Water	ppm	ASTM D6304	>500	<b>203.4</b>	170	110

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>983</b>	507	3707
Particles >6µm		ASTM D7647	>1300	<b>457</b>	178	871
Particles >14µm		ASTM D7647	>80	<b>14</b>	24	26
Particles >21µm		ASTM D7647	>20	<b>3</b>	6	3
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>16/11</b>	15/12	17/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.403</b>	0.423	0.408


# OIL ANALYSIS REPORT

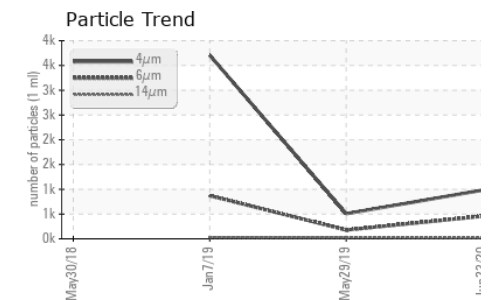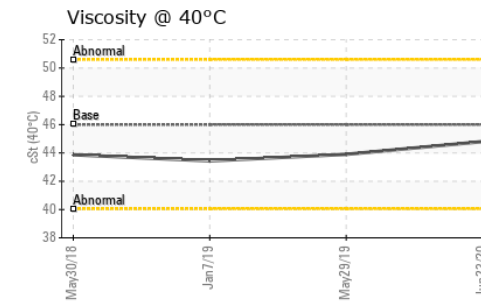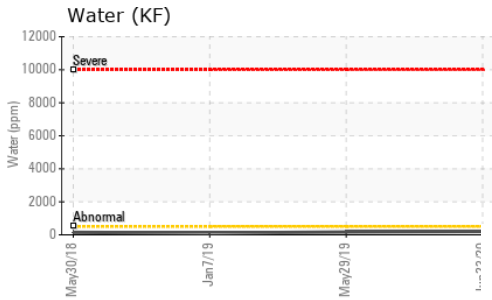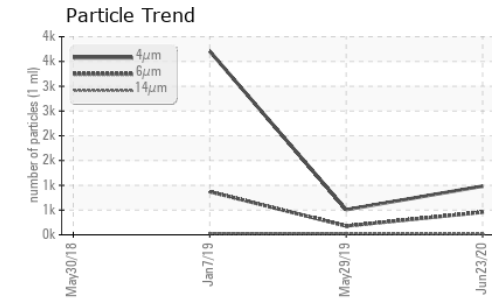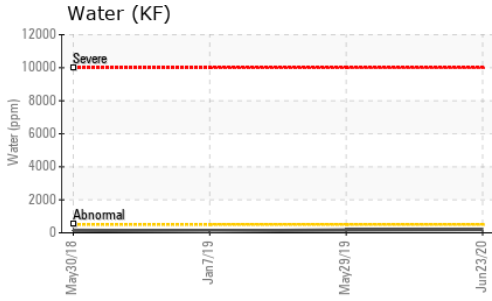




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.8	43.9	43.44

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

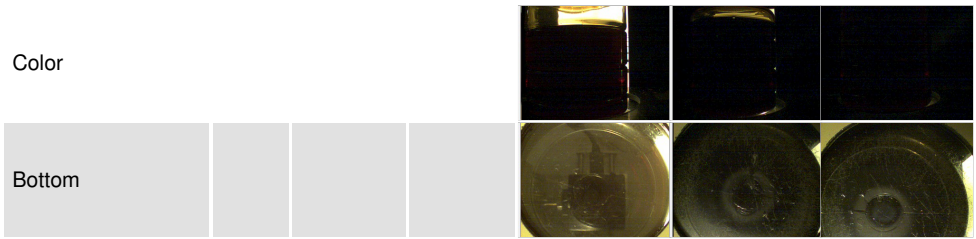

## GRAPHS

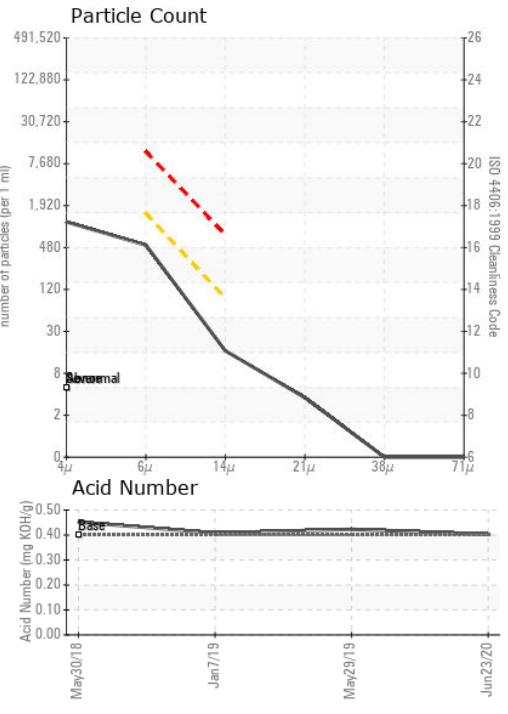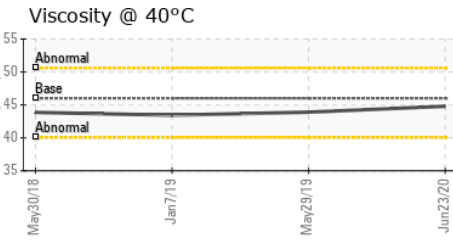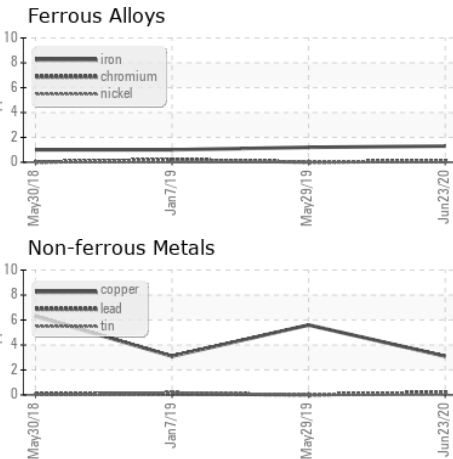

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC84378  
**Lab Number** : 05009369  
**Unique Number** : 9079523  
**Test Package** : IND 2  
**Received** : 29 Jun 2020  
**Tested** : 30 Jun 2020  
**Diagnosed** : 30 Jun 2020 - Doug Bogart

**DIE-MATIC CORP**  
 201 EASTVIEW DR  
 BROOKLYN HEIGHTS, OH  
 US 44131  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: