


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

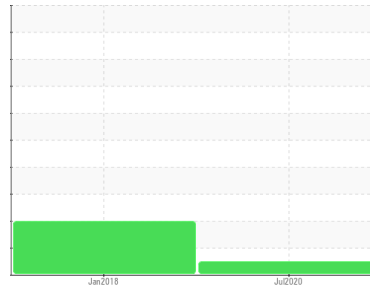

Machine Id
KAESER SX 5 3367834 (S/N 1006)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP10009	KCP08656	---
Sample Date	Client Info			13 Jul 2020	26 Jan 2018	---
Machine Age	hrs	Client Info		757	716	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				NORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	12	---
Chromium	ppm	ASTM D5185m	>10	0	<1	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	0	---
Lead	ppm	ASTM D5185m	>10	<1	<1	---
Copper	ppm	ASTM D5185m	>50	<1	1	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	2	---
Barium	ppm	ASTM D5185m	90	15	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	2	---
Magnesium	ppm	ASTM D5185m	90	23	42	---
Calcium	ppm	ASTM D5185m	2	<1	2	---
Phosphorus	ppm	ASTM D5185m		2	42	---
Zinc	ppm	ASTM D5185m		18	89	---
Sulfur	ppm	ASTM D5185m		16704	19705	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	---
Sodium	ppm	ASTM D5185m		7	70	---
Potassium	ppm	ASTM D5185m	>20	1	10	---
Water	%	ASTM D6304	>0.05	0.014	▲ 0.198	---
ppm Water	ppm	ASTM D6304	>500	149.9	▲ 1980	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1051	---	---
Particles >6µm		ASTM D7647	>1300	178	---	---
Particles >14µm		ASTM D7647	>80	10	---	---
Particles >21µm		ASTM D7647	>20	4	---	---
Particles >38µm		ASTM D7647	>4	3	---	---
Particles >71µm		ASTM D7647	>3	3	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	15/10	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.147	0.285	---


OIL ANALYSIS REPORT

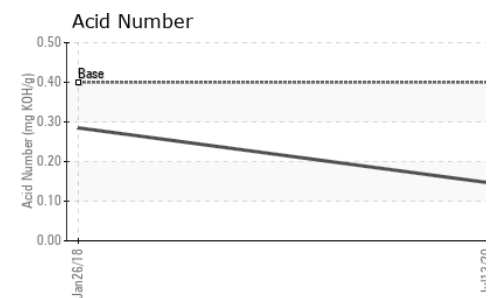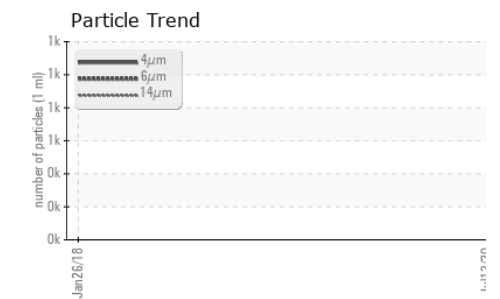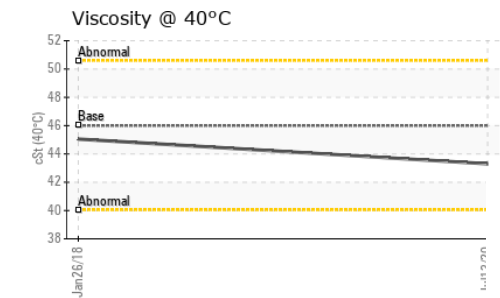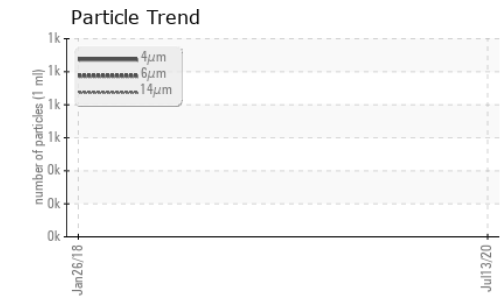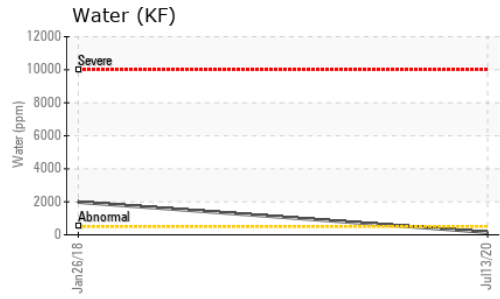




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.3	45.05

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

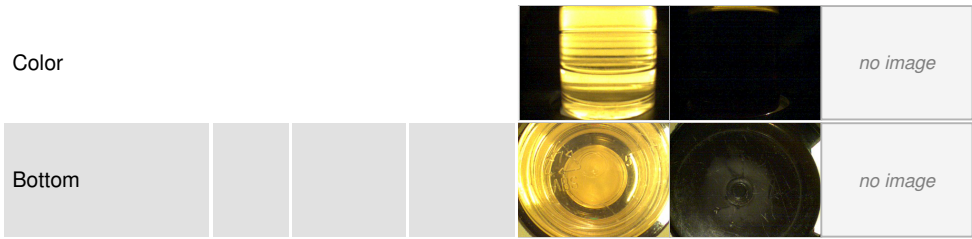

GRAPHS

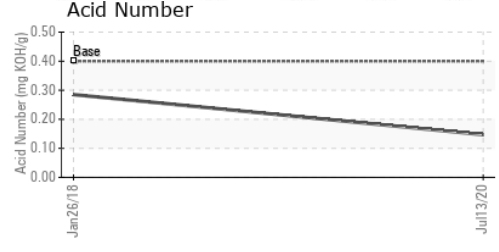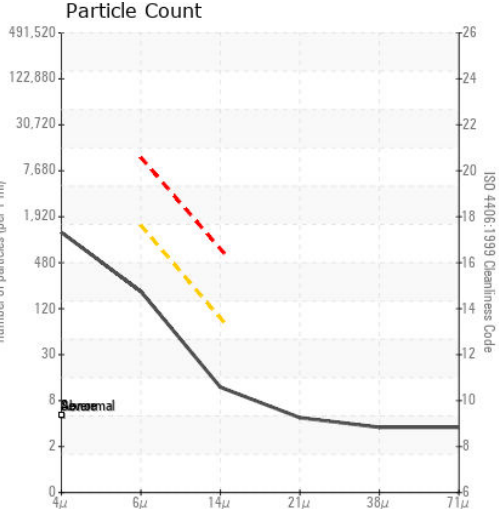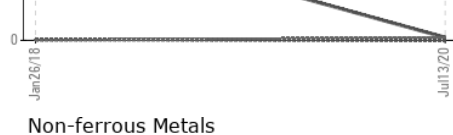

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP10009 **Received** : 27 Jul 2020
Lab Number : 05028617 **Tested** : 28 Jul 2020
Unique Number : 9113778 **Diagnosed** : 28 Jul 2020 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SPRAYING SYSTEMS MIDWEST
 18997 W 158TH ST
 OLATHE, KS
 US 66062
 Contact: SCOTT MONSON
 scott.monson@spray.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)