




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

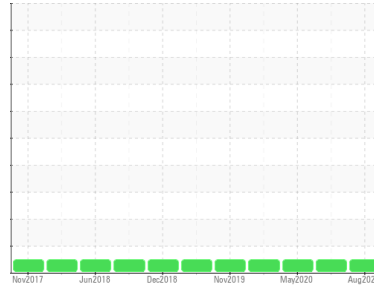

Area  
**97**  
 Machine Id  
**[97] A97 B112**  
 Component  
**Center Compressor**  
 Fluid  
**COMP LIFE 100 (8 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number	Client Info			<b>HPL007581</b>	HPL007627	HPL008631
Sample Date	Client Info			<b>05 Aug 2020</b>	16 Jul 2020	20 May 2020
Machine Age	hrs	Client Info		<b>56438</b>	57832	52588
Oil Age	hrs	Client Info		<b>720</b>	2114	7382
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<b>15</b>	0	<1
Chromium	ppm	ASTM D5185m	>5	<b>4</b>	0	0
Nickel	ppm	ASTM D5185m		<b>2</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	1
Lead	ppm	ASTM D5185m	>65	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>65	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	12	0
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m		<b>150</b>	177	158
Phosphorus	ppm	ASTM D5185m		<b>8</b>	9	8
Zinc	ppm	ASTM D5185m		<b>2</b>	0	5
Sulfur	ppm	ASTM D5185m		<b>16664</b>	17999	17034



CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>35	<b>1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>11</b>	4	1
Potassium	ppm	ASTM D5185m	>20	<b>10</b>	<1	0

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.222</b>	0.164	0.195

VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG











# OIL ANALYSIS REPORT

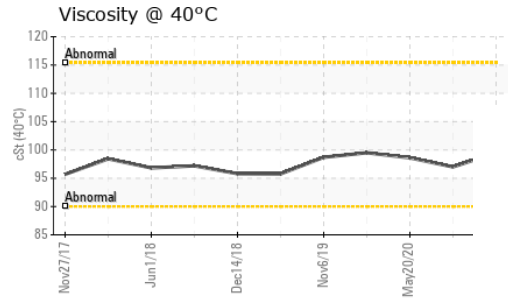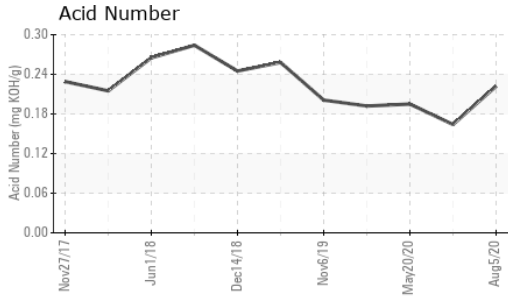

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	<b>99.5</b>	97.0	98.6

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

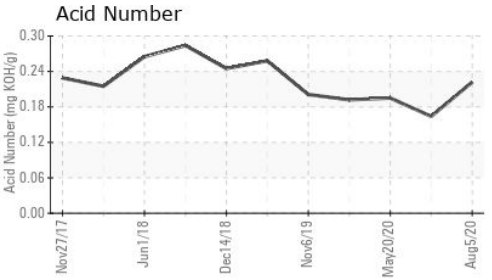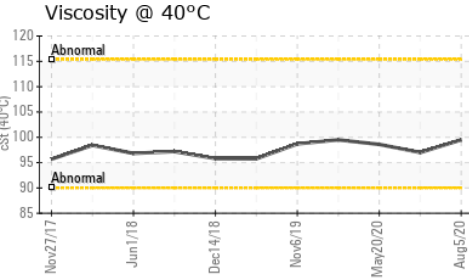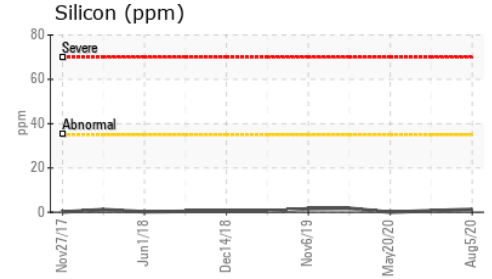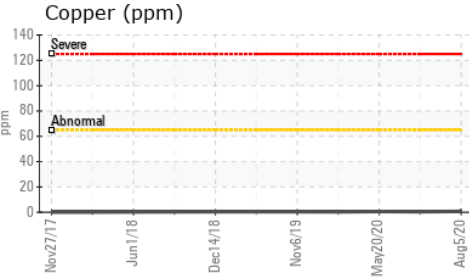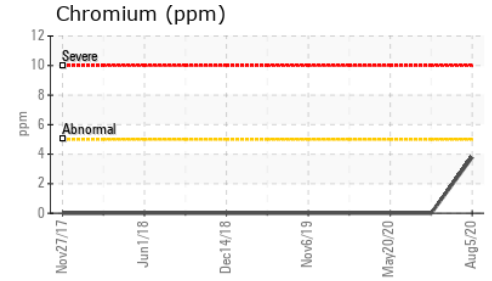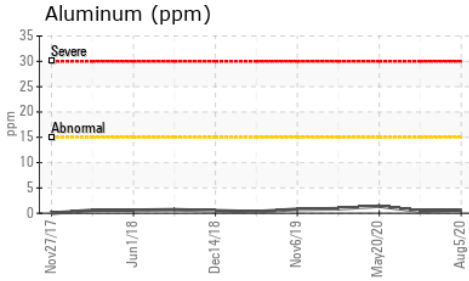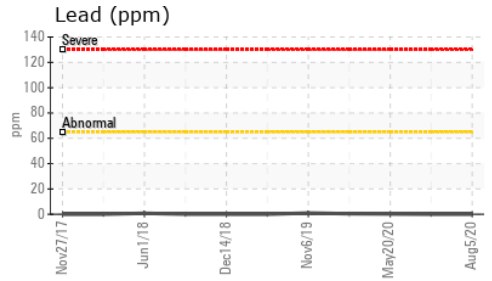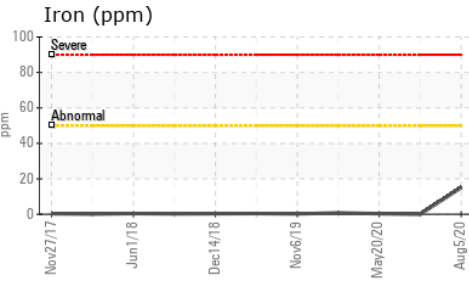

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HPL007581 **Received** : 26 Aug 2020  
**Lab Number** : 05051985 **Diagnosed** : 26 Aug 2020  
**Unique Number** : 9152165 **Diagnostician** : Doug Bogart  
**Test Package** : MOB 2

**KENSING**  
 2525 S KENSINGTON RD  
 KANKAKEE, IL  
 US 60901

Contact: TIM HUBERT  
 timothy.hubert@kensingsolutions.com

T: (815)939-8918

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)