

OIL ANALYSIS REPORT

7239207 (S/N 1010)

Component

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

Sample Rating Trend ISO

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | L | | Aug 2020 | | |
|------------------|----------|--------------|------------|---------------|----------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KC78889 | | |
| Sample Date | | Client Info | | 26 Aug 2020 | | |
| Machine Age | hrs | Client Info | | 2020 | | |
| Oil Age | hrs | Client Info | | 2020 | | |
| Oil Changed | | Client Info | | Changed | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | | |
| Chromium | ppm | ASTM D5185m | >10 | <1 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | <1 | | |
| Aluminum | ppm | ASTM D5185m | >10 | 7 | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 6 | | |
| Tin | ppm | ASTM D5185m | >10 | <1 | | |
| Antimony | ppm | ASTM D5185m | | 0 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | <1 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 5 | | |
| Barium | ppm | ASTM D5185m | | 0 | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | | 53 | | |
| Calcium | ppm | ASTM D5185m | | 0 | | |
| Phosphorus | ppm | ASTM D5185m | 500 | 7 | | |
| Zinc | ppm | ASTM D5185m | | 11 | | |
| CONTAMINANTS | 3 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 3 | | |
| Sodium | ppm | ASTM D5185m | | 13 | | |
| Potassium | ppm | ASTM D5185m | >20 | 7 | | |
| Water | % | ASTM D6304 | >0.05 | 0.027 | | |
| ppm Water | ppm | ASTM D6304 | >500 | 271.0 | | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 5852 | | |
| Particles >6µm | | ASTM D7647 | >1300 | ^ 2644 | | |
| Particles >14μm | | ASTM D7647 | >80 | 80 | | |
| Particles >21µm | | ASTM D7647 | >20 | 14 | | |
| Particles >38µm | | ASTM D7647 | >4 | 1 | | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | 19/13 | | |
| FLUID DEGRADA | ATION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.5 | 0.395 | | |



OIL ANALYSIS REPORT

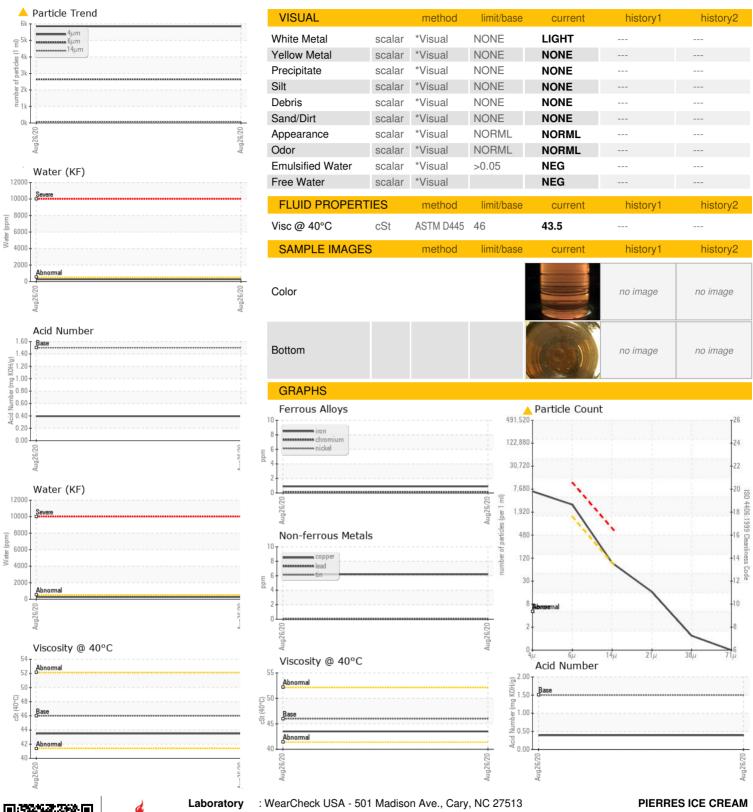



Certificate L2367

Sample No. Lab Number

: KC78889 : 05056790

Unique Number: 9156970 Test Package : IND 2

Received **Tested** Diagnosed

: 01 Sep 2020 : 02 Sep 2020

: 03 Sep 2020 - Don Baldridge

6200 EUCLID AVE CLEVELAND, OH US 44103

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: