


OIL ANALYSIS REPORT







Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2020	Sep2020		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC85191	KC83607	
Sample Date		Client Info		22 Sep 2020	22 May 2020	
Machine Age	hrs	Client Info		1946	1441	
Oil Age	hrs	Client Info		1946	1441	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	2	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	12	6	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Antimony	ppm	ASTM D5185m		<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		13	<1	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	1	<1	
Calcium	ppm	ASTM D5185m	2	4	<1	
Phosphorus	ppm	ASTM D5185m		7	3	
Zinc	ppm	ASTM D5185m		26	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	<1	<1	
Water	%	ASTM D6304	>0.05	0.005	0.005	
ppm Water	ppm	ASTM D6304	>500	58.0	59.6	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		312	377	
Particles >6µm		ASTM D7647	>1300	103	117	
Particles >14µm		ASTM D7647	>80	8	7	
Particles >21µm		ASTM D7647	>20	3	2	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	14/10	14/10	
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
A - ! - ! A ! ! (A N !)		AOTM D0045	0.4	0.449	0.440	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.440

0.448



OIL ANALYSIS REPORT

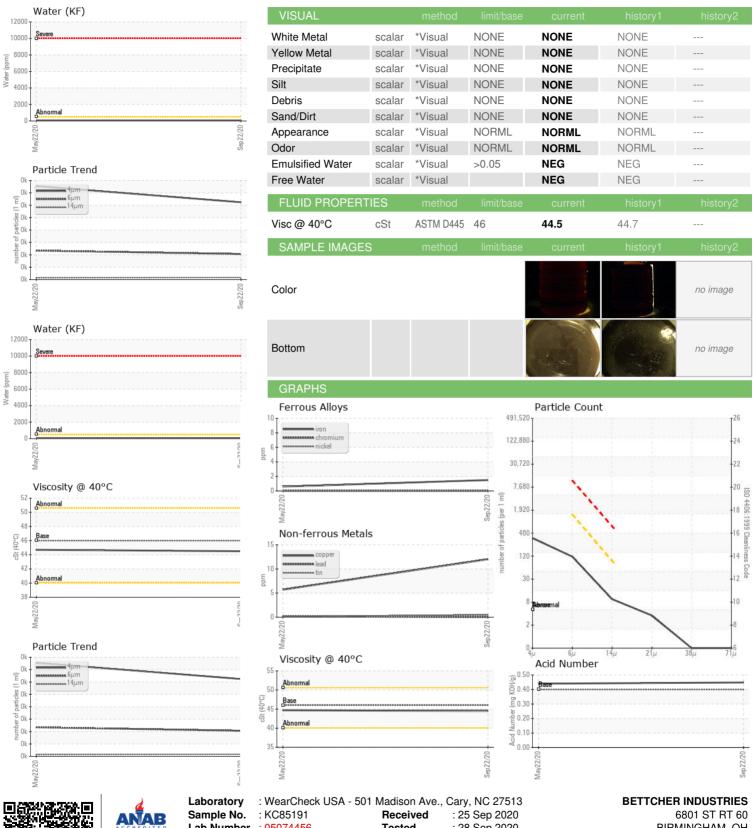





Certificate L2367

Lab Number

: 05074456 Unique Number: 9189687 Test Package : IND 2

Tested

Diagnosed

: 28 Sep 2020 : 28 Sep 2020 - Don Baldridge BIRMINGHAM, OH US 44889

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: