

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

KAESER BSD 60 2722725 (S/N 1080)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		ļ				
				Nov2020		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	I/(IIOIV		III III Dasc		,	
Sample Number		Client Info		KC91471		
Sample Date	,	Client Info		09 Nov 2020		
Machine Age	hrs	Client Info		81166		
Oil Age	hrs	Client Info		2333 Ohammad		
Oil Changed		Client Info		Changed ABNORMAL		
Sample Status				ADNURIMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	7		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	12		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		4		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.008		
ppm Water	ppm	ASTM D6304	>500	87.6		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		11769		
Particles >6µm		ASTM D7647	>1300	^ 2602		
Particles >14µm		ASTM D7647	>80	124		
Particles >21µm		ASTM D7647	>20	2 9		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.336		501,1
ACIO INUITIDEI (AIN)	ilig NU⊓/g	79 LINI D0043	0.4	0.330		



OIL ANALYSIS REPORT

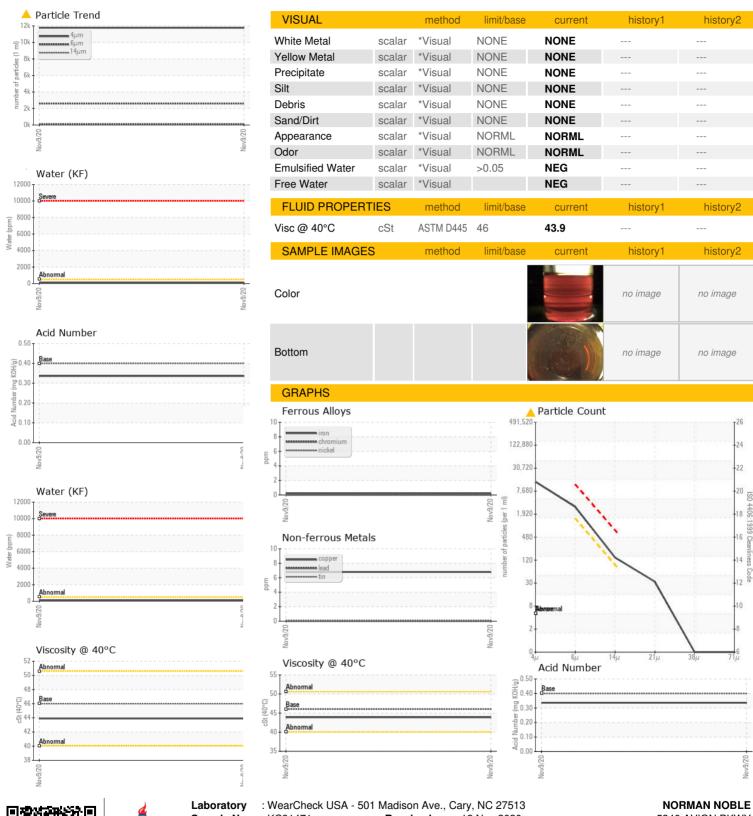



Certificate L2367

Sample No. Lab Number

: KC91471 : 05114267

Unique Number : 9254531 Test Package : IND 2

Received : 12 Nov 2020 **Tested** : 16 Nov 2020 Diagnosed

: 16 Nov 2020 - Angela Borella

5340 AVION PKWY HIGHLAND HEIGHTS, OH US 44143

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: