




# OIL ANALYSIS REPORT

Sample Rating Trend

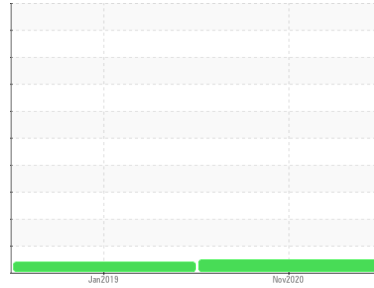

**NORMAL**



Machine Id  
**KAESER DSD 175 6221021 (S/N 1016)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC85173</b>	KC75327	---
Sample Date	Client Info		<b>19 Nov 2020</b>	05 Jan 2019	---
Machine Age	hrs	Client Info	<b>6954</b>	3624	---
Oil Age	hrs	Client Info	<b>3330</b>	3624	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>10</b>	9	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>&lt;1</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m 90	<b>2</b>	0	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>5</b>	<1	---
Zinc	ppm	ASTM D5185m	<b>0</b>	0	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>3</b>	0	---
Sodium	ppm	ASTM D5185m	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.011</b>	0.004	---
ppm Water	ppm	ASTM D6304 >500	<b>113.6</b>	40	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>989</b>	8292	---
Particles >6µm	ASTM D7647 >1300		<b>306</b>	▲ 3108	---
Particles >14µm	ASTM D7647 >80		<b>11</b>	38	---
Particles >21µm	ASTM D7647 >20		<b>1</b>	8	---
Particles >38µm	ASTM D7647 >4		<b>0</b>	0	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>15/11</b>	▲ 19/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.380</b>	0.357	---


# OIL ANALYSIS REPORT

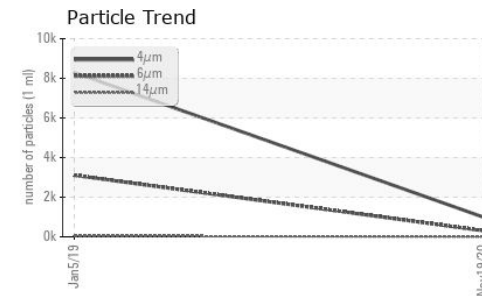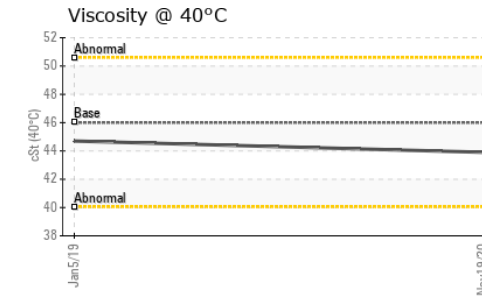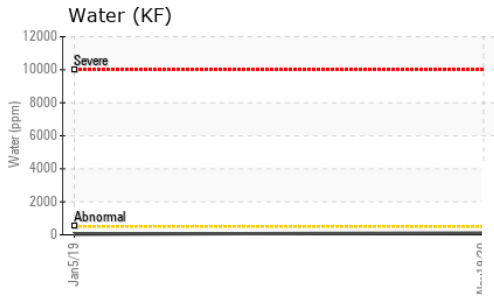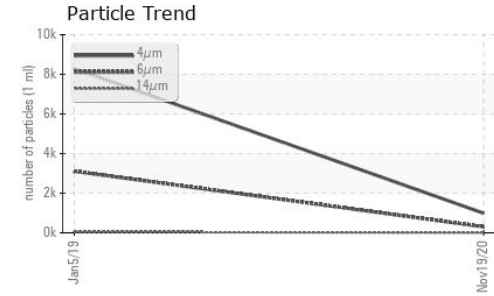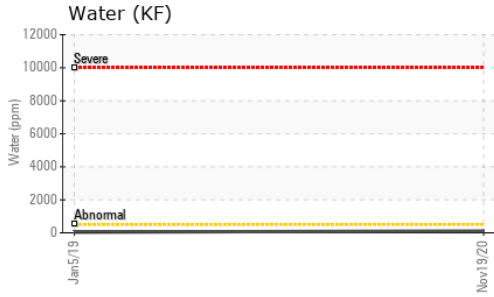






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.9	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

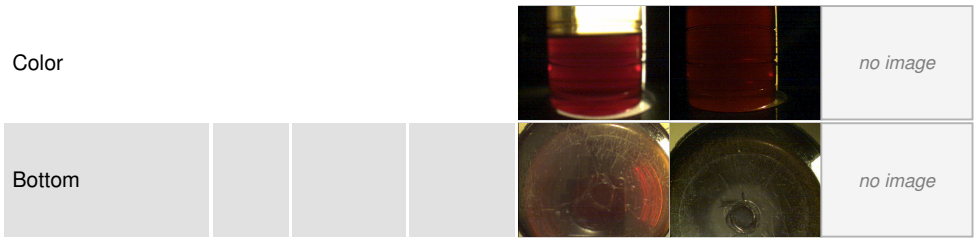

## GRAPHS

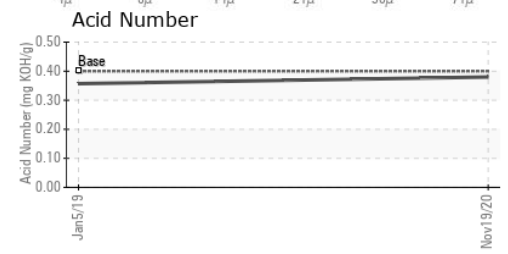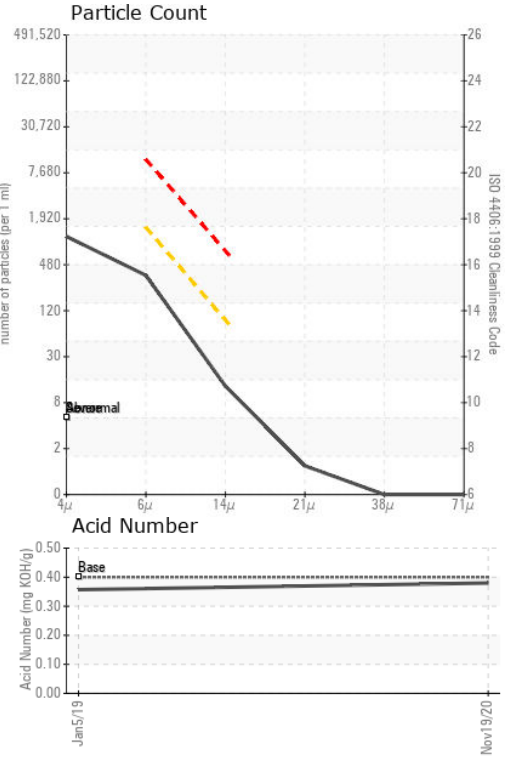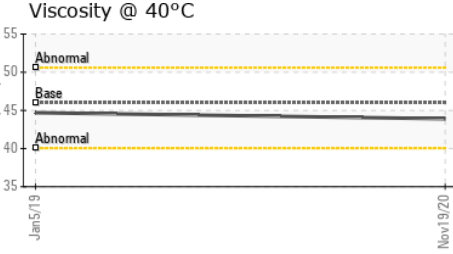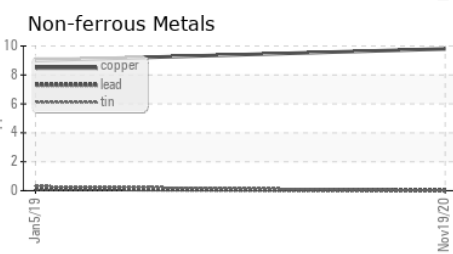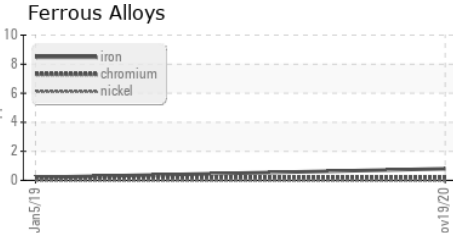

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC85173  
**Lab Number** : 05125324  
**Unique Number** : 9270593  
**Test Package** : IND 2  
**Received** : 27 Nov 2020  
**Tested** : 30 Nov 2020  
**Diagnosed** : 30 Nov 2020 - Don Baldrige

**PERMATEx**  
 6875 PARKLAND BLVD  
 SOLON, OH  
 US 44139  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: