

OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Machine Id
123
 Component
Hydraulic System
 Fluid
{not provided} (42 GAL)



DIAGNOSIS

- Recommendation**
 No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
 All component wear rates are normal.
- Contamination**
 There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.
- Fluid Condition**
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP202491	---	---
Sample Date	Client Info		20 Nov 2020	---	---
Machine Age	hrs	Client Info	25000	---	---
Oil Age	hrs	Client Info	25000	---	---
Oil Changed	Client Info		Not Changed	---	---
Sample Status			ATTENTION	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<1	---	---
Chromium	ppm	ASTM D5185m >20	<1	---	---
Nickel	ppm	ASTM D5185m >20	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	<1	---	---
Aluminum	ppm	ASTM D5185m >20	0	---	---
Lead	ppm	ASTM D5185m >20	<1	---	---
Copper	ppm	ASTM D5185m >20	2	---	---
Tin	ppm	ASTM D5185m >20	0	---	---
Antimony	ppm	ASTM D5185m	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	<1	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	<1	---	---
Calcium	ppm	ASTM D5185m	34	---	---
Phosphorus	ppm	ASTM D5185m	297	---	---
Zinc	ppm	ASTM D5185m	361	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---
Water	%	ASTM D6304 >0.05	0.004	---	---
ppm Water	ppm	ASTM D6304 >500	47.5	---	---

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	5347	---	---
Particles >6µm	ASTM D7647	>1300	526	---	---
Particles >14µm	ASTM D7647	>160	23	---	---
Particles >21µm	ASTM D7647	>40	7	---	---
Particles >38µm	ASTM D7647	>10	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	20/16/12	---	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.249	---	---

OIL ANALYSIS REPORT

Particle Trend

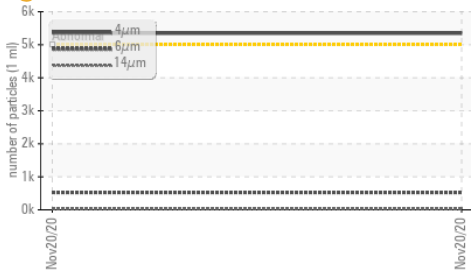


Water (KF)

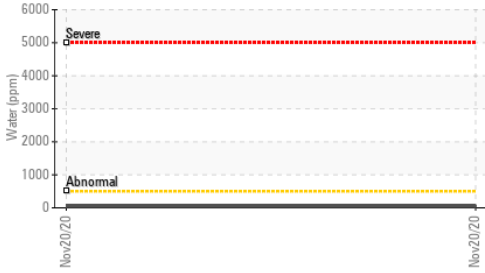

Acid Number



Water (KF)

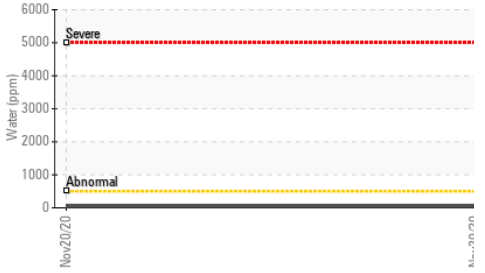

Viscosity @ 40°C




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	66.3	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

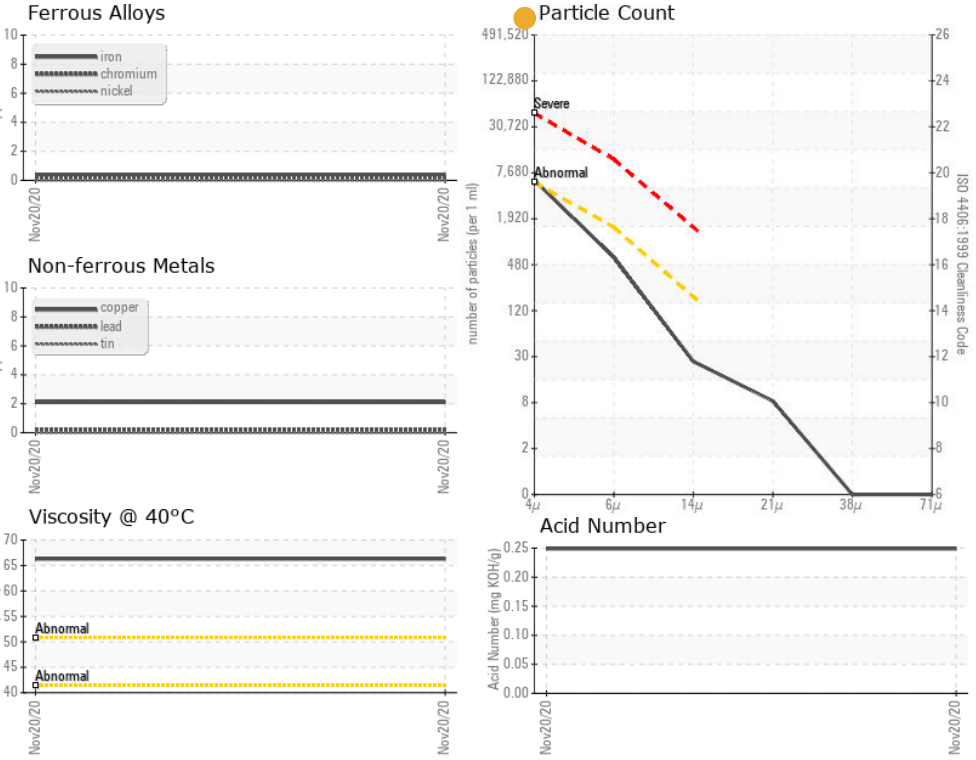

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP202491 **Received** : 11 Dec 2020
Lab Number : 05135028 **Tested** : 14 Dec 2020
Unique Number : 9285298 **Diagnosed** : 14 Dec 2020 - Jonathan Hester
Test Package : IND 2

TEAM SUR S.A.S.
 BOGOTA, CO
 Contact: Team Sur
 jconde@teamsur.com
 T: (300)740-0654
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)