

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

KAESER 7370207

Component Compressor Fluid

{not provided} (--- GAL)

DIAGNOSIS

A Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC91490		
Sample Date		Client Info		04 Jan 2021		
Machine Age	hrs	Client Info		2275		
Oil Age	hrs	Client Info		2275		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
	1-1-		line it //s a s a		lainte mut	history O
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		34		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		5		
Zinc	ppm	ASTM D5185m		35		
CONTAMINANTS	i	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		13		
Potassium	ppm	ASTM D5185m	>20	9		
Water	%	ASTM D6304	>0.05	0.015		
ppm Water	ppm	ASTM D6304	>500	155.0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		11674		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	1 9/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
			mmbase			
Acid Number (AN)	mg KOH/g	ASTM D8045		0.341		



Built for a lifetime."





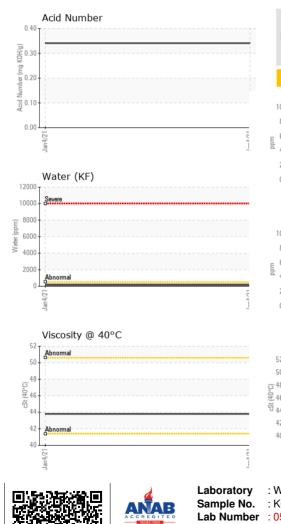

OIL ANALYSIS REPORT

	VISUAL		method	limit/base	current	history1	history
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	LIGHT		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.05	NEG		
	Free Water	scalar	*Visual		NEG		
	FLUID PROPER	TIES	method	limit/base	current	history1	histor
	Visc @ 40°C	cSt	ASTM D445		43.8		
	SAMPLE IMAGE	S	method	limit/base	current	history1	histor
	Color					no image	no imag
	Bottom					no imogo	no ima
	Dottom					no image	no imag
	GRAPHS						
	Ferrous Alloys			491,520	Particle Count		
	8 - iron chromium			122.000			
	6 - nickel			122,880			
6				30,720	ł		
	2			7,680	1		
	Jan 4/21						
	Jar			토 1,920· 이 33			
	Non-ferrous Meta	als		480 ·		1	
	10 8 copper			12/huer 1,920			
	nananananan lead			numt)	
- 1				30-			
ŝ							
ł	2-				Bierese mal		
i	2				Bevee mal		
	2			Jan4/21	-		
	2 0 1 (7) 4 uer				μ 6μ	14μ 21μ	38µ
	Viscosity @ 40°C				-	14µ 21µ	38µ
	Viscosity @ 40°C				μ 6μ	14µ 21µ	38µ
	Viscosity @ 40°C				μ 6μ	14µ 21µ	зёµ
	2 0 Viscosity @ 40°C				μ 6μ	14μ 21μ	38µ 7
	2 0 Viscosity @ 40°C 5 5 4 4 4 4 4 4 4 4 2 4 6 4 4 4 4 2 4 0 4 0°C				μ 6μ	14µ 21µ	36µ
	Viscosity @ 40°C			(0,40 (0,40) (0,40) (0,40) (0,40) (0,0,0) (0,0,0) (0,0	Acid Number	14µ 21µ	36µ
	2 0 Viscosity @ 40°C 5 5 4 4 4 4 4 4 4 4 2 4 6 4 4 4 4 2 4 0 4 0°C				μ 6μ	14 ¹ µ 21 ¹ µ	38µ
254 (40°C)	Viscosity @ 40°C			12/huer (B/H0X Bull) a qumN point 12/huer (B/H0X Bull) a qumN point 12/huer	Acid Number		
rss+ (40°C)	Viscosity @ 40°C	01 Madisc		(B)400 (B	Acid Number	REP	UBLIC WA
	Viscosity @ 40°C		ived :11	12/huer (B/H0X Bull) a qumN point 12/huer (B/H0X Bull) a qumN point 12/huer	Acid Number		UBLIC WA

Test Package : IN To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: Service Manager - REPOBEKC

T:

F: