


OIL ANALYSIS REPORT

P3 3543-D Crystallizer Gearbox (S/N N/A)

Agitator Gearbox

Mobilgear 629 (44 QTS)





DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jul2020	Sep.2020	Nov2020 J	an 2021	
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0536891	WC0506427	WC0472484
Sample Date		Client Info		12 Jan 2021	02 Nov 2020	02 Sep 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>150	14	2	12
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>10	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<1	0	<1
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>50	0	0	<1
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m		0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		37	36	32
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	<1	3
Phosphorus	ppm	ASTM D5185m		371	308	320
Zinc	ppm	ASTM D5185m		0	0	3
Sulfur	ppm	ASTM D5185m		16557	12854	14628
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	0	0	<1
Sodium	ppm	ASTM D5185m		0	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.1	0.009	0.024	0.017
ppm Water	ppm	ASTM D6304	>1000	97.7	245.0	178.0
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>20000	△ 62482	<u></u> 58840	<u></u> 118918
Particles >6µm		ASTM D7647	>5000	▲ 5756	▲ 6663	<u>^</u> 22118
Particles >14μm		ASTM D7647	>640	142	213	342
Particles >21μm		ASTM D7647	>160	27	42	54
Particles >38μm		ASTM D7647	>40	0	1	2
Particles >71μm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	23/20/14	23/20/15	<u>4</u> 24/22/16
FLUID DEGRADA		method	limit/base	current	history1	history2

0.818



OIL ANALYSIS REPORT

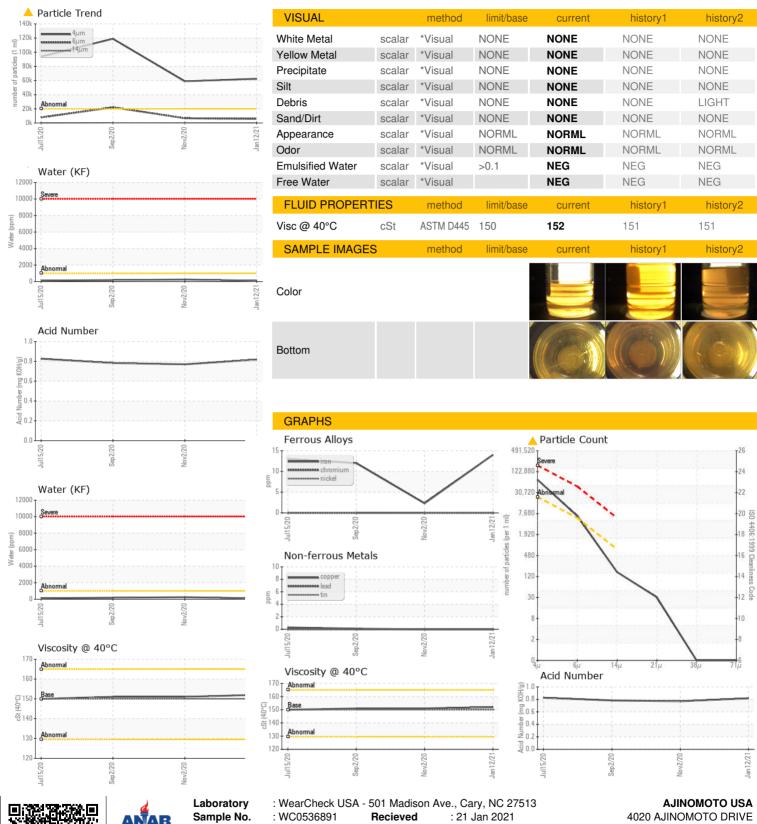



Certificate L2367

Lab Number **Unique Number**

: 05163172

: 9333454

Diagnosed

: 22 Jan 2021

Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

RALEIGH, NC US 27610

Contact: AJINOMOTO ACCOUNT ANGELA.BORELLA@WEARCHECKUSA.COM

T:

F: