

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

7186413 (S/N 1058)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2021		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC94009		
Sample Date		Client Info		28 Jan 2021		
Machine Age	hrs	Client Info		471		
Oil Age	hrs	Client Info		471		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m	0	0		
	ppm			35		
Barium	ppm	ASTM D5185m	90			
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	100	<1		
Magnesium	ppm	ASTM D5185m	100	78		
Calcium	ppm	ASTM D5185m	0	6		
Phosphorus	ppm	ASTM D5185m	0	8		
Zinc	ppm	ASTM D5185m	0	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	8		
Water	%	ASTM D6304	>0.05	0.030		
ppm Water	ppm	ASTM D6304	>500	305.4		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		2694		
Particles >6µm		ASTM D7647	>1300	1009		
Particles >14μm		ASTM D7647	>80	39		
Particles >21µm		ASTM D7647	>20	5		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	I/OLI/-	ACTM DOOM	1.0	0.210		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.319



OIL ANALYSIS REPORT

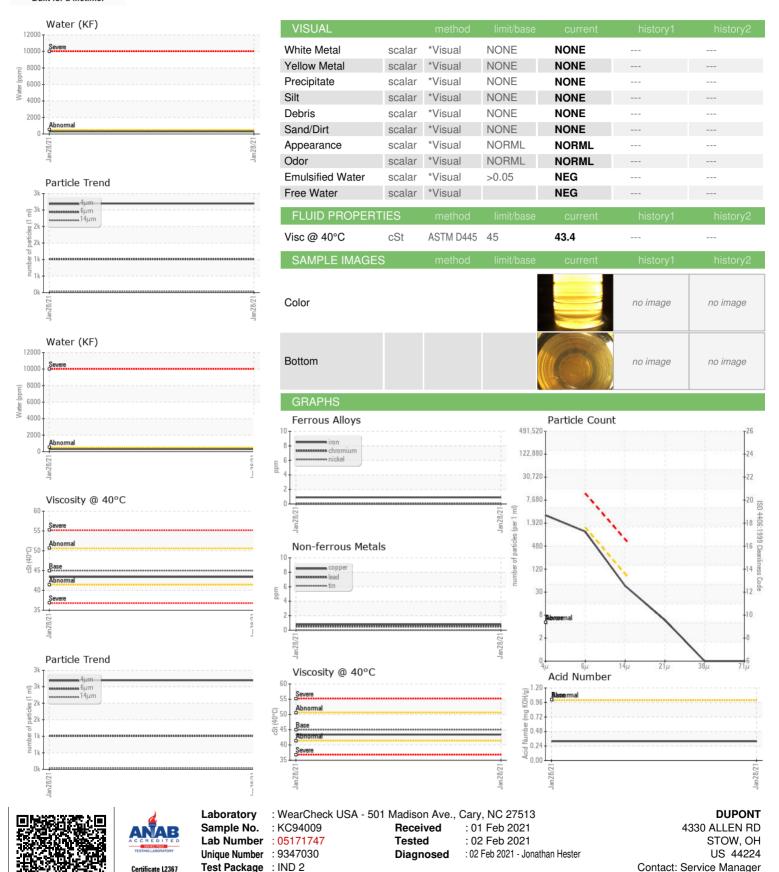

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

T:

F: