

OIL ANALYSIS REPORT

Sample Rating Trend **NORMAL**

Machine Id KAESER SFC 55 7180975 (S/N 1024)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Feb 2021		
SAMPLE INFORM	AATION.	method			hiotomia	hiotom/2
	MATION		limit/base	current	history1	history2
Sample Number		Client Info		KC91415		
Sample Date		Client Info		09 Feb 2021		
Machine Age	hrs	Client Info		9251		
Oil Age	hrs	Client Info		6759		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m	mmrsacc	10		
Barium	ppm	ASTM D5185m	90	0		
	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m	90	1		
Magnesium Calcium	ppm	ASTM D5185m		0		
	ppm		2	-		
Phosphorus	ppm	ASTM D5185m		5		
Zinc	ppm	ASTM D5185m		1		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.004		
ppm Water	ppm	ASTM D6304	>500	46.3		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		551		
Particles >6µm		ASTM D7647	>1300	129		
Particles >14µm		ASTM D7647	>80	8		
Particles >21µm		ASTM D7647	>20	2		
Particles >38µm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	14/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
						HISTOLYZ
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.357		



OIL ANALYSIS REPORT

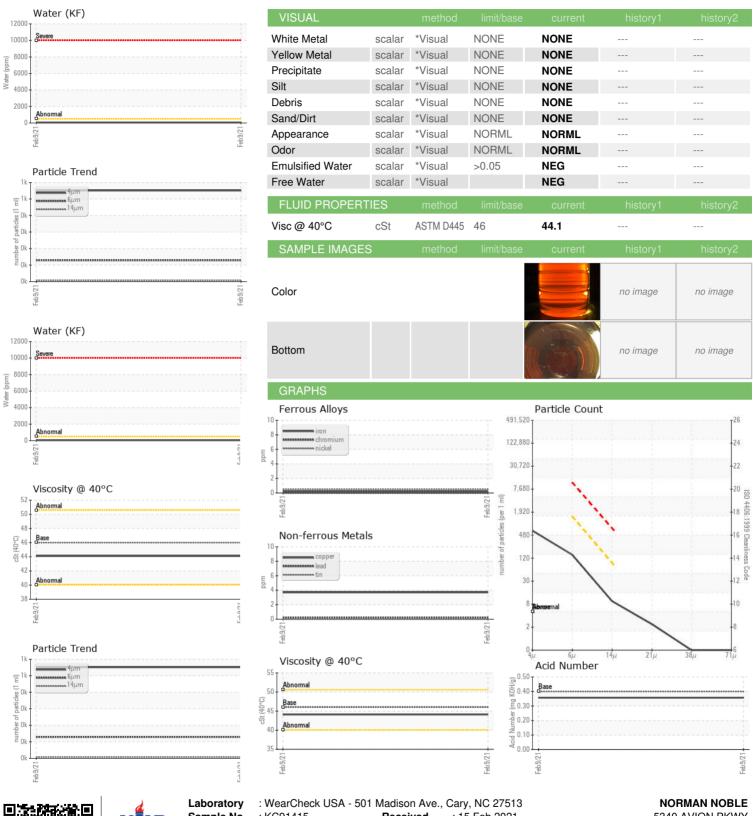





Certificate L2367

Sample No. Lab Number

: KC91415 : 05183088 Unique Number

: 9368377 Test Package : IND 2

Received : 15 Feb 2021 : 16 Feb 2021 **Tested**

Diagnosed : 16 Feb 2021 - Don Baldridge

5340 AVION PKWY HIGHLAND HEIGHTS, OH

US 44143 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: