




OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area
P1
Machine Id
3201-A - 3200-A CRYSTALLIZER
Component
Gearbox
Fluid
MOBIL MOBILGEAR 600 XP ISO 150 (27 QTS)

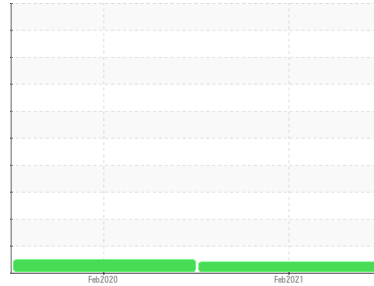

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0524632	WC0425040	---
Sample Date	Client Info		19 Feb 2021	04 Feb 2020	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	365	---
Oil Changed	Client Info		N/A	Not Changd	---
Sample Status			ATTENTION	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	2	<1	---
Chromium	ppm	ASTM D5185m	>15	0	0	---
Nickel	ppm	ASTM D5185m	>15	<1	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	1	---
Aluminum	ppm	ASTM D5185m	>25	0	0	---
Lead	ppm	ASTM D5185m	>100	0	0	---
Copper	ppm	ASTM D5185m	>200	<1	0	---
Tin	ppm	ASTM D5185m	>25	0	<1	---
Antimony	ppm	ASTM D5185m		2	2	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		17	16	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		0	<1	---
Phosphorus	ppm	ASTM D5185m		309	290	---
Zinc	ppm	ASTM D5185m		0	2	---
Sulfur	ppm	ASTM D5185m		12945	15955	---

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<1	<1	---
Sodium	ppm	ASTM D5185m		<1	<1	---
Potassium	ppm	ASTM D5185m	>20	4	<1	---
Water	%	ASTM D6304	>0.2	0.007	0.008	---
ppm Water	ppm	ASTM D6304	>2000	75.7	88.9	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 25425	9448	---
Particles >6µm	ASTM D7647	>5000	2840	1089	---
Particles >14µm	ASTM D7647	>640	50	15	---
Particles >21µm	ASTM D7647	>160	9	5	---
Particles >38µm	ASTM D7647	>40	0	0	---
Particles >71µm	ASTM D7647	>10	0	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 22/19/13	20/17/11	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.788	0.765	---




OIL ANALYSIS REPORT

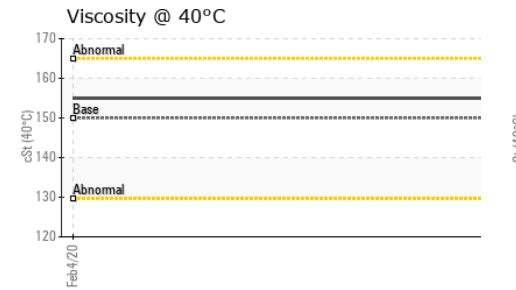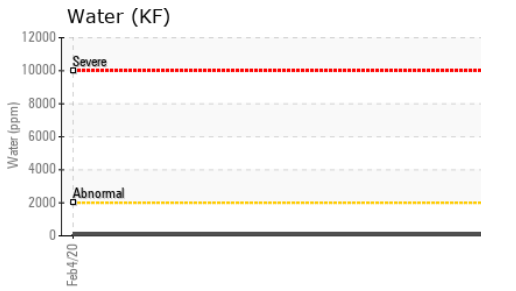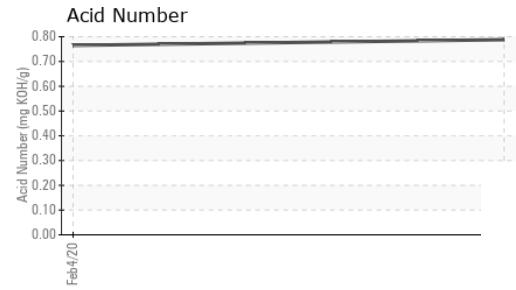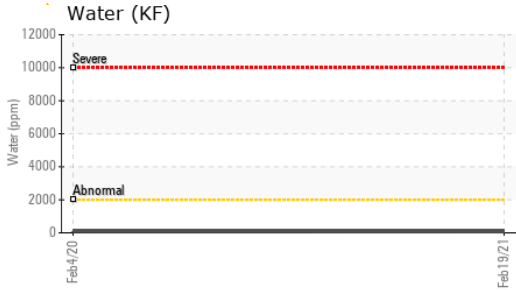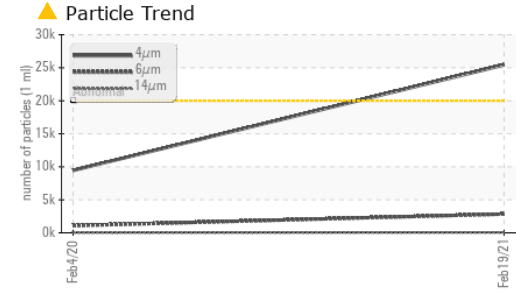





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	155	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

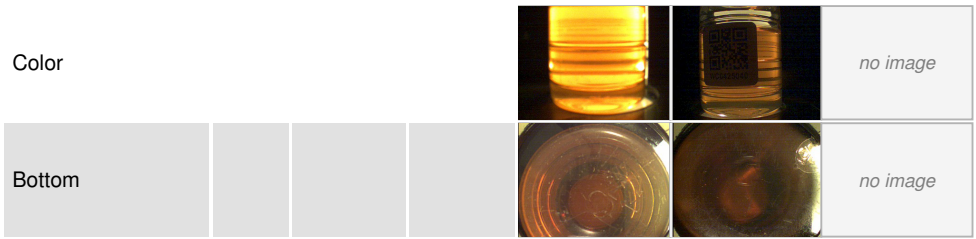

GRAPHS

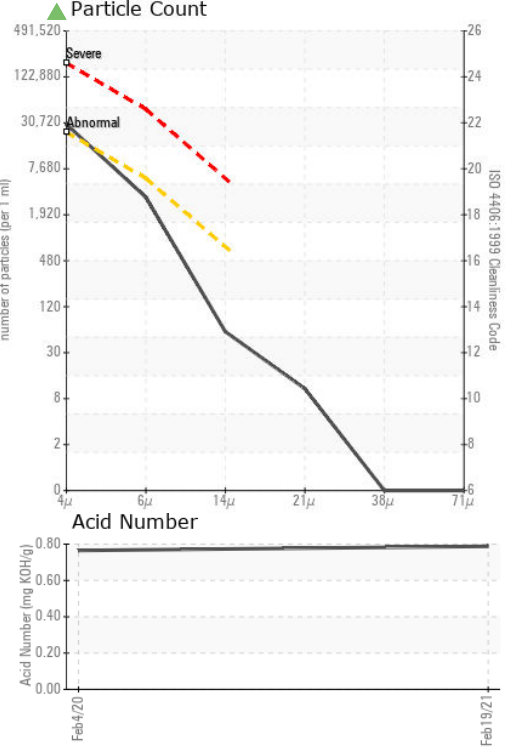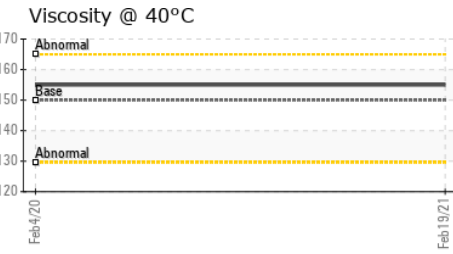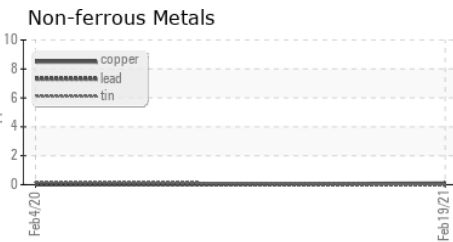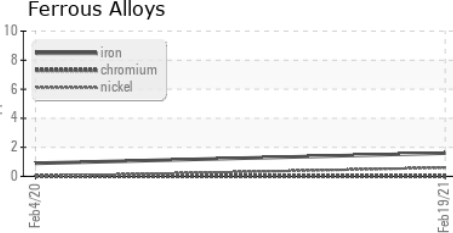

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0524632 **Received** : 25 Feb 2021
Lab Number : 05189925 **Diagnosed** : 25 Feb 2021
Unique Number : 9380223 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AJINOMOTO USA
 4020 AJINOMOTO DRIVE
 RALEIGH, NC
 US 27610
 Contact: Michael Thompson
 thompsonm@ajiusa.com
 T: (919)723-2142
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)