




# OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area  
**P1**  
 Machine Id  
**3201-B - 3200-B CRYSTALLIZER**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL MOBILGEAR 600 XP ISO 150 (27 QTS)**

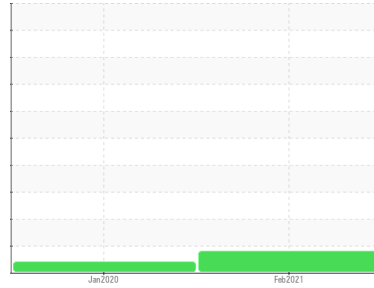

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0524630</b>	WC0425038	---
Sample Date	Client Info		<b>19 Feb 2021</b>	07 Jan 2020	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	Changed	---
Sample Status			<b>ABNORMAL</b>	ATTENTION	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>6</b>	3	---
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >200	<b>0</b>	0	---
Tin	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m	<b>4</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>16</b>	19	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>315</b>	285	---
Zinc	ppm	ASTM D5185m	<b>3</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>12956</b>	12601	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	1	---
Water	%	ASTM D6304 >0.2	<b>0.007</b>	0.004	---
ppm Water	ppm	ASTM D6304 >2000	<b>71.2</b>	42.9	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>▲ 66908</b>	▲ 35930	---
Particles >6µm	ASTM D7647	>5000	<b>▲ 8263</b>	4467	---
Particles >14µm	ASTM D7647	>640	<b>122</b>	57	---
Particles >21µm	ASTM D7647	>160	<b>18</b>	8	---
Particles >38µm	ASTM D7647	>40	<b>0</b>	4	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	4	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>▲ 23/20/14</b>	▲ 22/19/13	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.774</b>	0.694	---




# OIL ANALYSIS REPORT

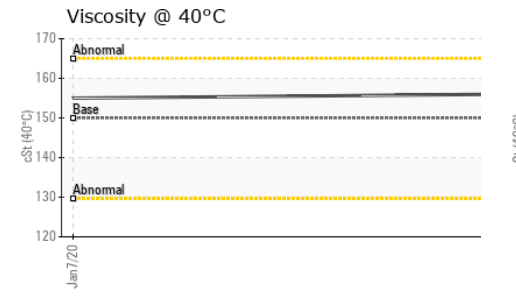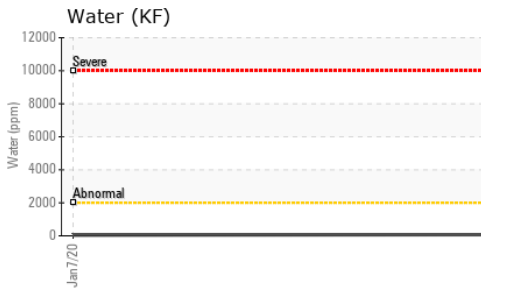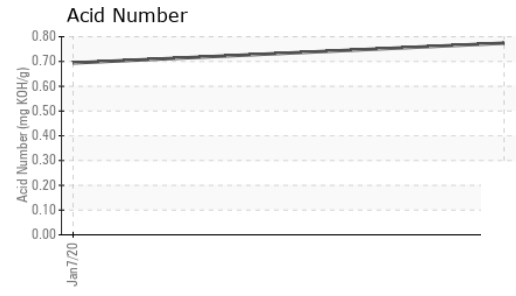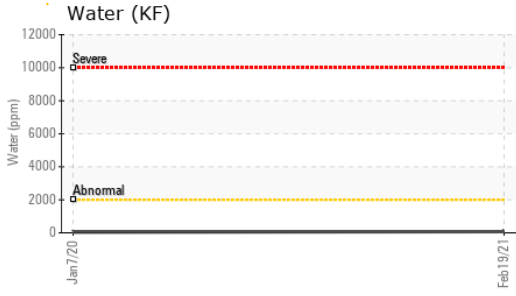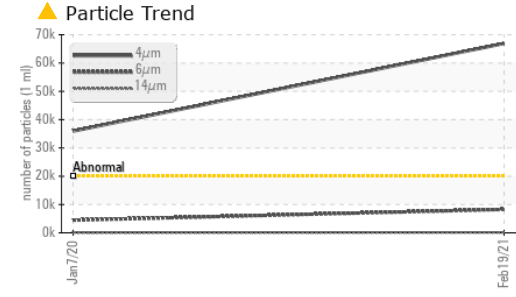







VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	156	155

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

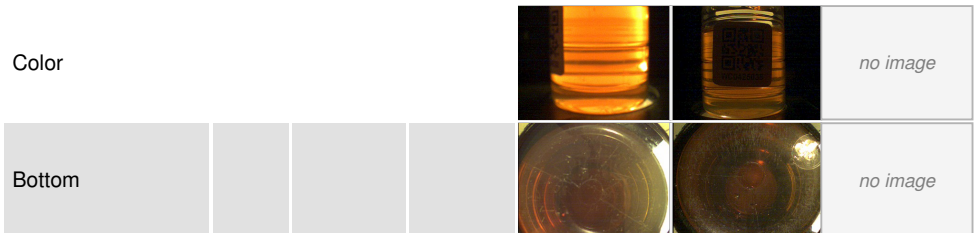

## GRAPHS

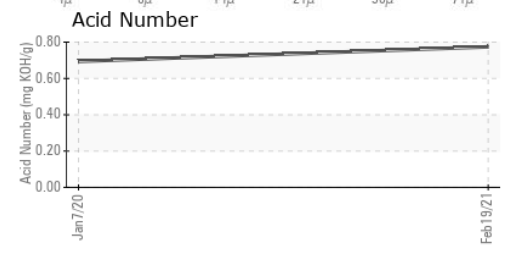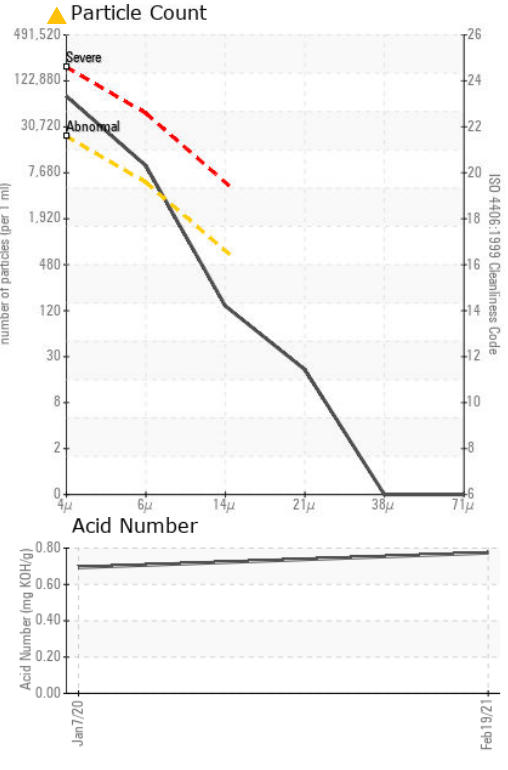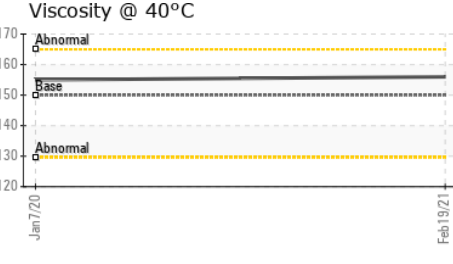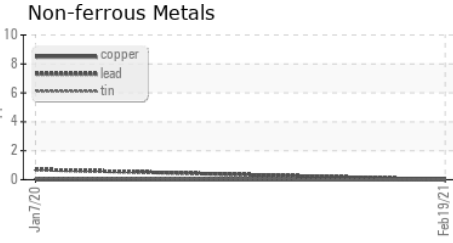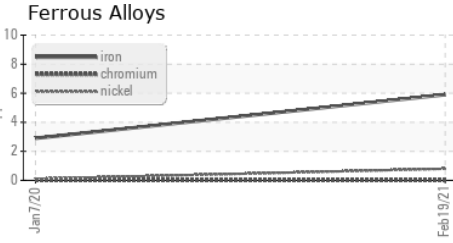

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0524630 **Received** : 25 Feb 2021  
**Lab Number** : 05189926 **Diagnosed** : 25 Feb 2021  
**Unique Number** : 9380224 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AJINOMOTO USA**  
 4020 AJINOMOTO DRIVE  
 RALEIGH, NC  
 US 27610  
 Contact: Michael Thompson  
 thompsonm@ajiusa.com  
 T: (919)723-2142  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)