




PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
UTL
 Machine Id
A65G141 LIMESTONE BULK
 Component
Hydraulic System
 Fluid
PETRO CANADA HYDREX AW 46 (2500 GAL)

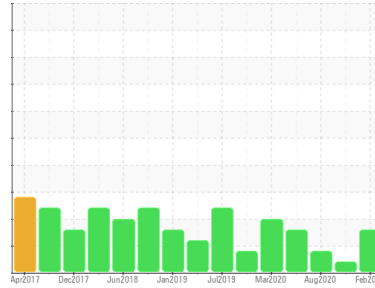

COMPONENT CONDITION SUMMARY

▲ Particle Trend

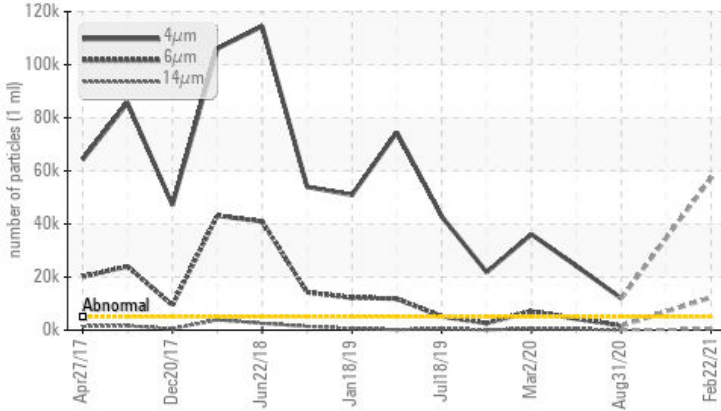

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	>5000	▲ 57275	---	---	▲ 11969
Particles >6µm	>1300	▲ 12333	---	---	▲ 1628
Particles >14µm	>160	▲ 415	---	---	82
Particles >21µm	>40	▲ 87	---	---	22
Oil Cleanliness	>19/17/14	▲ 23/21/16	---	---	▲ 21/18/14

Customer Id: INGBED
 Sample No.: WC0541779
 Lab Number: 05196164
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

27 Dec 2020 Diag: Jonathan Hester

VIS DEBRIS



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



31 Aug 2020 Diag: Don Baldrige

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



02 Jun 2020 Diag: Don Baldrige

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

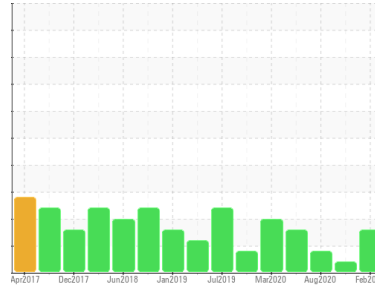

ISO



Area
UTL
 Machine Id
A65G141 LIMESTONE BULK
 Component
Hydraulic System
 Fluid
PETRO CANADA HYDREX AW 46 (2500 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0541779	WC0534918	WC0490460
Sample Date	Client Info	22 Feb 2021	27 Dec 2020	31 Aug 2020
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	3	4	7
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	0	0	0
Lead	ppm	ASTM D5185m >20	<1	<1	0
Copper	ppm	ASTM D5185m >20	<1	<1	<1
Tin	ppm	ASTM D5185m >20	0	0	0
Antimony	ppm	ASTM D5185m	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<1	<1	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	<1	<1
Manganese	ppm	ASTM D5185m 0	0	<1	0
Magnesium	ppm	ASTM D5185m 0	12	6	0
Calcium	ppm	ASTM D5185m 50	63	46	33
Phosphorus	ppm	ASTM D5185m 330	298	243	192
Zinc	ppm	ASTM D5185m 430	366	270	183
Sulfur	ppm	ASTM D5185m 760	842	899	971

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<1	0	1
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	0	<1	0





FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	▲ 57275	---	▲ 11969
Particles >6µm	ASTM D7647	>1300	▲ 12333	---	▲ 1628
Particles >14µm	ASTM D7647	>160	▲ 415	---	82
Particles >21µm	ASTM D7647	>40	▲ 87	---	22
Particles >38µm	ASTM D7647	>10	2	---	3
Particles >71µm	ASTM D7647	>3	0	---	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 23/21/16	---	▲ 21/18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.70	0.265	0.289	0.211

OIL ANALYSIS REPORT

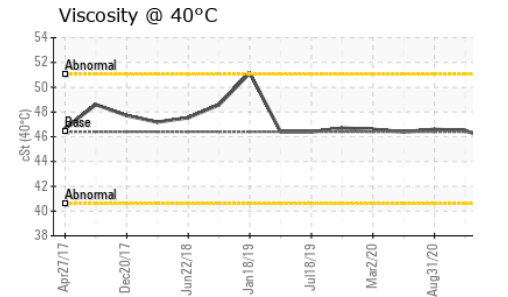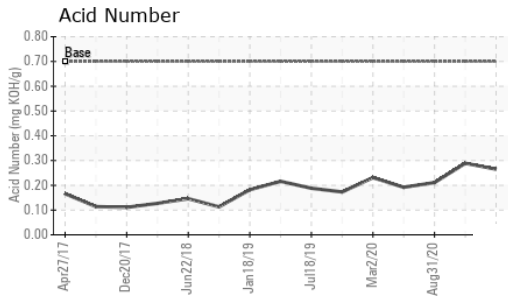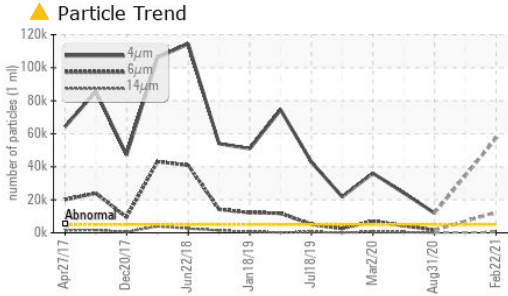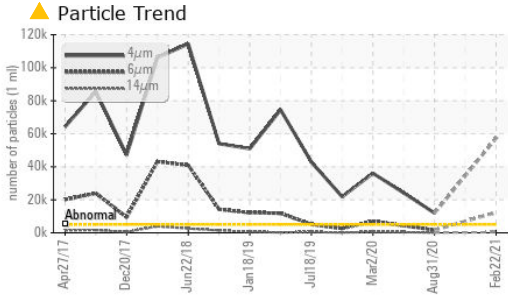






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.4	45.6	46.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

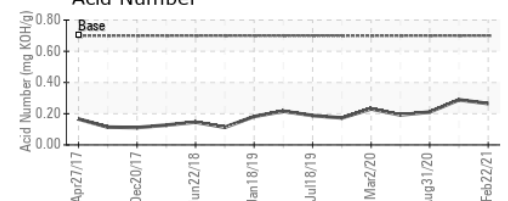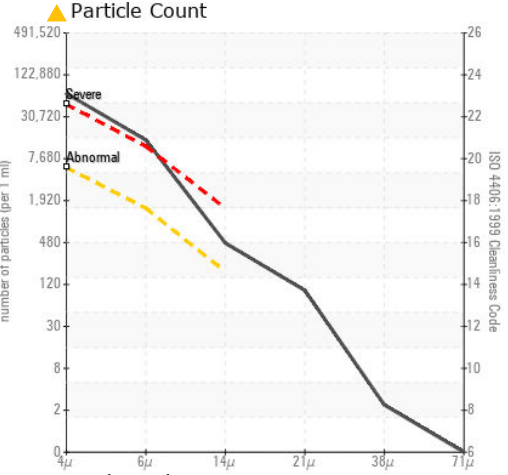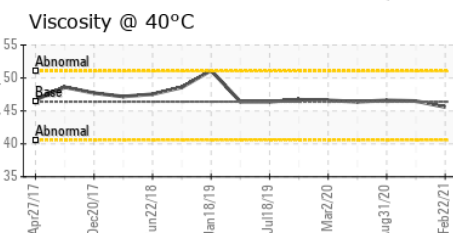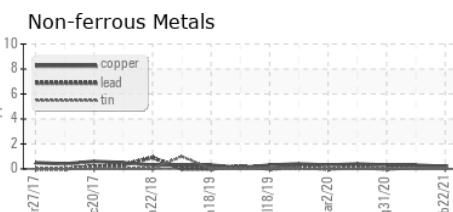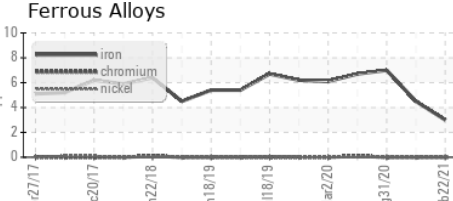

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0541779 **Received** : 04 Mar 2021
Lab Number : 05196164 **Diagnosed** : 05 Mar 2021
Unique Number : 9391475 **Diagnostician** : Jonathan Hester
Test Package : IND 2

INGREDION - BEDFORD PARK
 6400 SOUTH ARCHER ROAD
 BEDFORD PARK, IL
 US 60501
 Contact: Ricardo Gutierrez
 Ricardo.Gutierrez@ingredion.com
 T: (219)805-1307
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)