

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



# 7239207 (S/N 1010)

Component

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2020	Mar2021		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC93031	KC78889	
Sample Date		Client Info		01 Mar 2021	26 Aug 2020	
Machine Age	hrs	Client Info		3813	2020	
Oil Age	hrs	Client Info		1794	2020	
Oil Changed	1110	Client Info		Not Changd	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	7	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m		0	6	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Antimony	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	<1	
	PP		11 11 11			1:
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	5	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m		0	53	
Calcium	ppm	ASTM D5185m	F00	-	0	
Phosphorus Zinc	ppm	ASTM D5185m	500	8	7 11	
	ppm	ASTM D5185m				
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	3	
Sodium	ppm	ASTM D5185m		0	13	
Potassium	ppm	ASTM D5185m	>20	0	7	
Water	%	ASTM D6304	>0.05	0.004	0.027	
ppm Water	ppm	ASTM D6304	>500	43.1	271.0	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3294	5852	
Particles >6µm		ASTM D7647	>1300	1012	<u>^</u> 2644	
Particles >14µm		ASTM D7647	>80	57	80	
Particles >21µm		ASTM D7647		12	14	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71μm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/13	<u> </u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.738	0.395	



## **OIL ANALYSIS REPORT**

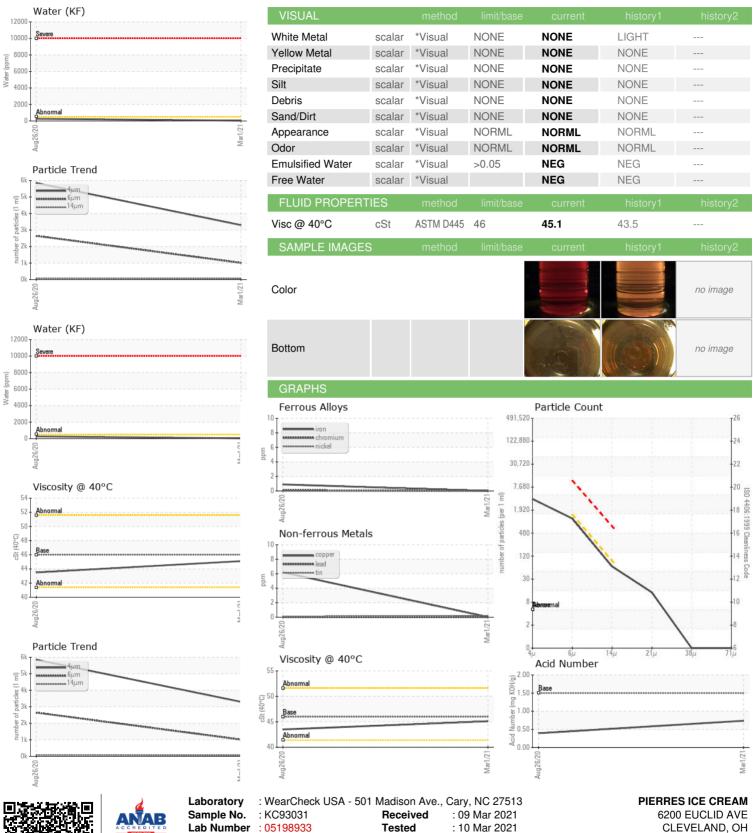



Certificate L2367

Lab Number Unique Number: 9394244

: 05198933 Test Package : IND 2

**Tested** Diagnosed

: 10 Mar 2021 : 10 Mar 2021 - Angela Borella

US 44103

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: