



# OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area  
**P3**

Machine Id


## 3543-C CRYSTALLIZER GEARBOX

Component

Agitator Gearbox

Fluid

MOBIL MOBILGEAR 600 XP ISO 150 (43 GAL)

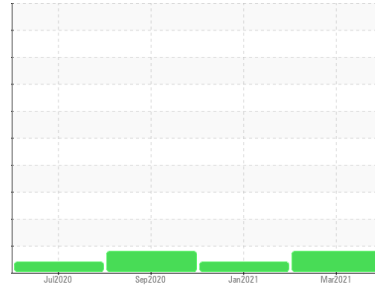

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0556419</b>	WC0536892	WC0472483
Sample Date	Client Info		<b>02 Mar 2021</b>	12 Jan 2021	02 Sep 2020
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >150	<b>2</b>	3	6
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>23</b>	37	34
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	2
Phosphorus	ppm	ASTM D5185m	<b>328</b>	368	319
Zinc	ppm	ASTM D5185m	<b>0</b>	1	2
Sulfur	ppm	ASTM D5185m	<b>14471</b>	16845	14435

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Water	%	ASTM D6304 >0.1	<b>0.018</b>	0.010	0.015
ppm Water	ppm	ASTM D6304 >1000	<b>180.1</b>	102.9	150.6

### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>▲ 58575</b>	▲ 41162	▲ 122812
Particles >6µm	ASTM D7647	>5000	<b>▲ 5974</b>	3532	▲ 17819
Particles >14µm	ASTM D7647	>640	<b>247</b>	114	338
Particles >21µm	ASTM D7647	>160	<b>44</b>	23	57
Particles >38µm	ASTM D7647	>40	<b>0</b>	1	3
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>▲ 23/20/15</b>	▲ 23/19/14	▲ 24/21/16


### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.762</b>	0.830	0.796




# OIL ANALYSIS REPORT


## Particle Trend

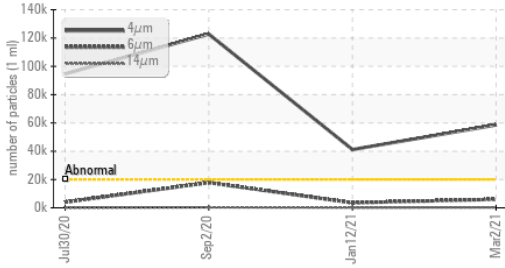


## Water (KF)

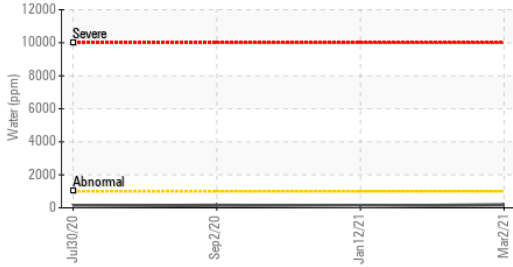


## Acid Number

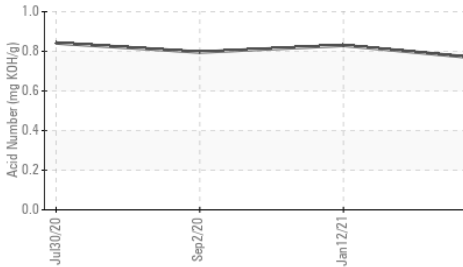

## Water (KF)

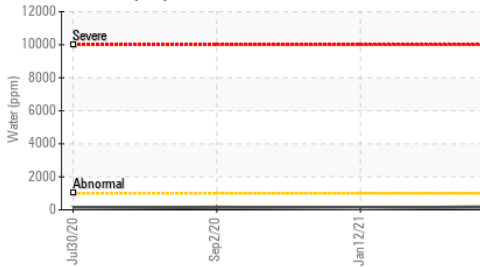

## Viscosity @ 40°C

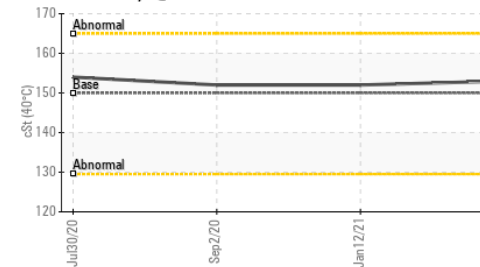


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	152	152

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

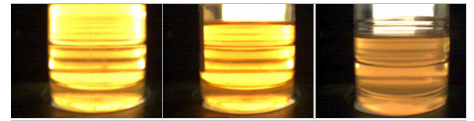


Bottom




## GRAPHS


### Ferrous Alloys

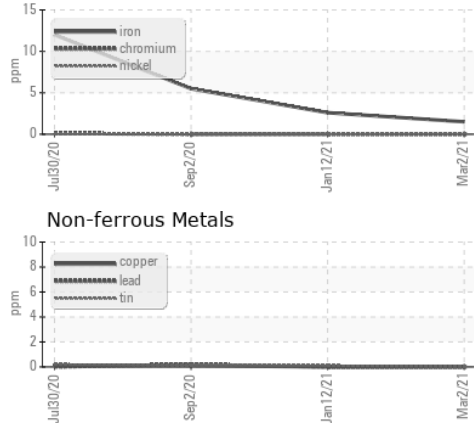


### Non-ferrous Metals

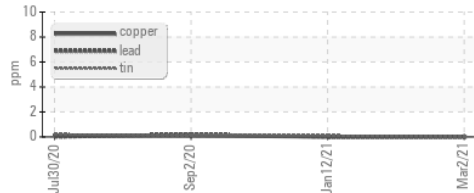


### Viscosity @ 40°C

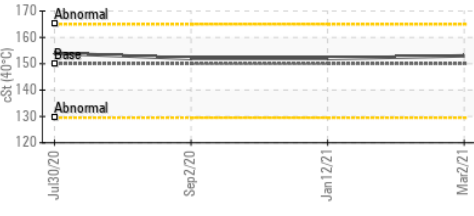

### Particle Count

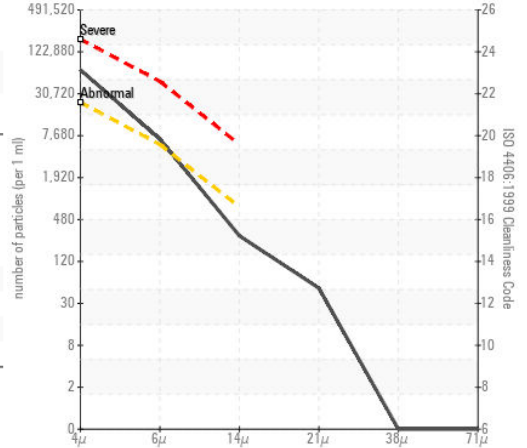

### Acid Number

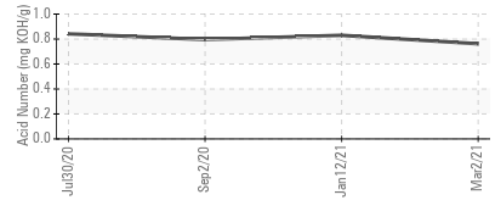

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0556419 **Received** : 15 Mar 2021  
**Lab Number** : 05203836 **Diagnosed** : 16 Mar 2021  
**Unique Number** : 9405245 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**AJINOMOTO USA**  
 4020 AJINOMOTO DRIVE  
 RALEIGH, NC  
 US 27610  
 Contact: Michael Thompson  
 thompsonm@ajiusa.com  
 T: (919)723-2142  
 F: