




OIL ANALYSIS REPORT

Sample Rating Trend

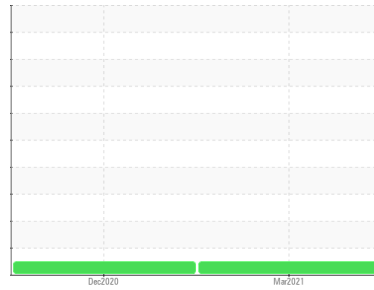

NORMAL



Machine Id

CCUP STG

Component

Turbine

Fluid

PHILLIPS 66 TURBINE OIL ISO 32 (300 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

RPVOT measured at 826. The AN level is acceptable for this fluid. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0545580	WC0536329	---
Sample Date	Client Info		01 Mar 2021	16 Dec 2020	---
Machine Age	hrs	Client Info	0	15808	---
Oil Age	hrs	Client Info	0	15808	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<1	<1	---
Chromium	ppm	ASTM D5185m >4	0	0	---
Nickel	ppm	ASTM D5185m >2	0	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	<1	---
Aluminum	ppm	ASTM D5185m >10	0	<1	---
Lead	ppm	ASTM D5185m	1	<1	---
Copper	ppm	ASTM D5185m >5	<1	<1	---
Tin	ppm	ASTM D5185m >5	0	2	---
Antimony	ppm	ASTM D5185m	0	3	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	<1	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	<1	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m	0	0	---
Calcium	ppm	ASTM D5185m	2	6	---
Phosphorus	ppm	ASTM D5185m	83	76	---
Zinc	ppm	ASTM D5185m	4	9	---
Sulfur	ppm	ASTM D5185m	59	45	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	<1	---
Sodium	ppm	ASTM D5185m	0	4	---
Potassium	ppm	ASTM D5185m >20	0	0	---
Water	%	ASTM D6304 >0.03	0.001	0.002	---
ppm Water	ppm	ASTM D6304 >300	13.0	23.4	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	189	90	---
Particles >6µm	ASTM D7647	>640	49	36	---
Particles >14µm	ASTM D7647	>80	6	5	---
Particles >21µm	ASTM D7647	>20	1	1	---
Particles >38µm	ASTM D7647	>4	0	0	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	15/13/10	14/12/10	---



OIL ANALYSIS REPORT

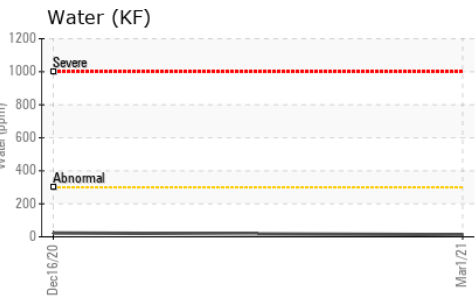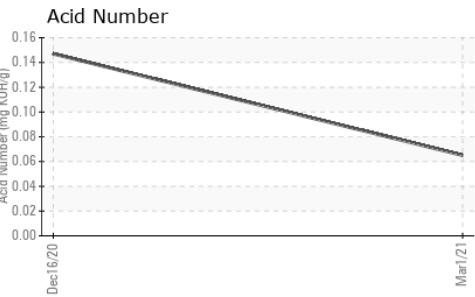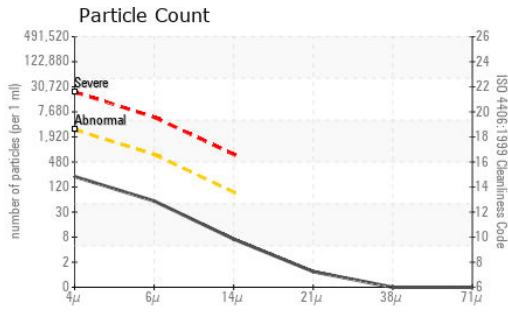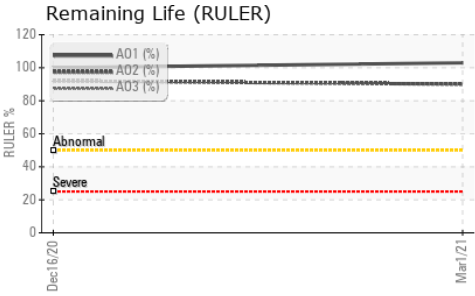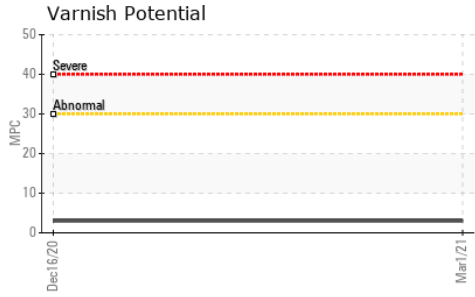

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.065	0.147	---
Anti-Oxidant 1	%	ASTM D6971	103	100	---
Anti-Oxidant 2	%	ASTM D6971	90	92	---
MPC Varnish Potential	Scale	ASTM D7843	3	3	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.7	32.0	---
Visc @ 100°C	cSt	ASTM D445	5.87	5.9	---
Viscosity Index (VI)	Scale	ASTM D2270	130	130	---
Oxidation Test (RPVOT)	minutes	*ASTM D2272	826	631	---


SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image
MPC					no image




Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0545580 **Received** : 15 Mar 2021
Lab Number : **05204217** **Tested** : 26 Mar 2021
Unique Number : 9405626 **Diagnosed** : 26 Mar 2021 - Doug Bogart
Test Package : AOM 1 (Additional Tests: KF, RPVOT)

NORTH CAROLINA STATE UNIVERSITY
 621 MOTOR POOL DR, FACILITIES DIVISION WAREHOUSE
 RALEIGH, NC
 US 27607
 Contact: PAUL WALKER
 apwalke3@ncsu.edu
 T: (919)513-3646
 F:


To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

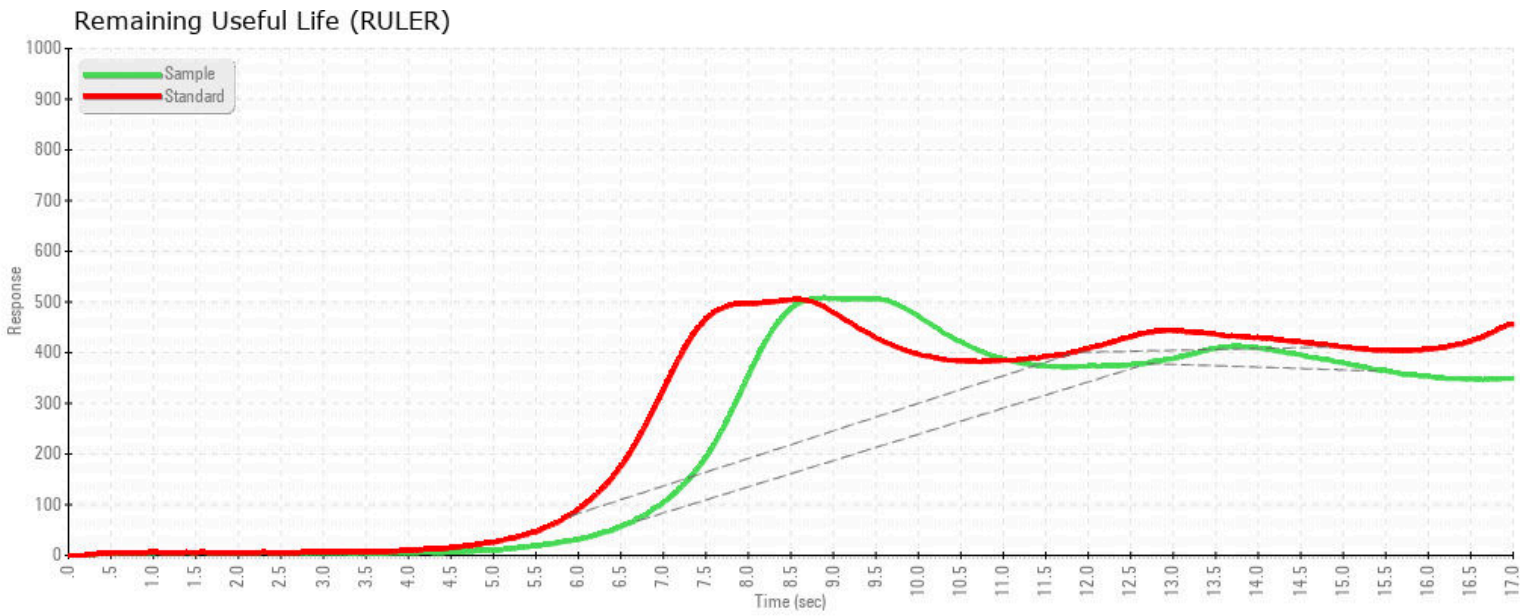

MPC (Varnish Test)

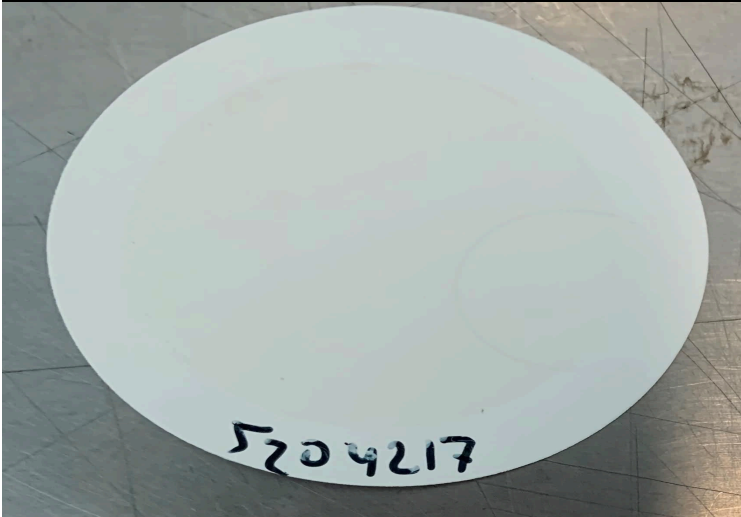

Sample Color & Clarity

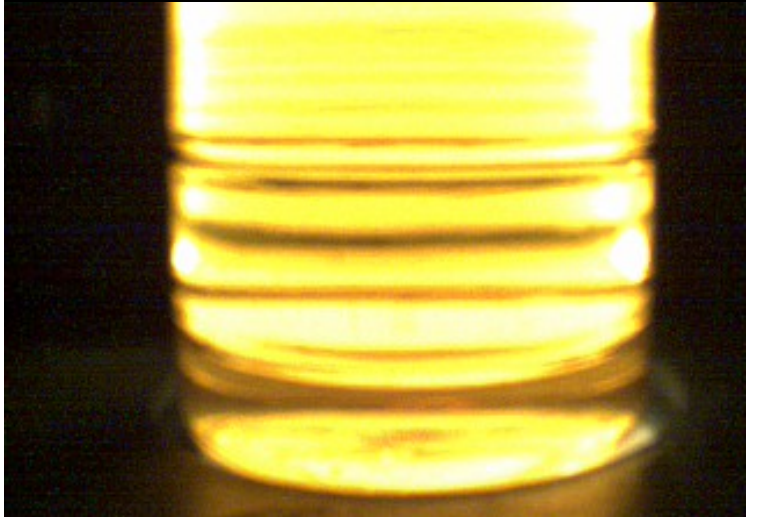

This page left intentionally blank