


OIL ANALYSIS REPORT





7463760 (S/N 1030)

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC90142		
Sample Date		Client Info		20 May 2021		
Machine Age	hrs	Client Info		368		
Oil Age	hrs	Client Info		368		
Oil Changed		Client Info		Not Changd		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m	210	0		
Vanadium		ASTM D5185m		0		
	ppm			0		
Cadmium	ppm	ASTM D5185m				
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1		
Barium	ppm	ASTM D5185m	90	59		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	77		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.024		
ppm Water	ppm	ASTM D6304	>500	245.7		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8207		
Particles >6µm		ASTM D7647	>1300	2383		
Particles >14µm		ASTM D7647	>80	1 39		
Particles >21µm		ASTM D7647	>20	3 7		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/14		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.349		
. ,						




OIL ANALYSIS REPORT


VISUAI method limit/base






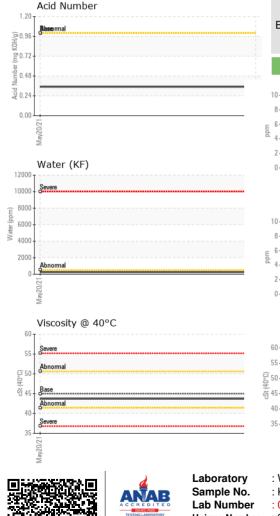

VISUAL		method	limit/base		history1	
White Metal	scalar	*Visual	NONE	NONE		-
w Metal	scalar	*Visual	NONE	NONE		-
ipitate	scalar	*Visual	NONE	NONE		-
Silt	scalar	*Visual	NONE	NONE		-
ebris	scalar	*Visual	NONE	LIGHT		
and/Dirt	scalar	*Visual	NONE	NONE		-
opearance	scalar	*Visual	NORML	NORML		
dor	scalar	*Visual	NORML	NORML		-
ulsified Water	scalar	*Visual	>0.05	NEG		
e Water	scalar	*Visual		NEG		
FLUID PROPER	TIES	method	limit/base	current	history1	
′isc @ 40°C	cSt	ASTM D445	45	43.7		-
SAMPLE IMAGE	S	method	limit/base	current	history1	
Color					no image	
Bottom					no image	
GRAPHS						
Ferrous Alloys			491,52	Particle Count		
iron			101,52			
6 - nickel			122,88	0-		
+			30,72	D-		
2			7,68			
May20/21						
—			85		N	
Non-ferrous Meta	IS		offined ju		\	
copper			0. agu 12	0-	1	
tin						
2				⁸ Bereve mal		1
0/21 0	**********************	******	0/21	2-		
May20/2			May20/2			
				411 611	140 210	38



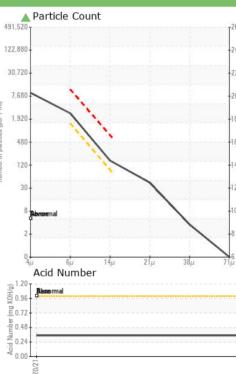

May20/21 w20/21 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 PIPELINE DEVELOPMENT : KC90142 Recieved : 03 Jun 2021 11792 ALAMEDA DR : 05269782 : 07 Jun 2021 STRONGSVILLE, OH Diagnosed : 9528714 Unique Number Diagnostician : Don Baldridge US 44149 Test Package : IND 2 Contact: Service Manager Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Se

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - PIPSTR

no image

no image

4406

1999