

OIL ANALYSIS REPORT

Ge-7000 Ma-7001 Jan-7001

Sample Rating Trend

NORMAL



CCUP STG

Turbine

PHILLIPS 66 TURBINE OIL ISO 32 (300 GAL)

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The condition of the oil is suitable for further service.


Dec2020 Mar2021 Jun2021								
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2		
	W/TTON	Client Info	IIIIIIIIIII	WC0545579	WC0545580	WC0536329		
Sample Number		Client Info		02 Jun 2021				
Sample Date	hvo				01 Mar 2021	16 Dec 2020		
Machine Age	hrs	Client Info		19544	0	15808		
Oil Age	hrs	Client Info		19544		15808		
Oil Changed		Client Info		Not Changd NORMAL	N/A NORMAL	N/A NORMAL		
Sample Status				NORMAL				
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>15	0	<1	<1		
Chromium	ppm	ASTM D5185m	>4	0	0	0		
Nickel	ppm	ASTM D5185m	>2	0	0	0		
Titanium	ppm	ASTM D5185m		0	0	0		
Silver	ppm	ASTM D5185m		0	0	<1		
Aluminum	ppm	ASTM D5185m	>10	0	0	<1		
Lead	ppm	ASTM D5185m		<1	1	<1		
Copper	ppm	ASTM D5185m	>5	<1	<1	<1		
Tin	ppm	ASTM D5185m	>5	0	0	2		
Antimony	ppm	ASTM D5185m		0	0	3		
Vanadium	ppm	ASTM D5185m		1	0	0		
Cadmium	ppm	ASTM D5185m		0	0	<1		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		2	<1	<1		
Barium	ppm	ASTM D5185m		0	0	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		0	0	0		
Magnesium	ppm	ASTM D5185m		0	0	0		
Calcium	ppm	ASTM D5185m		2	2	6		
Phosphorus	ppm	ASTM D5185m		78	83	76		
Zinc	ppm	ASTM D5185m		8	4	9		
Sulfur	ppm	ASTM D5185m		42	59	45		
CONTAMINANT	S	method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<1	0	<1		
Sodium	ppm	ASTM D5185m		2	0	4		
Potassium	ppm	ASTM D5185m	>20	0	0	0		
Water	%	ASTM D6304	>0.03	0.003	0.001	0.002		
ppm Water	ppm	ASTM D6304	>300	35.5	13.0	23.4		
FLUID CLEANLI	NESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>2500	947	189	90		
Particles >6µm		ASTM D7647	>640	229	49	36		
Particles >14µm		ASTM D7647	>80	22	6	5		
Particles >21µm		ASTM D7647		8	1	1		
Particles >38µm		ASTM D7647	>4	1	0	0		
Particles >71µm		ASTM D7647		0	0	0		
Oil Cleanliness		ISO 4406 (c)	>18/16/13	17/15/12	15/13/10	14/12/10		
		(0)		· · · · · · · · · · · · · · · · · ·		—		




OIL ANALYSIS REPORT

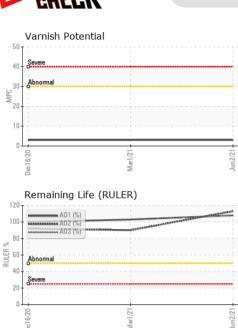







FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.061	0.065	0.147
Anti-Oxidant 1	%	ASTM D6971	<25	108	103	100
Anti-Oxidant 2	%	ASTM D6971	<25	113	90	92
MPC Varnish Potential	Scale	ASTM D7843	>15	3	3	3
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		31.6	31.7	32.0
Visc @ 100°C	cSt	ASTM D445		5.87	5.87	5.9
Viscosity Index (VI)	Scale	ASTM D2270		131	130	130
SAMPLE IMAGES n		method	limit/base	current	history1	history2
Color						
Bottom						
MPC						





Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: WC0545579 Lab Number : 05270456 Unique Number : 9529388

Diagnosed Test Package : AOM 1 (Additional Tests: KF)

Received

Tested

: 03 Jun 2021

: 14 Jun 2021

: 14 Jun 2021 - Doug Bogart

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.


* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)


NORTH CAROLINA STATE UNIVERSITY


621 MOTOR POOL DR, FACILITIES DIVISION WAREHOUSE RALEIGH, NC

US 27607 Contact: PAUL WALKER apwalke3@ncsu.edu

T: (919)513-3646

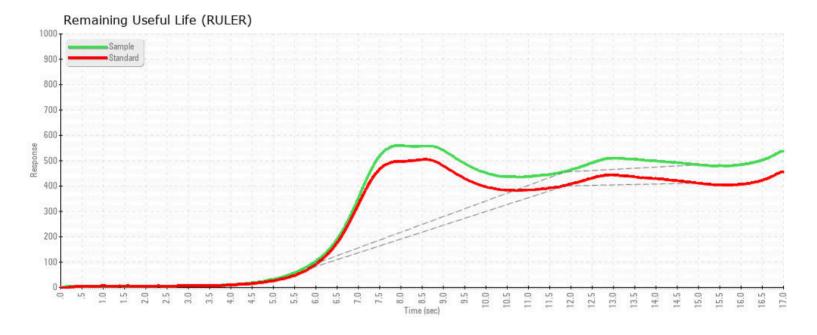

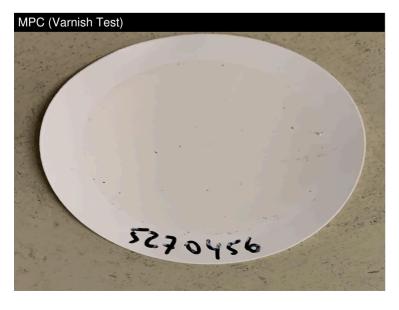

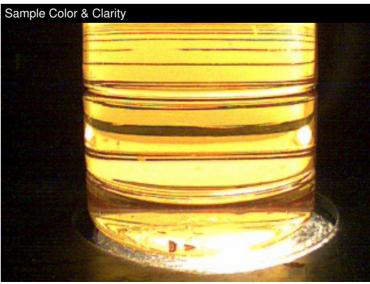

Report Id: NORRALNC [WUSCAR] 05270456 (Generated: 06/05/2024 14:29:10) Rev: 1

This page left intentionally blank