


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

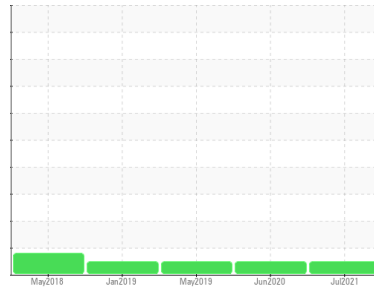

Machine Id  
**KAESER CSD 75 6006841 (S/N 1344)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The amount and size of particulates present in the system are acceptable.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC90014</b>	KC84361	KC77805
Sample Date	Client Info			<b>06 Jul 2021</b>	23 Jun 2020	29 May 2019
Machine Age	hrs	Client Info		<b>7368</b>	5419	3521
Oil Age	hrs	Client Info		<b>3847</b>	1898	900
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	1	1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	1	2
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	3	7
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>15</b>	<1	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	90	<b>31</b>	28	15
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>5</b>	8	0
Zinc	ppm	ASTM D5185m		<b>22</b>	26	55

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	4	3
Sodium	ppm	ASTM D5185m		<b>11</b>	9	4
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	5	3
Water	%	ASTM D6304	>0.05	<b>0.018</b>	0.018	0.016
ppm Water	ppm	ASTM D6304	>500	<b>183.8</b>	184.0	160

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1394</b>	367	2547
Particles >6µm		ASTM D7647	>1300	<b>231</b>	138	519
Particles >14µm		ASTM D7647	>80	<b>14</b>	8	27
Particles >21µm		ASTM D7647	>20	<b>6</b>	2	9
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>15/11</b>	14/10	16/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.408</b>	0.388	0.396


# OIL ANALYSIS REPORT

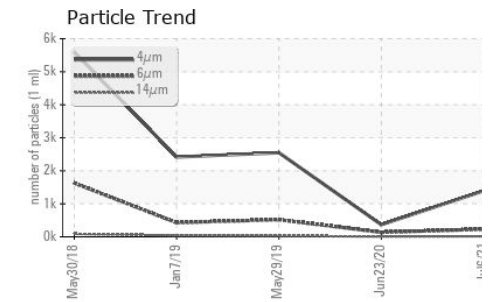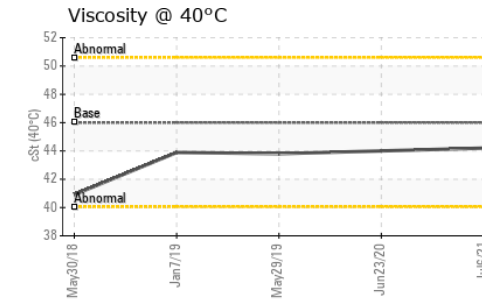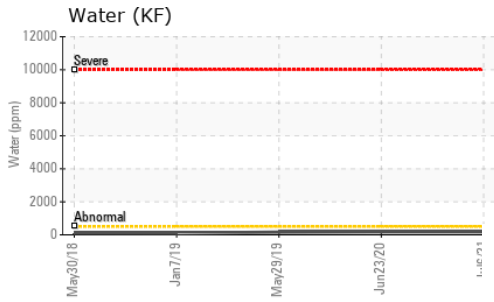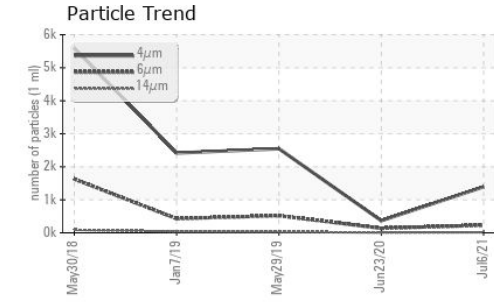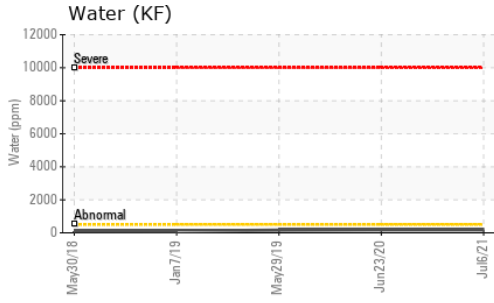






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.2	44.0	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

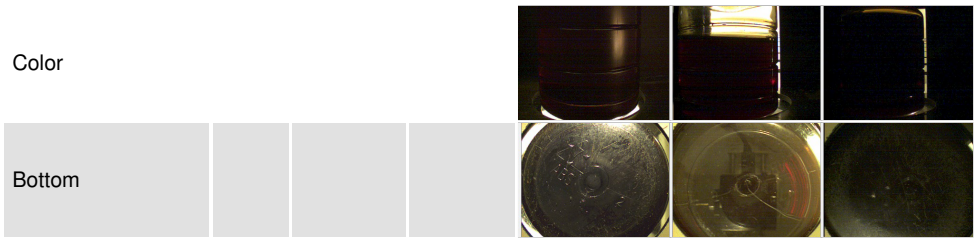

## GRAPHS

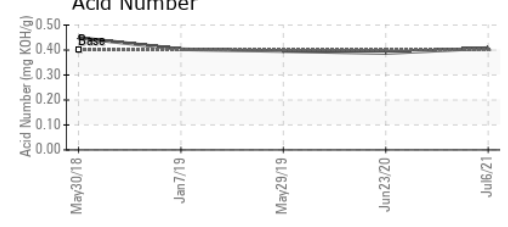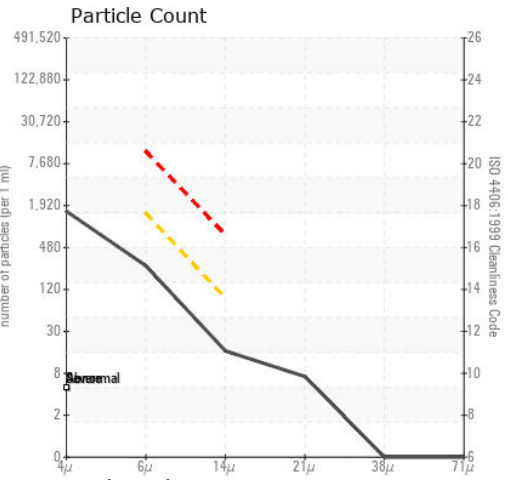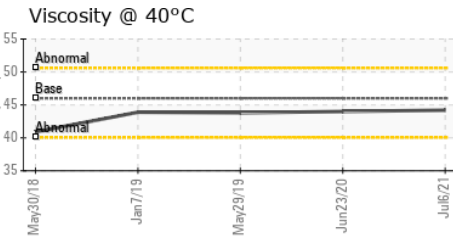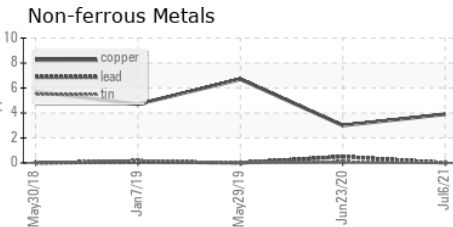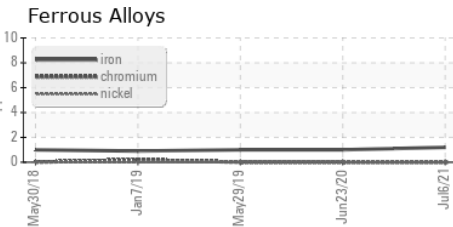

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC90014  
**Lab Number** : 05306361  
**Unique Number** : 9590330  
**Test Package** : IND 2  
**Received** : 20 Jul 2021  
**Tested** : 21 Jul 2021  
**Diagnosed** : 21 Jul 2021 - Angela Borella

**DIE-MATIC CORP**  
 201 EASTVIEW DR  
 BROOKLYN HEIGHTS, OH  
 US 44131  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)