

OIL ANALYSIS REPORT

Sample Rating Trend





Gearbox

MOBIL MOBILGEAR 600 XP ISO 150 (15 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		3602020	D802020 P802021	Αμιεύει συπεύει	Aug2021	
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0608851	WC0578479	WC0556413
Sample Date		Client Info		12 Aug 2021	15 Jun 2021	14 Apr 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	3	3	4
Chromium	ppm	ASTM D5185m	>15	0	0	<1
Nickel	ppm	ASTM D5185m	>15	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		<1	6	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>100	0	<1	2
Copper	ppm	ASTM D5185m		۰ <1	<1	0
Tin	ppm	ASTM D5185m	>200	0	0	0
Antimony		ASTM D5185m	225	0	0	0
•	ppm					
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		18	17	25
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		2	2	1
Magnesium	ppm	ASTM D5185m		0	1	0
Calcium	ppm	ASTM D5185m		<1	2	0
Phosphorus	ppm	ASTM D5185m		342	325	355
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		14892	15604	14138
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<1	<1	0
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	1	1	0
Water	%	ASTM D6304	>0.2	0.005	0.016	0.005
ppm Water	ppm	ASTM D6304	>2000	55.4	161.6	52.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	13271	2 4834	44656
Particles >6µm		ASTM D7647	>5000	1313	2004	3715
Particles >14µm		ASTM D7647	>640	92	144	284
Particles >21µm		ASTM D7647	>160	15	40	69
Particles >38µm		ASTM D7647		0	0	3
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	21/18/14	▲ 22/18/14	▲ 23/19/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.733	0.750	0.744
37:05) Rev: 1	ing itori/g	. 10 1 10 00040		Submitted By: BRENT FORSYTHE		

Report Id: AJIRAL [WUSCAR] 05328574 (Generated: 01/24/2024 13:37:05) Rev: 1

Submitted By: BRENT FORSYTHE



12000

100

2000

160

0°150

ざ 140

130

120

80

70

60

1) solutions sol

ີ້ 2 30k

20

10

0

团

lec17/20

5h5/7

[m]

Sep15/20

Abnorma

Sep

Water (ppm) 600 400

OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

*Visual

scalar *Visual

scalar *Visual

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.2

Aug12/21

Aug12/21.

: 17 Aug 2021

: 18 Aug 2021

Apr14/21.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Recieved

Diagnosed

Feb5/21

Jun15/21-

Diagnostician : Wes Davis

(0.80) 0.60 KOH/d)

0.40

틀 0.20

0.00 G

Sep 1

White Metal

Yellow Metal

Precipitate

Silt

Debris

Odor


Sand/Dirt


Appearance


Free Water

Emulsified Water

FLUID PROPERTIES





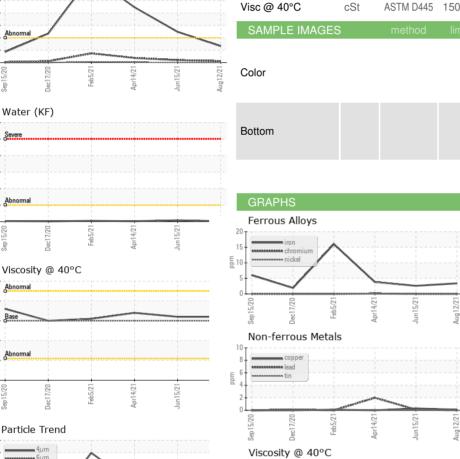

Abnormal

170

160 () 150

र्द्छ 140

130

120

Jun15/21

Laboratory

Sample No.

Lab Number

Unique Number

Sep15/20

: WC0608851

: 05328574


: 9622571

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Dec17/20

Test Package : IND 2 (Additional Tests: KF, PrtCount)

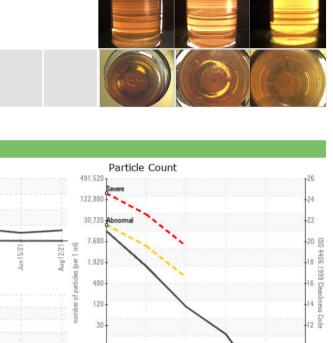

Acid Number

Dec17/20

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

152

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

152

NONE

NONE

NONE

NONE

NONE

NONE


NORML

NORML

NEG

NEG

154

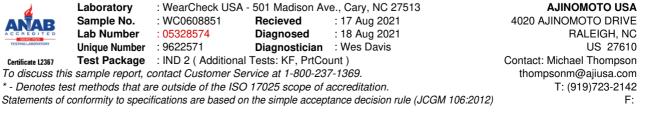

Jun15/21

Aug12/21

21

Apr14/21

Feb5/21

Report Id: AJIRAL [WUSCAR] 05328574 (Generated: 01/24/2024 13:37:05) Rev: 1

Certificate L2367

Submitted By: BRENT FORSYTHE

Page 2 of 2