

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Area Separation 2592-A S-Line crystalizer gearbox Component

Agitator Gearbox

Mobilgear 629 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0608853		
Sample Date		Client Info		12 Aug 2021		
Machine Age	hrs	Client Info		0		
Dil Age	hrs	Client Info		0		
Dil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>150	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>10	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		۔ <1		
Aluminum	ppm	ASTM D5185m	>25	0		
_ead	ppm	ASTM D5185m	>100	۰ <1		
		ASTM D5185m		<1		
Copper Tin	ppm	ASTM D5185m	>50			
	ppm		>10	0		
Antimony	ppm	ASTM D5185m		3		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		25		
Barium	ppm	ASTM D5185m		0		
Volybdenum	ppm	ASTM D5185m		0		
Vanganese	ppm	ASTM D5185m		<1		
Vagnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		333		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		11023		
	pp				الاستعادا	histow.0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.1	0.004		
opm Water	ppm	ASTM D6304	>1000	40.9		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	13249		
Particles >6µm		ASTM D7647	>5000	1607		
Particles >14µm		ASTM D7647	>640	138		
Particles >21µm		ASTM D7647	>160	35		
Particles >38µm		ASTM D7647	>40	0		
Particles >71µm		ASTM D7647		0		
		ISO 4406 (c)	>21/19/16	21/18/14		
Oil Cleanliness						
		()	limit/base	current	historv1	history2
DI Cleanliness FLUID DEGRADA Acid Number (AN)	TION mg KOH/g	method ASTM D8045	limit/base	current 0.746	history1	history2

Report Id: AJIRAL [WUSCAR] 05328577 (Generated: 01/26/2024 10:11:27) Rev: 1


Submitted By: BRENT FORSYTHE




OIL ANALYSIS REPORT





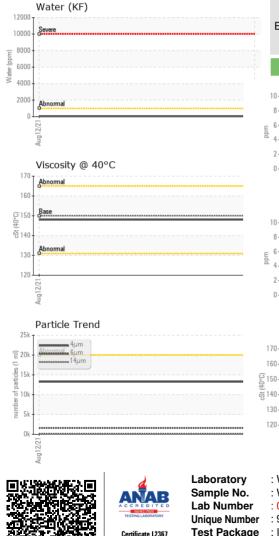

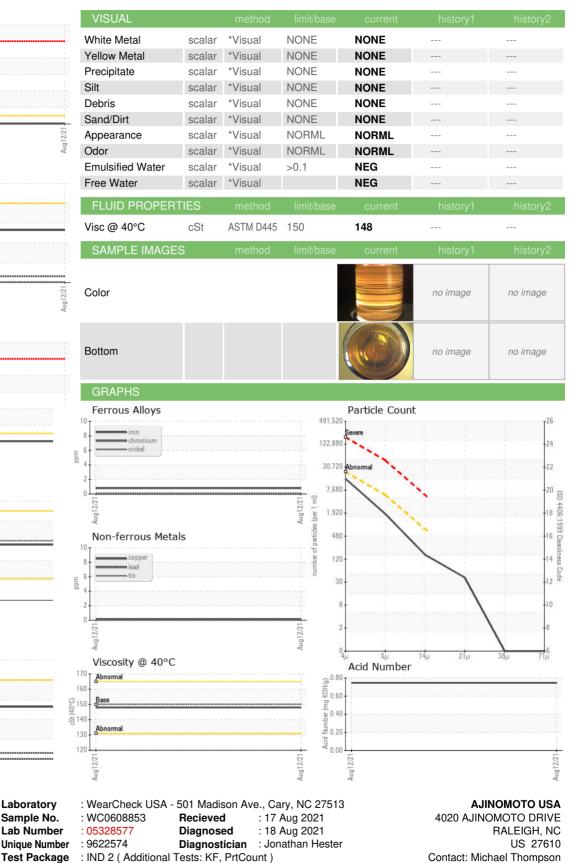

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

thompsonm@ajiusa.com

T: (919)723-2142

F: