




OIL ANALYSIS REPORT

Sample Rating Trend

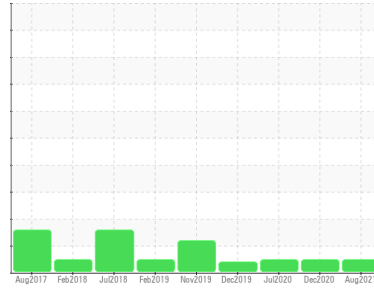

NORMAL



Area
63
Machine Id
[63] A63 SPQ 1 Fire Pump
Component
Diesel Engine
Fluid
HIGH PERFORMANCE LUBRICANTS HDMO 5W30 (8 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | HPL0000051 | HPL007880 | HPL008663 |
| Sample Date | Client Info | | 12 Aug 2021 | 29 Dec 2020 | 06 Jul 2020 |
| Machine Age | hrs | Client Info | 63 | 56 | 50 |
| Oil Age | hrs | Client Info | 23 | 16 | 11 |
| Oil Changed | Client Info | | Not Changed | Not Changd | Not Changed |
| Sample Status | | | NORMAL | NORMAL | NORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| Glycol | WC Method | | NEG | NEG | 0.0 |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|------------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >100 | 6 | 7 | 7 |
| Chromium | ppm | ASTM D5185m >20 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185m >4 | 0 | 0 | <1 |
| Titanium | ppm | ASTM D5185m | <1 | <1 | <1 |
| Silver | ppm | ASTM D5185m >3 | <1 | <1 | <1 |
| Aluminum | ppm | ASTM D5185m >20 | 2 | 2 | 2 |
| Lead | ppm | ASTM D5185m >40 | 5 | 4 | 3 |
| Copper | ppm | ASTM D5185m >330 | 76 | 64 | 66 |
| Tin | ppm | ASTM D5185m >15 | 1 | 1 | 0 |
| Antimony | ppm | ASTM D5185m | <1 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | <1 | <1 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m 200 | 140 | 98 | 102 |
| Barium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m 85 | 34 | 26 | 23 |
| Manganese | ppm | ASTM D5185m | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m 525 | 311 | 300 | 282 |
| Calcium | ppm | ASTM D5185m 4300 | 1992 | 1815 | 1805 |
| Phosphorus | ppm | ASTM D5185m 1000 | 719 | 765 | 747 |
| Zinc | ppm | ASTM D5185m 1100 | 820 | 879 | 831 |
| Sulfur | ppm | ASTM D5185m 20200 | 6075 | 4308 | 3580 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|-----------------|-----------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | 2 | 2 | 3 |
| Sodium | ppm | ASTM D5185m | 57 | 72 | 88 |
| Potassium | ppm | ASTM D5185m >20 | 2 | 1 | 6 |

INFRA-RED



| | method | limit/base | current | history1 | history2 |
|-----------|----------|-----------------|-------------|----------|----------|
| Soot % | % | *ASTM D7844 >3 | 0.1 | 0.1 | 0.1 |
| Nitration | Abs/cm | *ASTM D7624 >20 | 5.7 | 5.2 | 5 |
| Sulfation | Abs/.1mm | *ASTM D7415 >30 | 18.8 | 17.1 | 16.5 |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Oxidation | Abs/.1mm | *ASTM D7414 >25 | 11.2 | 10.1 | 9.6 |
| Base Number (BN) | mg KOH/g | ASTM D2896 14.5 | 8.56 | 7.59 | 7.55 |











OIL ANALYSIS REPORT

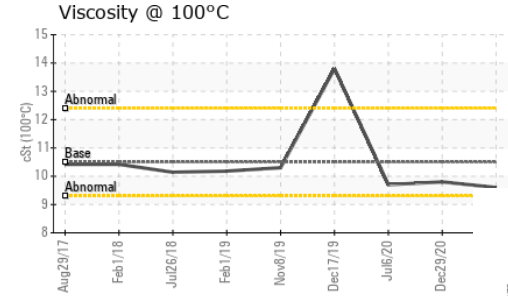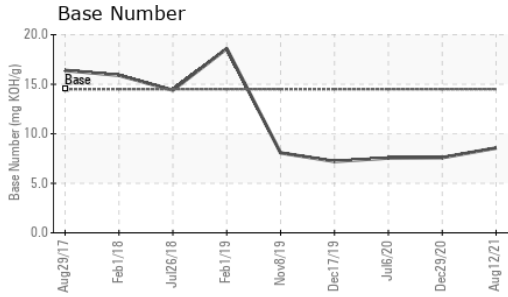

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|------------|----------|-----|
| Visc @ 100°C | cSt | ASTM D445 | 10.5 | 9.6 | 9.8 | 9.7 |

GRAPHS

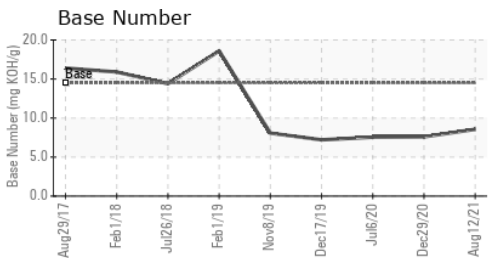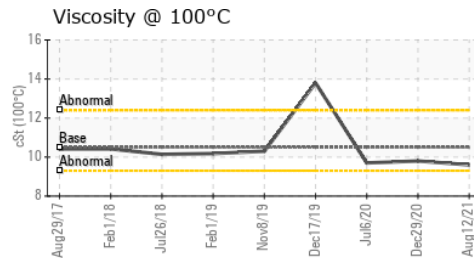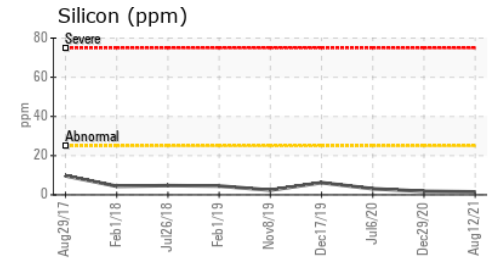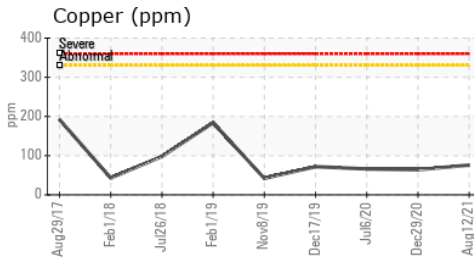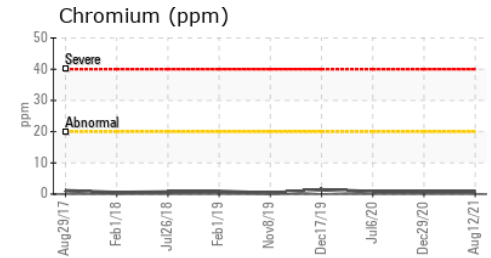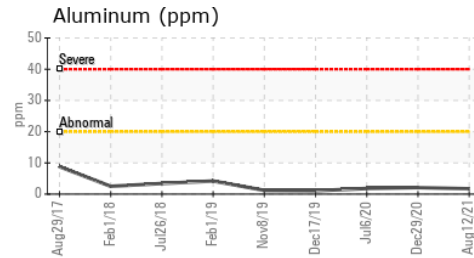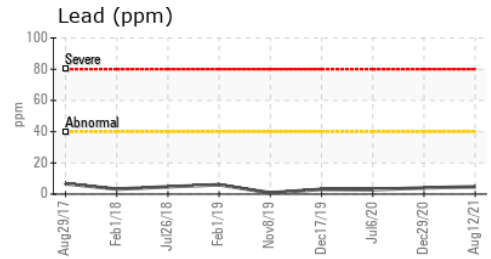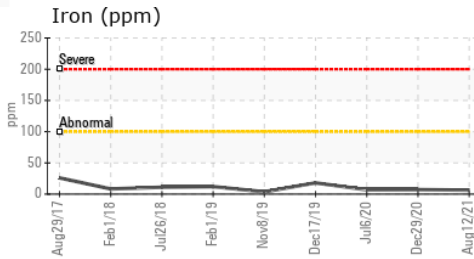

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HPL0000051 **Received** : 20 Aug 2021
Lab Number : 05331909 **Diagnosed** : 23 Aug 2021
Unique Number : 9630907 **Diagnostician** : Jonathan Hester
Test Package : MOB 2

KENSING
 2525 S KENSINGTON RD
 KANKAKEE, IL
 US 60901

Contact: TIM HUBERT
 timothy.hubert@kensingsolutions.com

T: (815)939-8918

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)