

OIL ANALYSIS REPORT





Machine Id 7208443 (S/N 1474) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

A Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC97862		
Sample Date		Client Info		18 Oct 2021		
Machine Age	hrs	Client Info		14922		
Oil Age	hrs	Client Info		4015		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm		>50	33		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
	lele					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	4		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	46		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.010		
ppm Water	ppm	ASTM D6304	>500	109.5		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14158		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	1 9/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.420		




OIL ANALYSIS REPORT

Built for a lifetime."





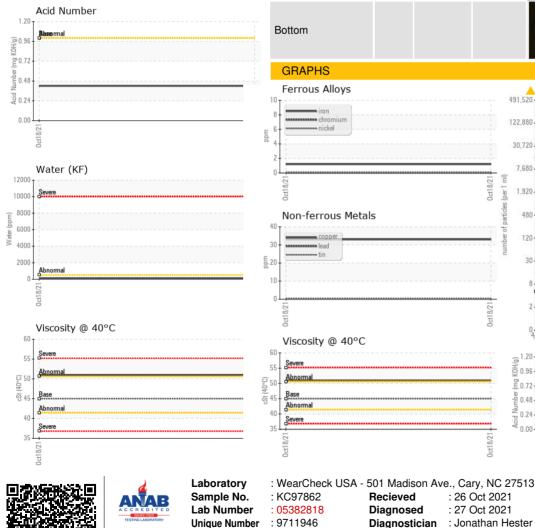

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history
Visc @ 40°C	cSt	ASTM D445	45	50.9		
SAMPLE IMAGES		method	limit/base	current	history1	history
Color					no image	no image
Bottom					no image	no image
GRAPHS			-			
Ferrous Alloys				Particle Count		0.0
8			491,520	I		
6			122,880	-		
4			30,720			
2						
		*********	7,680			
0ct18/21			0ct18/21 (per 1 ml)			
			Sappe 480		N	
Non-ferrous Metals	,		1201 1201 1201 1201 1201 1201 1201 1201			
0 - copper				-	1	-
0 tin			2 30			
0					1	
			8	Bibreven al	1	t
21 27		************	12/8			
0ct18/2			0ct18/21			
Viscosity @ 40°C			0	Acid Number	14μ 21μ	38µ 71j


Oct18/21.

: 26 Oct 2021

: 27 Oct 2021

Diagnostician : Jonathan Hester

60 Se 55 Ab Base 45 Abnormal 40





Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Sev

0ct18/21

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Recieved

Diagnosed

0ct18/21.

ADVANCED INNOVATIVE MFG

Contact: Service Manager

116 LENA DR

AURORA, OH

US 44202