




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

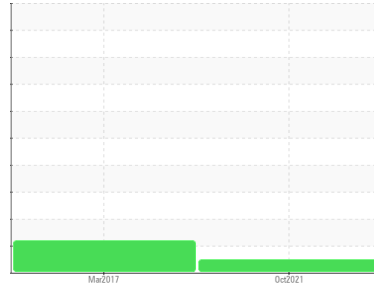

Machine Id
KAESER SFC 18ST 5859574 (S/N 1015)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC97859	KC52944	---
Sample Date	Client Info			27 Oct 2021	28 Mar 2017	---
Machine Age	hrs	Client Info		17047	1346	---
Oil Age	hrs	Client Info		1900	1346	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				NORMAL	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	0	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	<1	<1	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	0	10	---
Molybdenum	ppm	ASTM D5185m	0	0	<1	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	100	41	45	---
Calcium	ppm	ASTM D5185m	0	0	0	---
Phosphorus	ppm	ASTM D5185m	0	0	<1	---
Zinc	ppm	ASTM D5185m	0	14	12	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	2	---
Sodium	ppm	ASTM D5185m		21	10	---
Potassium	ppm	ASTM D5185m	>20	2	<1	---
Water	%	ASTM D6304	>0.05	0.030	0.022	---
ppm Water	ppm	ASTM D6304	>500	305.2	220	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1905	5323	---
Particles >6µm		ASTM D7647	>1300	602	▲ 1515	---
Particles >14µm		ASTM D7647	>80	51	▲ 85	---
Particles >21µm		ASTM D7647	>20	16	18	---
Particles >38µm		ASTM D7647	>4	1	3	---
Particles >71µm		ASTM D7647	>3	0	3	---
Oil Cleanliness		ISO 4406 (c)	>17/13	16/13	▲ 18/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.425	0.429	---


OIL ANALYSIS REPORT

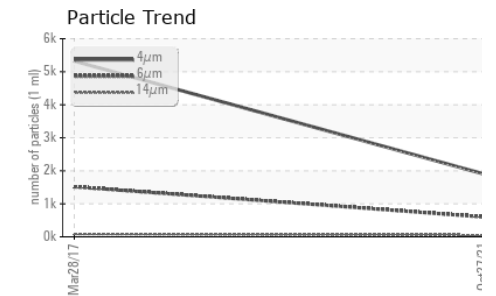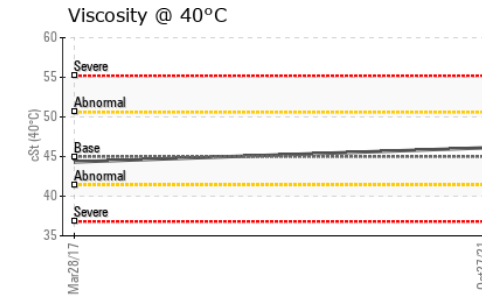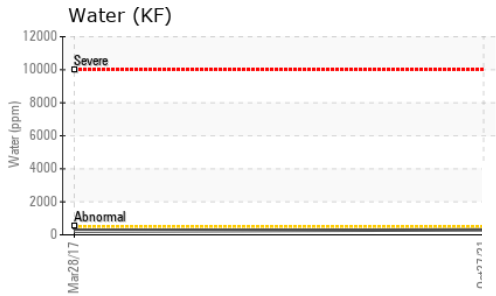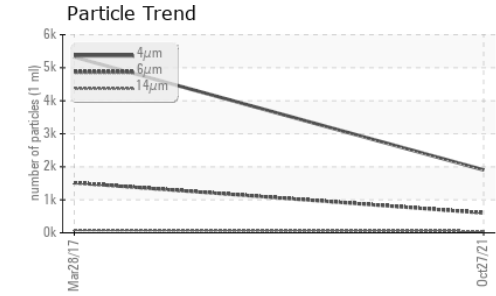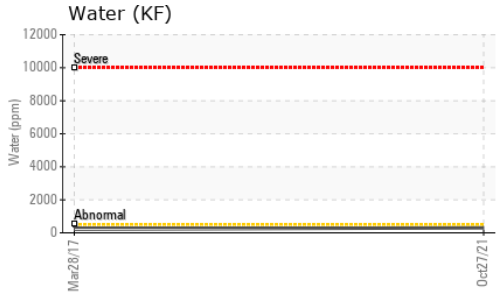





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.1	44.32

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

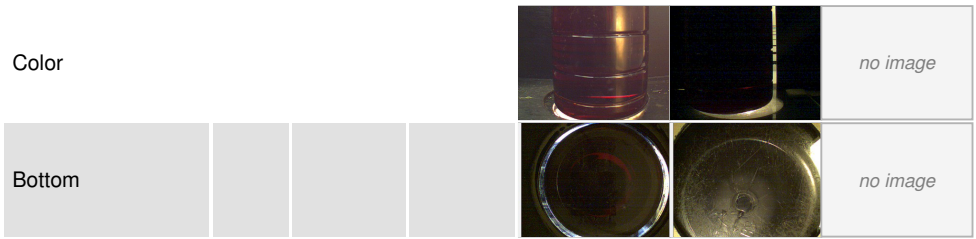

GRAPHS

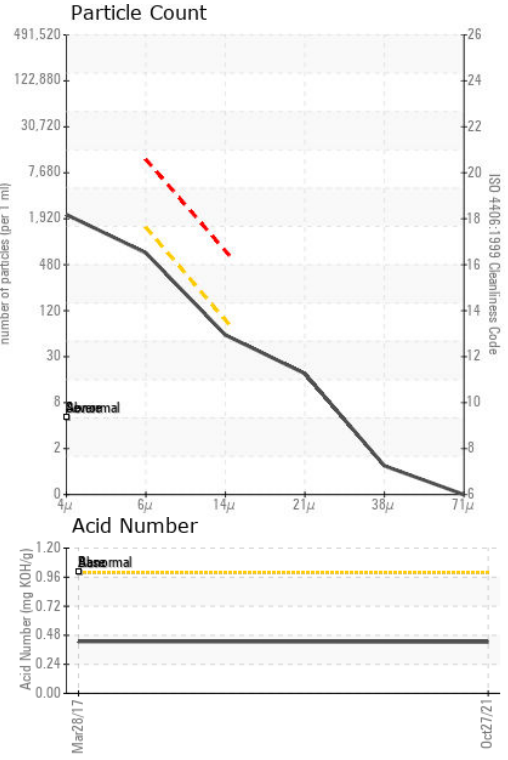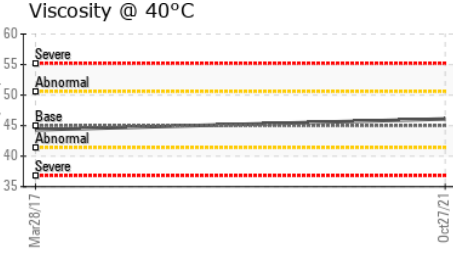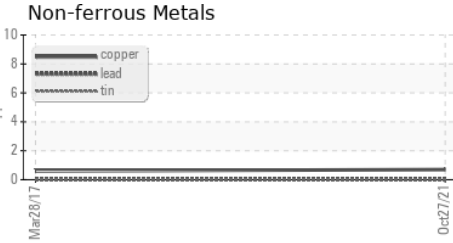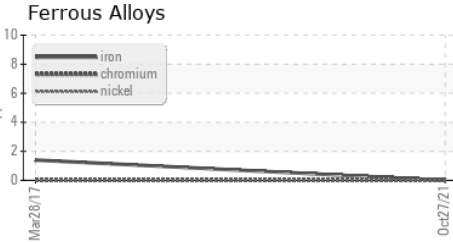

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC97859 **Received** : 02 Nov 2021
Lab Number : 05389782 **Tested** : 04 Nov 2021
Unique Number : 9723915 **Diagnosed** : 04 Nov 2021 - Jonathan Hester
Test Package : IND 2

ALRO STEEL
 4787 STATE RD
 CUYAHOGA FALLS, OH
 US 44223
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: