

OIL ANALYSIS REPORT

IR ULTRA [2204119] Machine Id ATLAS COPCO APF1030037 - PRIME PROCESSING Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend



NORMAL

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05389854		-
Sample Date		Client Info		21 Oct 2021		-
Machine Age	hrs	Client Info		29968		-
Oil Age	hrs	Client Info		0		-
Oil Changed		Client Info		Changed		-
Sample Status				NORMAL		-
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m	, 0	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum		ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
	ppm	ASTM D5185m	>65	0		
Copper Tin	ppm			-		
	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		-		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	500	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	0	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	20	48		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	200	23		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	4		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.432		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	VLITE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		


Page 1 of 2

NEG

scalar *Visual



OIL ANALYSIS REPORT

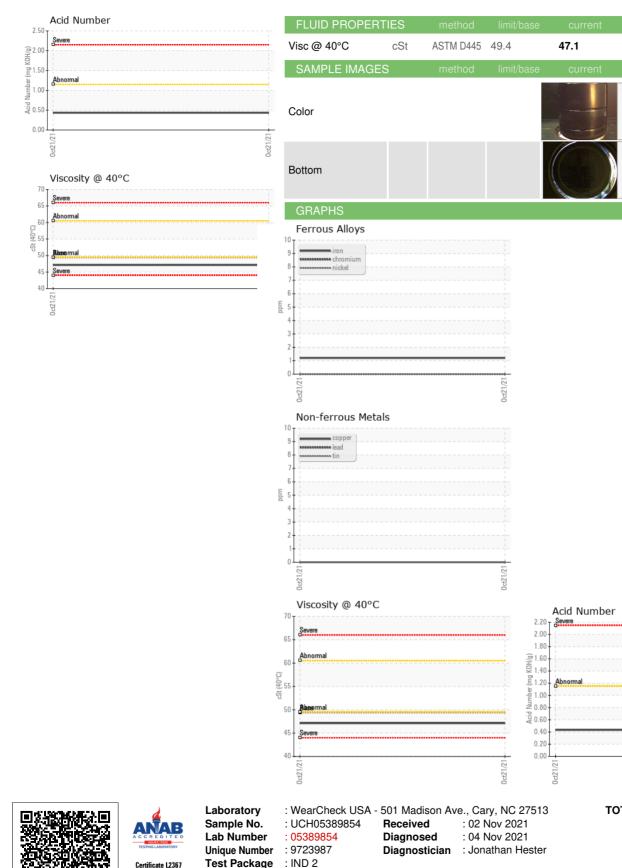

TOTAL EQUIPMENT COMPANY 200 SMILEY DR SAINT ALBANS, WV US 25177 Contact:

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

no image

no image

no image

no image