

OIL ANALYSIS REPORT

Sample Rating Trend

VISCOSITY



KAESER SM 15 AC 5066394 (S/N 1339)

Compressor

KAESER SIGMA (OEM) M-460 (2 GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

				Nov2021		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC97638		
Sample Date		Client Info		19 Nov 2021		
Machine Age	hrs	Client Info		8166		
Oil Age	hrs	Client Info		1887		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		4		
Tin	ppm	ASTM D5185m	>10	<1		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	9		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	80		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	7		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	10		
Sodium	ppm	ASTM D5185m		16		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.020		
ppm Water	ppm	ASTM D6304	>500	205.6		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		954		
Particles >6µm		ASTM D7647	>1300	213		
Particles >14μm		ASTM D7647	>80	21		
Particles >21µm		ASTM D7647	>20	6		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	15/12		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.375		



OIL ANALYSIS REPORT

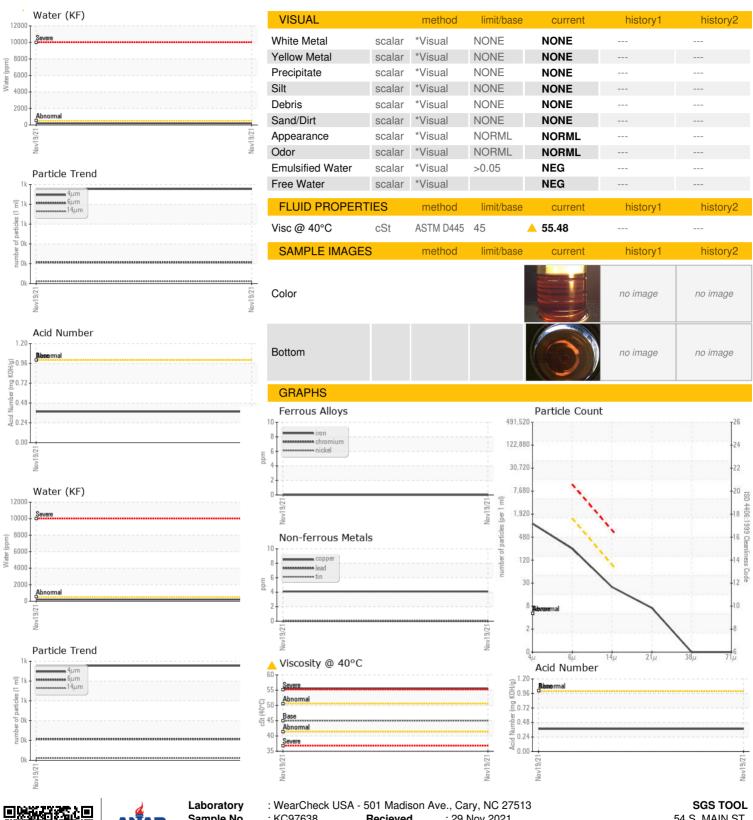



Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC97638 : 05410107

: 9759295 : IND 2

: 29 Nov 2021 Recieved Diagnosed Diagnostician

: 03 Dec 2021 : Jonathan Hester

54 S. MAIN ST. MONROE FALLS, OH US 44262

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: