

PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
STL HEATER
Component
Heat Transfer Fluid
Fluid
THERMINOL 55 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

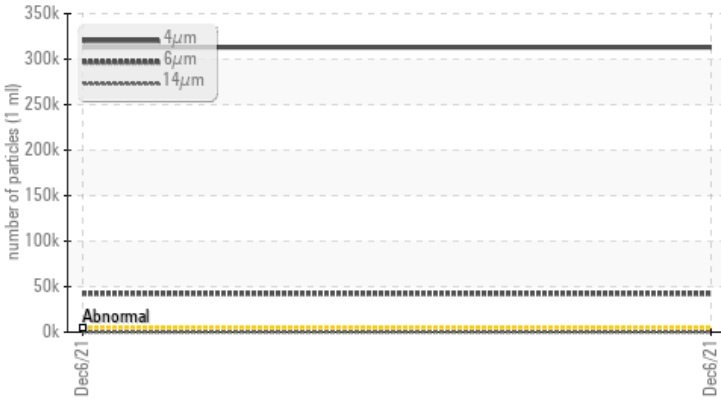

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. Please note that this is a corrected copy for laboratory data updates.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Particles >4µm	ASTM D7647	>5000	▲ 312983	---	---
Particles >6µm	ASTM D7647	>1300	▲ 42370	---	---
Particles >14µm	ASTM D7647	>160	▲ 234	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 25/23/15	---	---

Customer Id: BLUSTL
Sample No.: TO10000664
Lab Number: 05431747
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
STL HEATER
 Component
Heat Transfer Fluid
 Fluid
THERMINOL 55 (--- GAL)

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. Resample at the next service interval to monitor. Please note that this is a corrected copy for laboratory data updates.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO10000664	---	---
Sample Date	Client Info	06 Dec 2021	---	---
Machine Age	Client Info	0	---	---
Oil Age	Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m		11	---	---
Chromium ppm ASTM D5185m		0	---	---
Nickel ppm ASTM D5185m		0	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m		<1	---	---
Aluminum ppm ASTM D5185m		<1	---	---
Lead ppm ASTM D5185m		0	---	---
Copper ppm ASTM D5185m		0	---	---
Tin ppm ASTM D5185m		0	---	---
Antimony ppm ASTM D5185m		0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<1	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m		0	---	---
Calcium ppm ASTM D5185m		0	---	---
Phosphorus ppm ASTM D5185m		1	---	---
Zinc ppm ASTM D5185m		0	---	---
Sulfur ppm ASTM D5185m		22	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m		0	---	---
Sodium ppm ASTM D5185m		0	---	---
Potassium ppm ASTM D5185m	>20	0	---	---
Water % ASTM D6304		0.021	---	---
ppm Water ppm ASTM D6304		218.7	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>5000	▲ 312983	---	---
Particles >6µm ASTM D7647	>1300	▲ 42370	---	---
Particles >14µm ASTM D7647	>160	▲ 234	---	---
Particles >21µm ASTM D7647	>40	23	---	---
Particles >38µm ASTM D7647	>10	0	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>19/17/14	▲ 25/23/15	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		0.727	---	---

OIL ANALYSIS REPORT

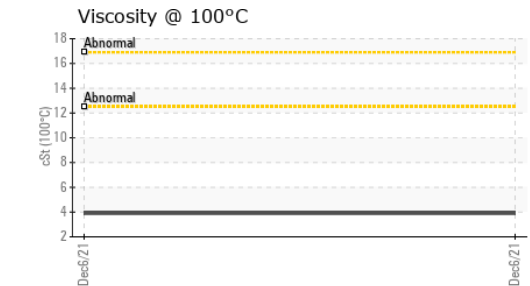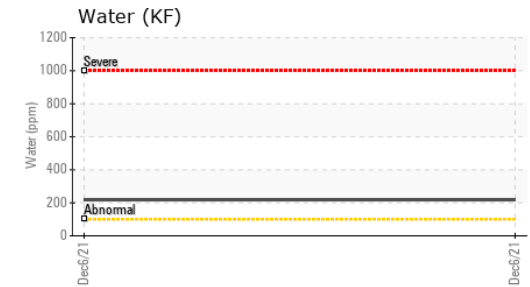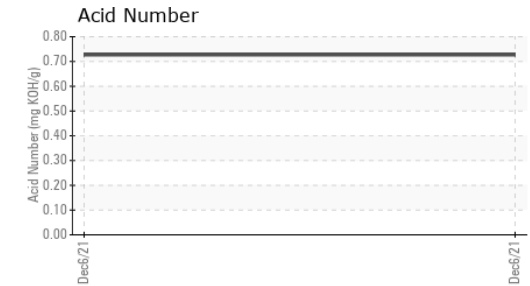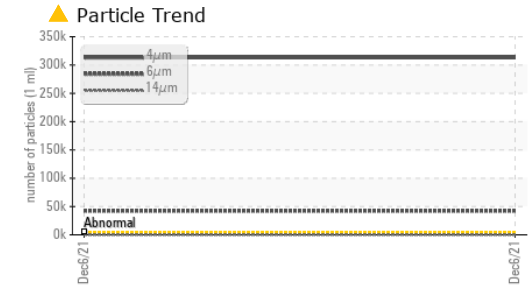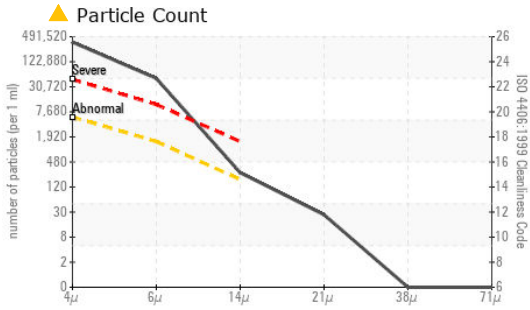


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	18.9	---	---
Visc @ 100°C	cSt	ASTM D445	3.9	---	---
Viscosity Index (VI)	Scale	ASTM D2270	97	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

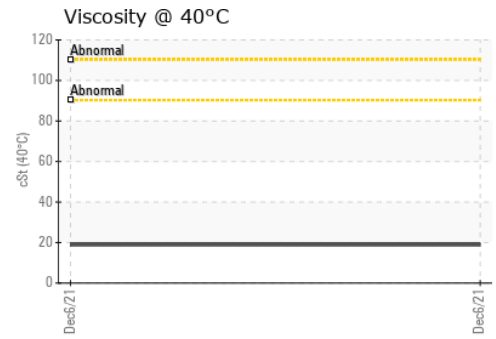

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO10000664 **Received** : 27 Dec 2021
Lab Number : 05431747 **Diagnosed** : 29 Dec 2021
Unique Number : 9790939 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

ERGON - ST LOUIS
 201 EAST NAGEL
 ST LOUIS, MO
 US 63111
 Contact: BUTCH JANES
 bjanes@jamesriverequipment.com
 T: (336)973-8201
 F: (336)973-8496

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)