

OIL ANALYSIS REPORT

T Sa



ISO

Machine Id

6907561 (S/N 1122)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC73407		
Sample Date		Client Info		07 Jan 2022		
Machine Age	hrs	Client Info		2886		
Oil Age	hrs	Client Info		2886		
Oil Changed	0	Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm		>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	2		
Tin		ASTM D5185m	>10	<1		
Antimony	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm			0		
	ppm	ASTM D5185m		U		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	62		
Calcium	ppm	ASTM D5185m	0	1		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	18		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		15		
Potassium	ppm	ASTM D5185m	>20	12		
Water	%	ASTM D6304	>0.05	0.008		
ppm Water	ppm	ASTM D6304	>500	83.8		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		9710		
Particles >6µm		ASTM D7647	>1300	<u></u> 3124		
Particles >14µm		ASTM D7647	>80	428		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38μm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.376		



OIL ANALYSIS REPORT

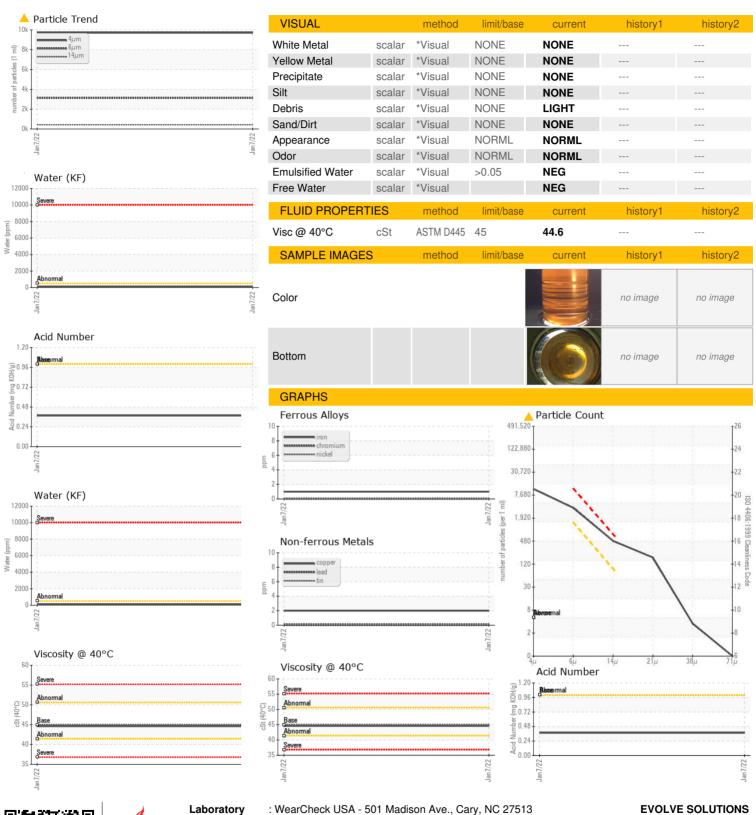



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC73407 . 05446007

: 9815201 : IND 2

Recieved Diagnosed Diagnostician

: 19 Jan 2022 : 19 Jan 2022 : Doug Bogart

US 44077 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

1 HIGH TECH AVE

PAINESVILLE, OH