

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



7145192 (S/N 1204)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2022		
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC100435		
Sample Date		Client Info		10 Jan 2022		
Machine Age	hrs	Client Info		2103		
Oil Age	hrs	Client Info		2103		
Oil Changed	1110	Client Info		Changed		
Sample Status		Olioni inio		NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
	10.10.100	ASTM D5185m				
Iron	ppm		>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		1		
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	2		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	69		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		1		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	189.7		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4397		
Particles >6µm		ASTM D7647	>1300	893		
Particles >14µm		ASTM D7647	>80	21		
Particles >21µm		ASTM D7647	>20	5		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/12		
- FI - U.D. D. F. O.D. A.D.						
FLUID DEGRAD	ATION _	method				history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.330



# **OIL ANALYSIS REPORT**

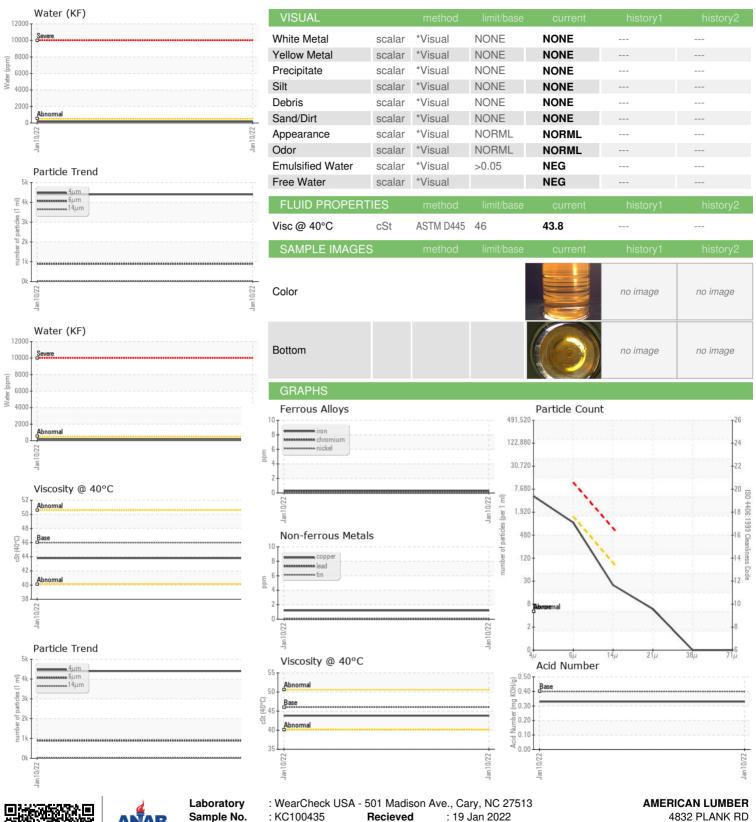



Certificate L2367

Sample No. Lab Number Unique Number Test Package

: KC100435 : 05446025 : 9815219 : IND 2

: 19 Jan 2022 Recieved Diagnosed : 19 Jan 2022

Diagnostician : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NORWALK, OH

Contact: Service Manager

US 44857

T: F: