


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

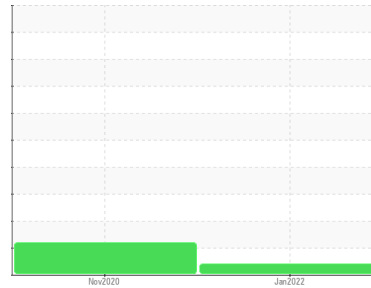

Machine Id
KAESER SK 15 AC 6797762 (S/N 1351)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC95278	KC92363	---
Sample Date	Client Info		13 Jan 2022	20 Nov 2020	---
Machine Age	hrs	Client Info	1930	1028	---
Oil Age	hrs	Client Info	902	1028	---
Oil Changed	Client Info		Not Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	<1	0	---
Lead	ppm	ASTM D5185m >10	0	<1	---
Copper	ppm	ASTM D5185m >50	3	2	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Antimony	ppm	ASTM D5185m	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 90	6	40	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m 90	45	73	---
Calcium	ppm	ASTM D5185m 2	0	3	---
Phosphorus	ppm	ASTM D5185m	5	3	---
Zinc	ppm	ASTM D5185m	5	0	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	2	---
Sodium	ppm	ASTM D5185m	12	15	---
Potassium	ppm	ASTM D5185m >20	<1	3	---
Water	%	ASTM D6304 >0.05	0.012	0.037	---
ppm Water	ppm	ASTM D6304 >500	122.0	376.8	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		12433	53538	---
Particles >6µm	ASTM D7647 >1300		▲ 4167	▲ 24331	---
Particles >14µm	ASTM D7647 >80		59	▲ 697	---
Particles >21µm	ASTM D7647 >20		7	▲ 78	---
Particles >38µm	ASTM D7647 >4		0	4	---
Particles >71µm	ASTM D7647 >3		0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/13	▲ 22/17	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.31	0.375	---


OIL ANALYSIS REPORT

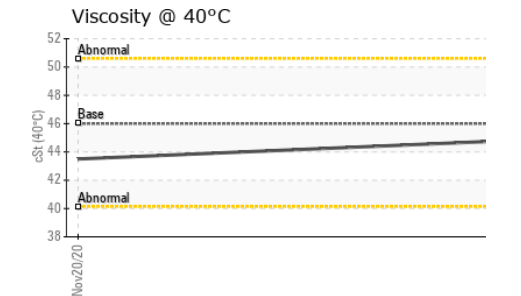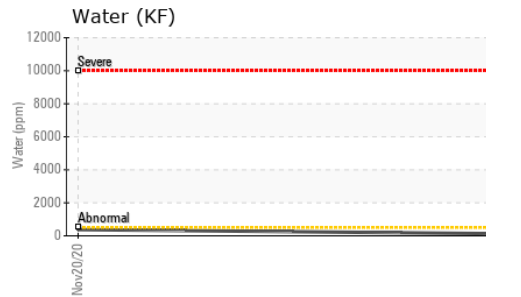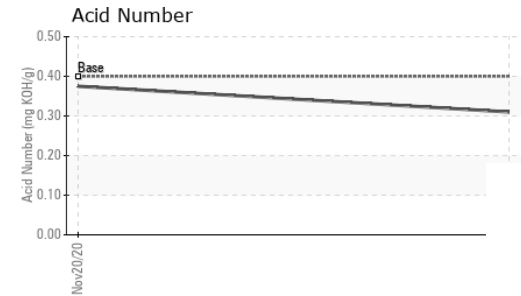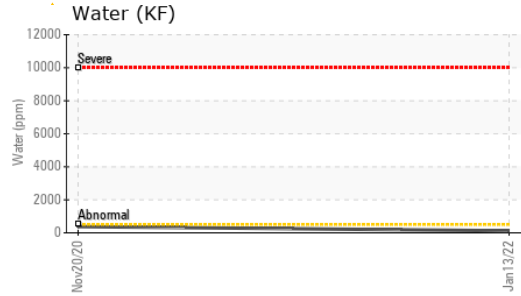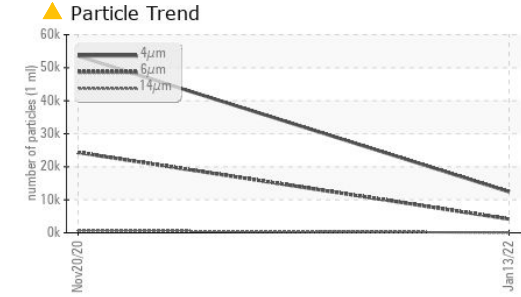





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.8	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

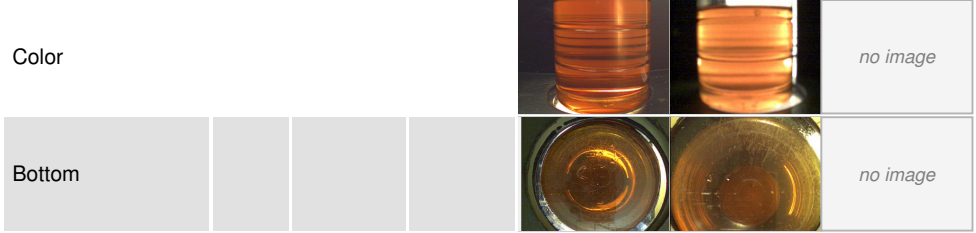

GRAPHS

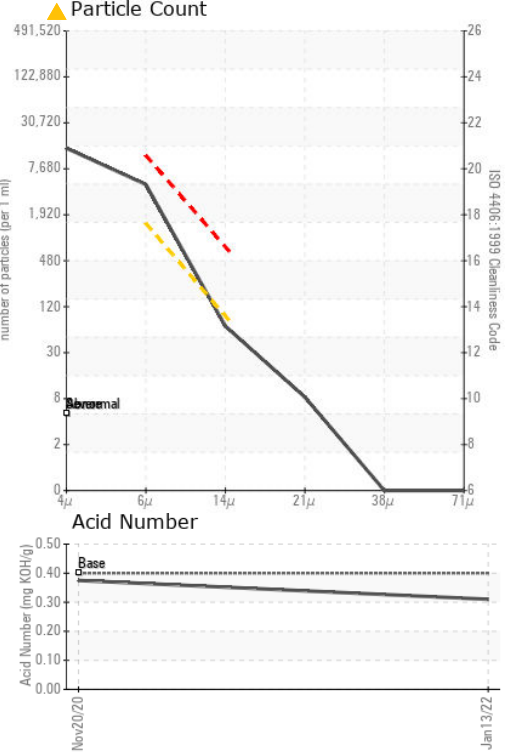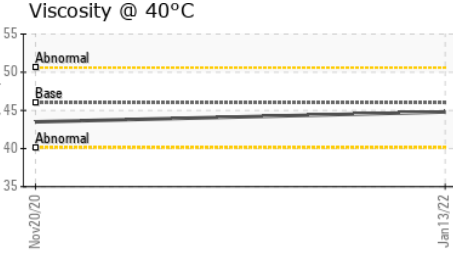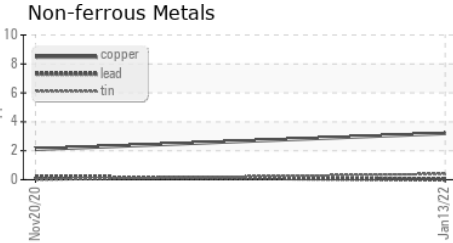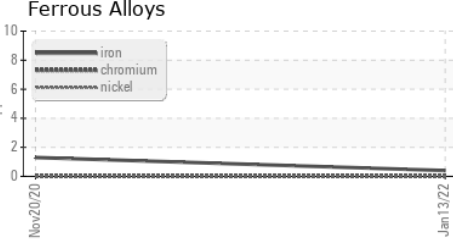

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC95278 **Received** : 01 Feb 2022
Lab Number : 05456219 **Diagnosed** : 02 Feb 2022
Unique Number : 9830414 **Diagnostician** : Don Baldrige
Test Package : IND 2

AERO CONTROLLEX
 313 GILLET ST.
 PAINESVILLE, OH
 US 44077
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)