


# PROBLEM SUMMARY

## Sample Rating Trend




ISO

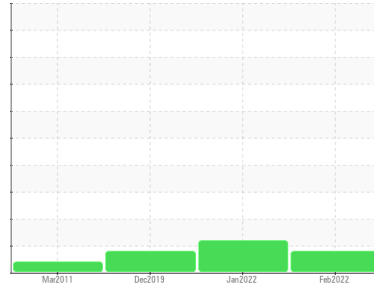

Machine Id  
**A-02**  
Component  
**Wind Turbine Gearbox**  
Fluid  
**ROYAL PURPLE SYNFILM GT 320 (65 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

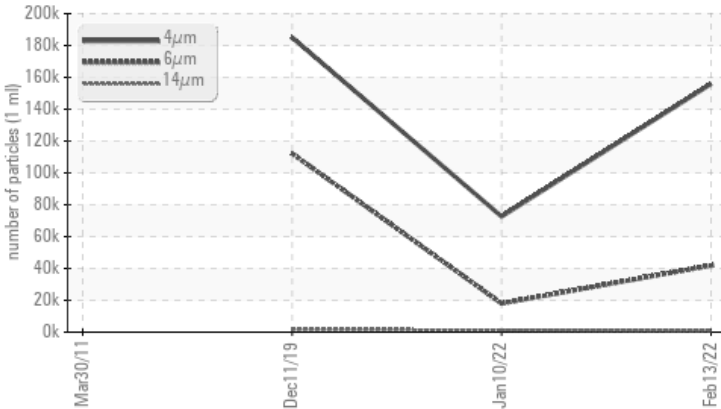

## RECOMMENDATION

Replace filter element and resample at later date. In case already attempted and cleanliness was not improved then proceed to replace oil.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>5000	▲ <b>41866</b>	▲ 18041	▲ 112169
Particles >14µm	ASTM D7647	>640	▲ <b>882</b>	▲ 1334	▲ 1561
Oil Cleanliness	ISO 4406 (c)	>--/19/16	▲ <b>24/23/17</b>	▲ 23/21/18	▲ 25/24/18

Customer Id: MITWHI  
Sample No.: MHI019868  
Lab Number: 05466778  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	Replace filter element and resample at later date. In case already attempted and cleanliness was not improved then proceed to replace oil.
Resample	---	---	?	Replace filter element and resample at later date. In case already attempted and cleanliness was not improved then proceed to replace oil.

## HISTORICAL DIAGNOSIS

### 10 Jan 2022 Diag: Angela Borella

ISO



We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



### 11 Dec 2019 Diag: Don Baldrige

ISO



Replace filter element and resample at later date. In case already attempted and cleanliness was not improved then proceed to replace oil. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid.

view report



### 30 Mar 2011 Diag: Jonathan Hester

VIS DEBRIS




We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend you service the filters on this component. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The condition of oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

## Sample Rating Trend

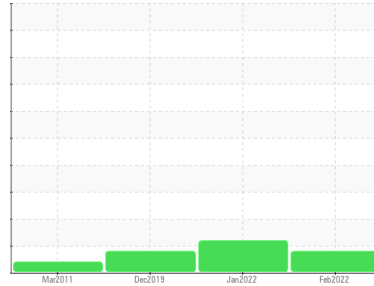

ISO



Machine Id  
**A-02**  
Component  
**Wind Turbine Gearbox**  
Fluid  
**ROYAL PURPLE SYNFILM GT 320 (65 GAL)**

### DIAGNOSIS

#### Recommendation

Replace filter element and resample at later date. In case already attempted and cleanliness was not improved then proceed to replace oil.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>MHI019868</b>	MHI019861	MHI009778
Sample Date	Client Info			<b>13 Feb 2022</b>	10 Jan 2022	11 Dec 2019
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>200	<b>18</b>	20	33
Iron	ppm	ASTM D5185m	>200	<b>12</b>	18	20
Chromium	ppm	ASTM D5185m		<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m		<b>0</b>	0	<1
Lead	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>75	<b>5</b>	11	5
Tin	ppm	ASTM D5185m		<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	3	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>7</b>	0	31
Calcium	ppm	ASTM D5185m		<b>0</b>	0	1
Phosphorus	ppm	ASTM D5185m		<b>23</b>	177	11
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>15203</b>	8672	15721

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<b>2</b>	<1	2
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Water	%	ASTM D6304	>0.1	<b>0.003</b>	0.007	0.023
ppm Water	ppm	ASTM D6304	>1000	<b>37.8</b>	71.5	231.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>155900</b>	72606	185061
Particles >6µm		ASTM D7647	>5000	<b>▲ 41866</b>	▲ 18041	▲ 112169
Particles >14µm		ASTM D7647	>640	<b>▲ 882</b>	▲ 1334	▲ 1561
Particles >21µm		ASTM D7647	>160	<b>115</b>	▲ 280	64
Particles >38µm		ASTM D7647	>40	<b>9</b>	3	0
Particles >71µm		ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/19/16	<b>▲ 24/23/17</b>	▲ 23/21/18	▲ 25/24/18

# OIL ANALYSIS REPORT

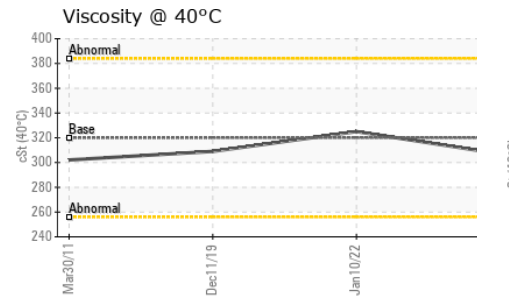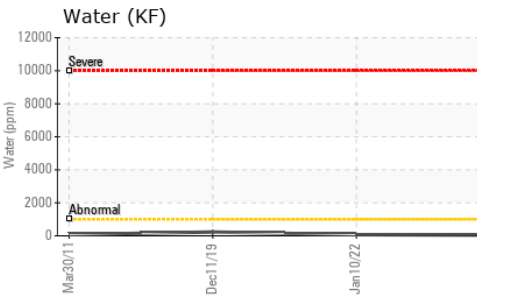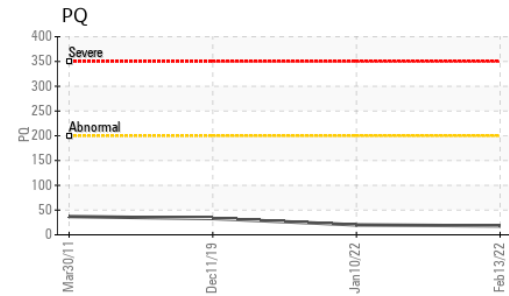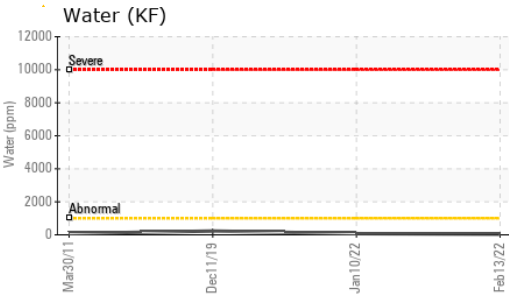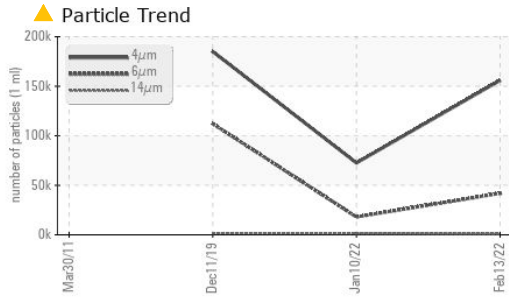

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	<b>0.38</b>	0.55	0.380






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	<b>307</b>	325	309

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------



## GRAPHS

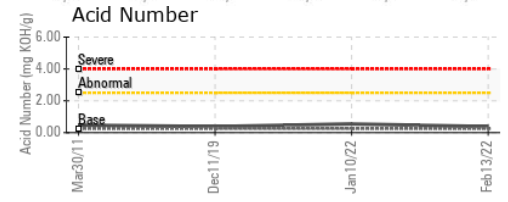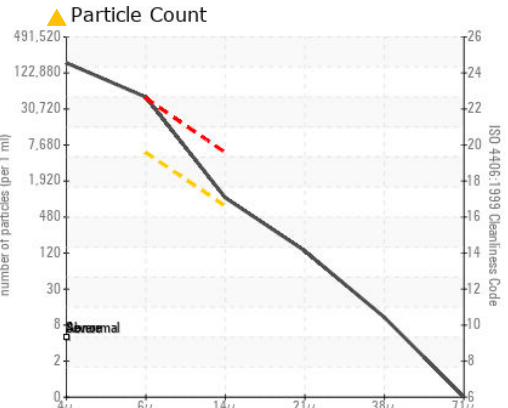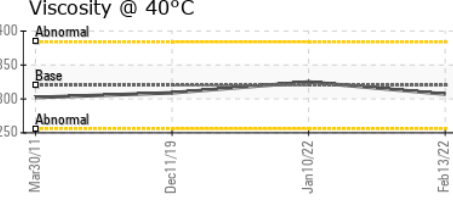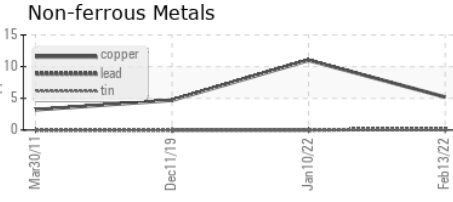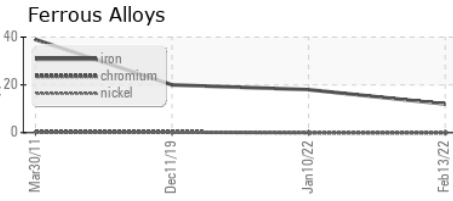

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MHI019868 **Received** : 14 Feb 2022  
**Lab Number** : 05466778 **Diagnosed** : 15 Feb 2022  
**Unique Number** : 9850991 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**DIAMOND WTG - WHITE DEER SITE - MPS WD**  
 PO BOX 872  
 WHITE DEER, TX  
 US 79097  
 Contact: WESLEY CAMPBELL  
 wesley.campbell@diamondwtg.com  
 T: (806)883-1051  
 F: (806)883-2004

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)