


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

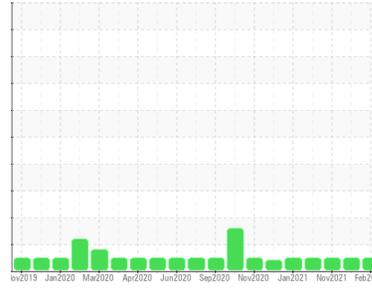

Machine Id
WHITE

Component
Reciprocating Compressor

Fluid
TULCO LUBSOIL IND MP R&O 150 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-----------------|--------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | TO40000023 | TO40000021 | TO40000020 |
| Sample Date | Client Info | | | 07 Feb 2022 | 06 Jan 2022 | 09 Nov 2021 |
| Machine Age | wks Client Info | | | 0 | 0 | 0 |
| Oil Age | wks Client Info | | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | <1 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | <1 | 0 | 0 |
| Lead | ppm | ASTM D5185m | >25 | <1 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | <1 | <1 | <1 |
| Tin | ppm | ASTM D5185m | >15 | 0 | <1 | <1 |
| Antimony | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |






| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | <1 | 3 | 2 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 0 | 1 | 2 | 1 |
| Phosphorus | ppm | ASTM D5185m | 0 | 17 | 12 | 12 |
| Zinc | ppm | ASTM D5185m | 0 | 0 | 3 | 0 |
| Sulfur | ppm | ASTM D5185m | 2400 | 2032 | 2288 | 2123 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | 4 | 4 | 5 |
| Sodium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |
| Water | % | ASTM D6304 | >0.1 | 0.007 | 0.001 | 0.010 |
| ppm Water | ppm | ASTM D6304 | >1000 | 71.6 | 11.8 | 100.8 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | >10000 | 6017 | 3862 | 1865 |
| Particles >6µm | | ASTM D7647 | >2500 | 975 | 984 | 476 |
| Particles >14µm | | ASTM D7647 | >320 | 24 | 52 | 35 |
| Particles >21µm | | ASTM D7647 | >80 | 4 | 13 | 6 |
| Particles >38µm | | ASTM D7647 | >20 | 1 | 0 | 0 |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/15 | 20/17/12 | 19/17/13 | 18/16/12 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|--------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.078 | 0.06 | 0.055 |


OIL ANALYSIS REPORT

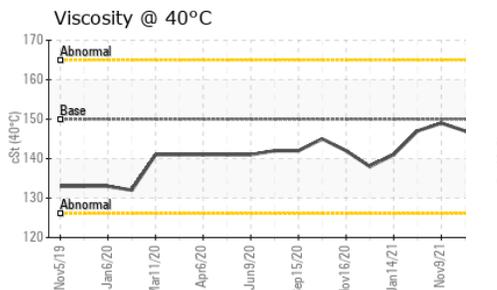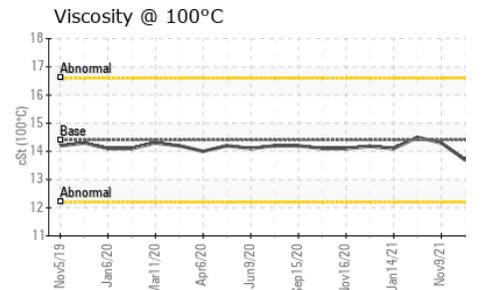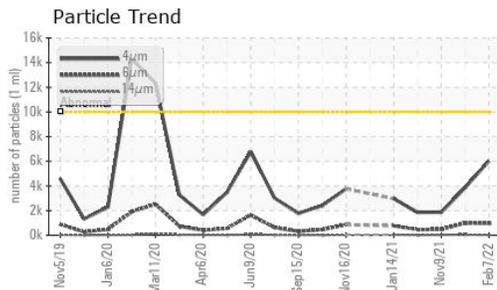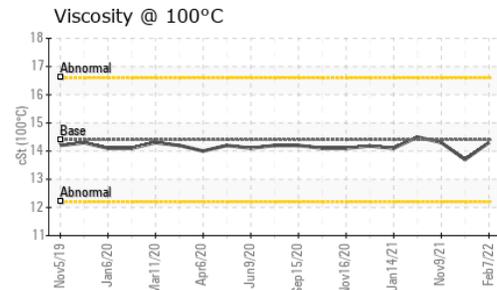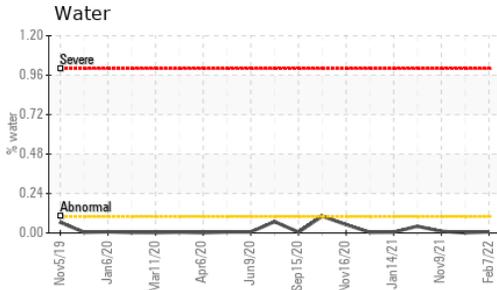






| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | LIGHT | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|----------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 150 | 147 | 149 |
| Visc @ 100°C | cSt | ASTM D445 | 14.4 | 13.7 | 14.3 |
| Viscosity Index (VI) | Scale | ASTM D2270 | 92 | 87 | 92 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

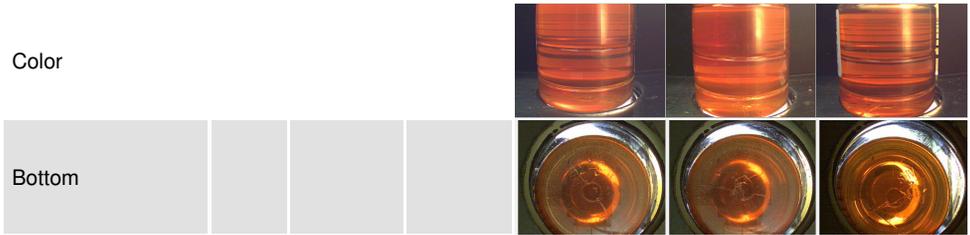

GRAPHS

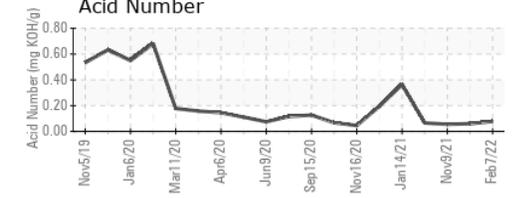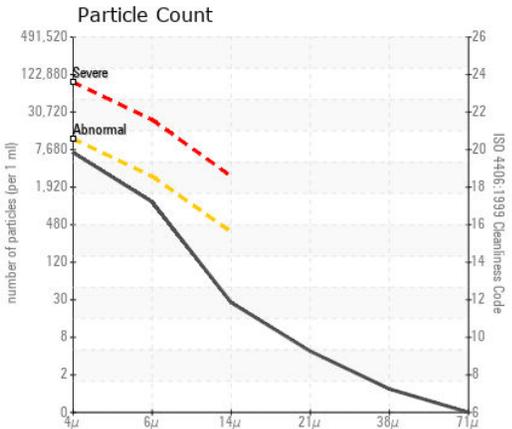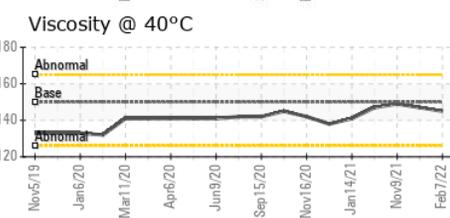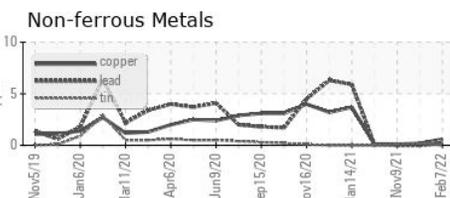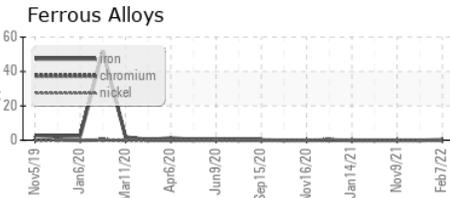

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO40000023 **Received** : 16 Feb 2022
Lab Number : 05470245 **Diagnosed** : 17 Feb 2022
Unique Number : 9854458 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CAMBRIAN ENERGY-SOUTH TEX FT. SMITH TREATERS
 5950 COMMERCE RD
 FORT SMITH, AR
 US 72916
 Contact: DUSTIN FRY
 dustin@morrowenergy.com
 T: (479)221-7571
 F: