




OIL ANALYSIS REPORT

Sample Rating Trend

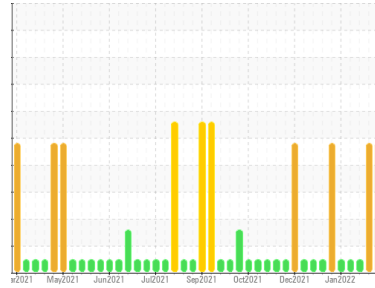

DIRT



Machine Id
ZOKM01BE (S/N GZJ00541)
 Component
Biogas Engine
 Fluid
SHELL MYSELLA S5 S (160 GAL)

DIAGNOSIS

Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. (Customer Sample Comment: Oil type: shell mysella s5)

Wear

All component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0623294	WC0623293	WC0623290
Sample Date	Client Info		14 Feb 2022	08 Feb 2022	31 Jan 2022
Machine Age	hrs	Client Info	69490	69343	69153
Oil Age	hrs	Client Info	693	546	356
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	6	10	4
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >6	3	3	2
Lead	ppm	ASTM D5185m >9	1	1	<1
Copper	ppm	ASTM D5185m >6	2	2	2
Tin	ppm	ASTM D5185m >4	5	5	3
Antimony	ppm	ASTM D5185m	11	15	10
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	3	3	3
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	4	5	4
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	32	38	32
Calcium	ppm	ASTM D5185m	1543	1568	1364
Phosphorus	ppm	ASTM D5185m 300	356	358	310
Zinc	ppm	ASTM D5185m	398	424	371
Sulfur	ppm	ASTM D5185m	2911	3127	2502

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	230	210	137
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	0	0	<1

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0	0
Nitration	Abs/cm	*ASTM D7624 >20	5.7	5.4	4.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	23.1	22.2	20.6



OIL ANALYSIS REPORT





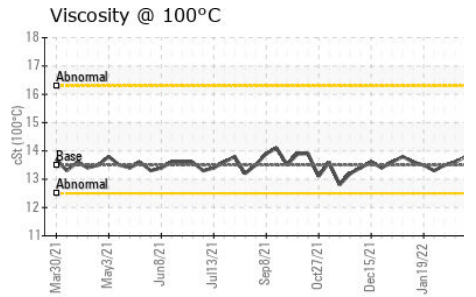
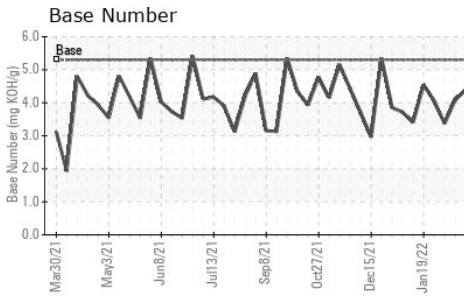
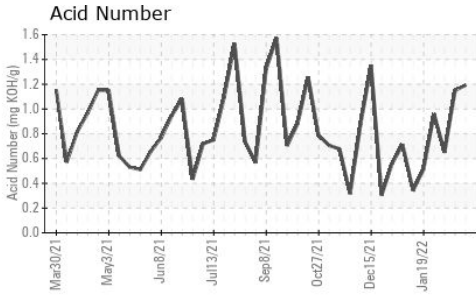
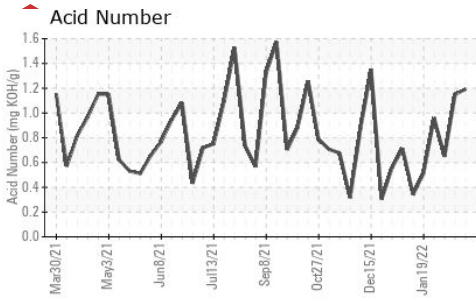


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.8	14.6	12.7
Acid Number (AN)	mg KOH/g	ASTM D8045		1.193	1.15	0.65
Base Number (BN)	mg KOH/g	ASTM D2896	5.3	4.38	4.08	3.37

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.8	13.6	13.5

GRAPHS

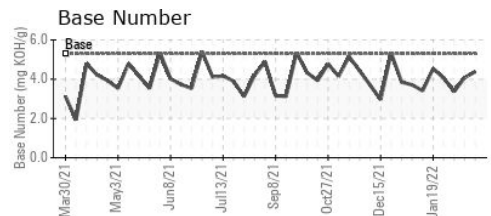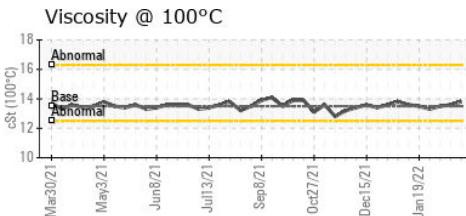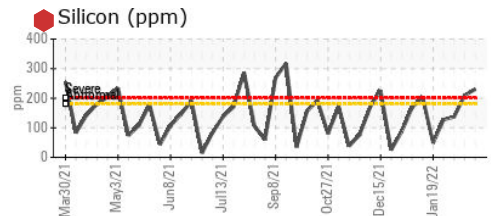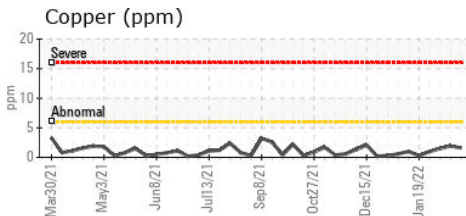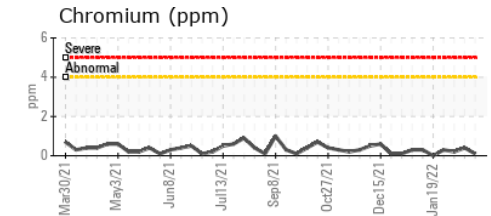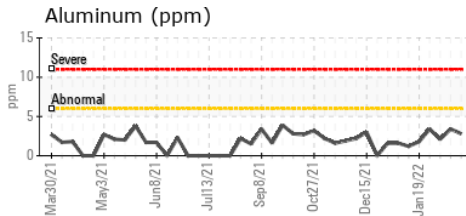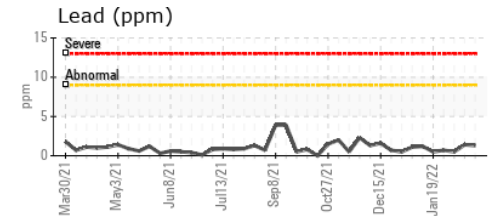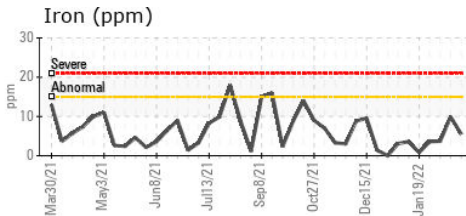

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0623294
Lab Number : **05470482**
Unique Number : 9854695
Test Package : MOB 2

Received : 16 Feb 2022
Tested : 18 Feb 2022
Diagnosed : 18 Feb 2022 - Jonathan Hester

EDL NA Recips-Zook
 Zook Powerstation, 388 E. Main Street
 Leola, PA
 US 17540-1925
 Contact: Kevin Johnson
 kevin.johnson@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: