




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
ATLAS COPCO ROTO XTEND [12443892]
 Machine Id
ATLAS COPCO AFI097785 - ARCH SHARPLES
 Component
Compressor

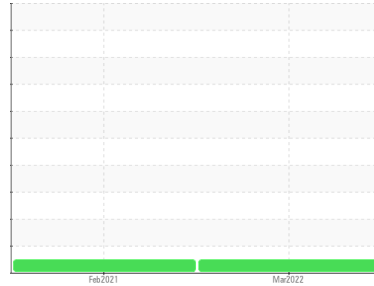

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|----------|
| Sample Number | Client Info | | UCH05503911 | UCH05195435 | --- |
| Sample Date | Client Info | | 21 Mar 2022 | 19 Feb 2021 | --- |
| Machine Age | hrs | Client Info | 4476 | 933 | --- |
| Oil Age | hrs | Client Info | 1421 | 0 | --- |
| Oil Changed | Client Info | | Not Chngd | Not Chngd | --- |
| Sample Status | | | NORMAL | NORMAL | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | 3 | <1 | --- |
| Chromium | ppm | ASTM D5185m >5 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185m | 0 | 0 | --- |
| Silver | ppm | ASTM D5185m | <1 | 0 | --- |
| Aluminum | ppm | ASTM D5185m >15 | 5 | 0 | --- |
| Lead | ppm | ASTM D5185m >65 | 0 | <1 | --- |
| Copper | ppm | ASTM D5185m >65 | <1 | <1 | --- |
| Tin | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Antimony | ppm | ASTM D5185m | --- | 0 | --- |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m | 0 | 0 | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | 0 | <1 | --- |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | --- |
| Calcium | ppm | ASTM D5185m | <1 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | 149 | 17 | --- |
| Zinc | ppm | ASTM D5185m | 48 | 10 | --- |
| Sulfur | ppm | ASTM D5185m | 443 | 41 | --- |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|-----------------|----------|----------|----------|
| Silicon | ppm | ASTM D5185m >35 | 4 | <1 | --- |
| Sodium | ppm | ASTM D5185m | 2 | 0 | --- |
| Potassium | ppm | ASTM D5185m >20 | 0 | <1 | --- |

FLUID DEGRADATION



| | method | limit/base | current | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.14 | 0.20 | 0.129 | --- |

VISUAL

| | method | limit/base | current | history1 | history2 |
|------------------|--------|---------------|--------------|----------|----------|
| White Metal | scalar | *Visual NONE | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual NONE | NONE | NONE | --- |
| Precipitate | scalar | *Visual NONE | NONE | NONE | --- |
| Silt | scalar | *Visual NONE | NONE | NONE | --- |
| Debris | scalar | *Visual NONE | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual NONE | NONE | NONE | --- |
| Appearance | scalar | *Visual NORML | NORML | NORML | --- |
| Odor | scalar | *Visual NORML | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual >0.1 | NEG | NEG | --- |
| Free Water | scalar | *Visual | NEG | --- | --- |







OIL ANALYSIS REPORT

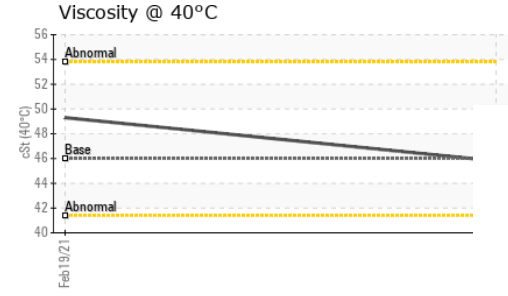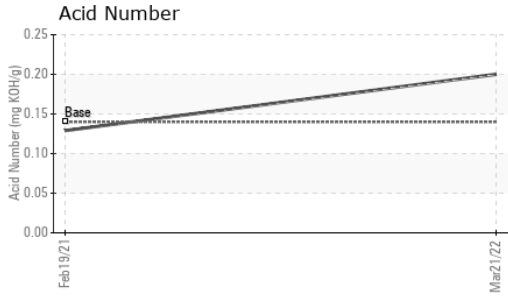

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 45.8 | 49.3 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color | | | | | no image |
| Bottom | | | | | no image |

GRAPHS

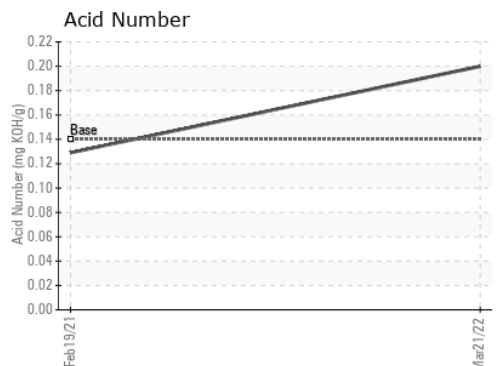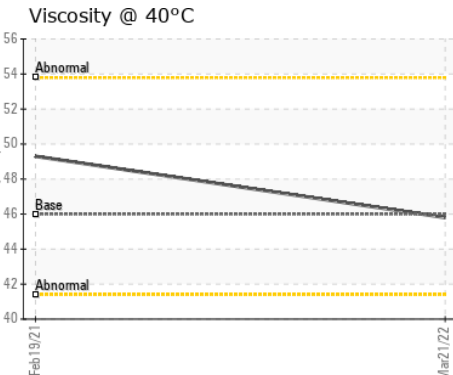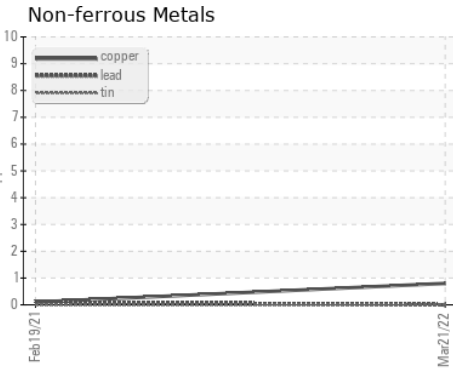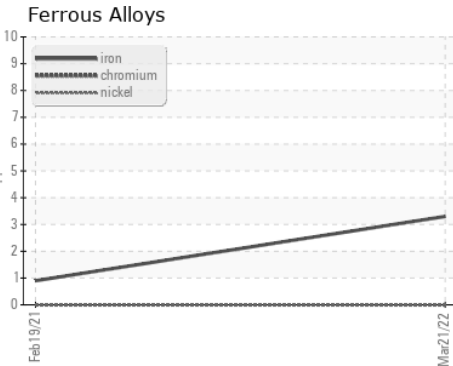

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH05503911 **Received** : 28 Mar 2022
Lab Number : **05503911** **Diagnosed** : 30 Mar 2022
Unique Number : 9908148 **Diagnostician** : Doug Bogart
Test Package : IND 2

TOTAL EQUIPMENT COMPANY
 200 SMILEY DR
 SAINT ALBANS, WV
 US 25177
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: