


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

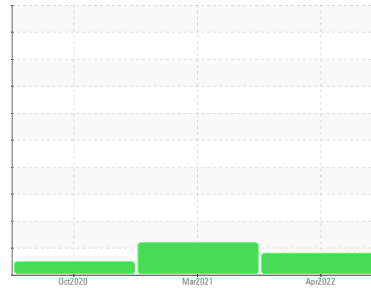

Machine Id  
**KAESER SFC 22T 6619212 (S/N 1008)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC96205</b>	KC92967	KC91104
Sample Date	Client Info		<b>18 Apr 2022</b>	15 Mar 2021	14 Oct 2020
Machine Age	hrs	Client Info	<b>25499</b>	18367	15120
Oil Age	hrs	Client Info	<b>2289</b>	3247	6900
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>5</b>	2	10
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	44	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 90	<b>0</b>	70	17
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	4
Phosphorus	ppm	ASTM D5185m	<b>0</b>	4	6
Zinc	ppm	ASTM D5185m	<b>0</b>	9	54

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	0	2
Sodium	ppm	ASTM D5185m	<b>12</b>	28	10
Potassium	ppm	ASTM D5185m >20	<b>0</b>	8	4
Water	%	ASTM D6304 >0.05	<b>0.014</b>	0.022	0.012
ppm Water	ppm	ASTM D6304 >500	<b>144.1</b>	229.0	127.1

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>28271</b>	8574	728
Particles >6µm	ASTM D7647 >1300		▲ <b>4852</b>	▲ 2401	235
Particles >14µm	ASTM D7647 >80		▲ <b>100</b>	▲ 163	16
Particles >21µm	ASTM D7647 >20		<b>10</b>	▲ 39	5
Particles >38µm	ASTM D7647 >4		<b>0</b>	2	0
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>19/14</b>	▲ 18/15	15/11

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.39</b>	0.384	0.348

# OIL ANALYSIS REPORT


## Particle Trend

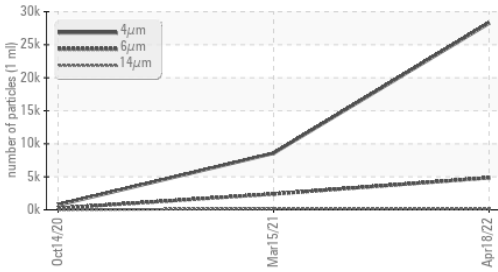


## Water (KF)

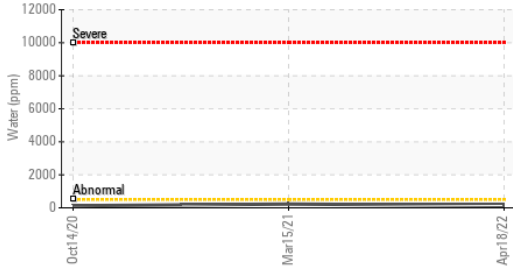


## Acid Number

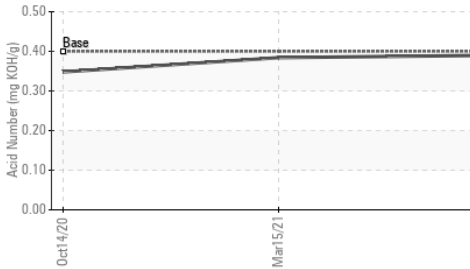

## Water (KF)

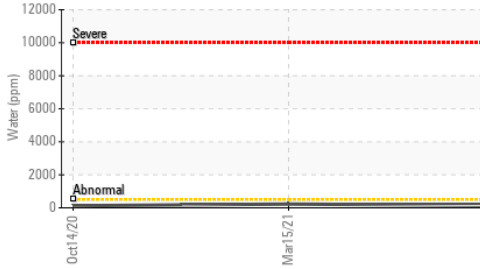


## Viscosity @ 40°C

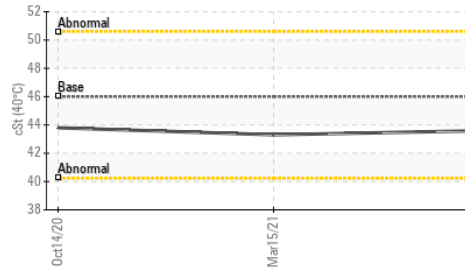



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.6	43.3	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

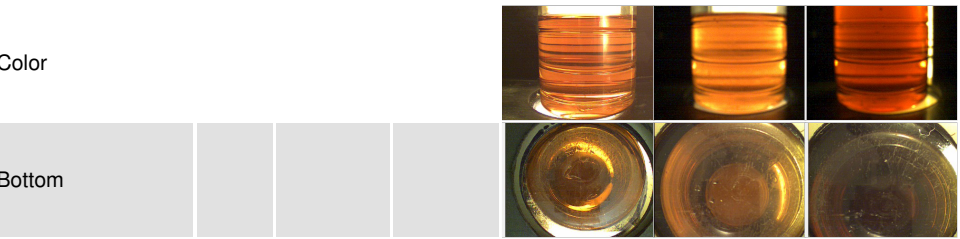

## GRAPHS

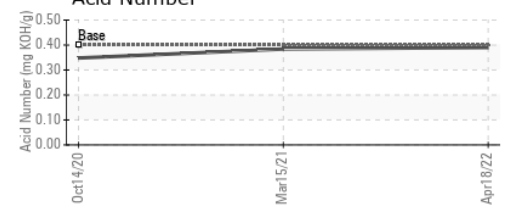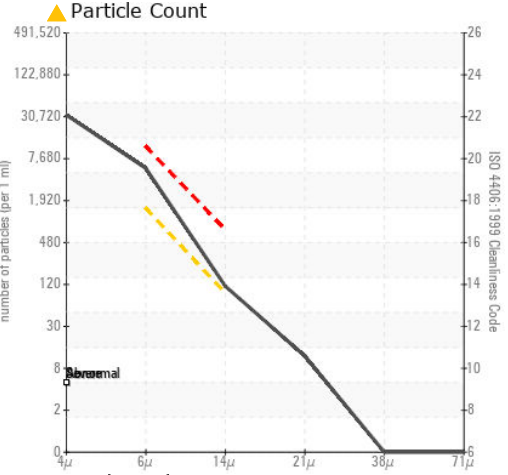

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC96205 **Received** : 02 May 2022  
**Lab Number** : 05533337 **Diagnosed** : 02 May 2022  
**Unique Number** : 9957626 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**AERO CONTROLLEX**  
 313 GILLET ST.  
 PAINESVILLE, OH  
 US 44077  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)