




# OIL ANALYSIS REPORT

## Sample Rating Trend

**NORMAL**



Area  
**BLEACH O2**  
 Machine Id  
**METSO BX025 PRE02 PRESS SE (S/N 0661-03-02-040-040-090)**  
 Component  
**Bearing**  
 Fluid  
**NOT GIVEN (4 GAL)**

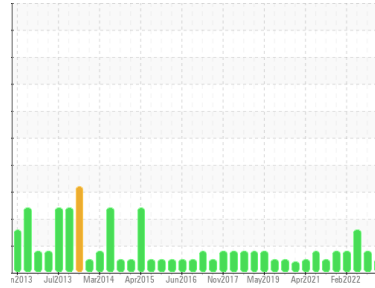

### DIAGNOSIS

- Recommendation**  
 Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0676805</b>	WC0676804	WC0676811
Sample Date	Client Info			<b>13 May 2022</b>	29 Apr 2022	08 Mar 2022
Machine Age	mls Client Info			<b>0</b>	0	0
Oil Age	mls Client Info			<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>12</b>	▲ 25	8
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	3	2
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	3	<1
Calcium	ppm	ASTM D5185m		<b>8</b>	34	11
Phosphorus	ppm	ASTM D5185m		<b>31</b>	114	53
Zinc	ppm	ASTM D5185m		<b>0</b>	4	0
Sulfur	ppm	ASTM D5185m		<b>7363</b>	20132	10642

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	5	2
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.22</b>	0.24	0.34

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>2	<b>NEG</b>	NEG	0.2%
Free Water	scalar	*Visual		<b>NEG</b>	NEG	0.2%

# OIL ANALYSIS REPORT

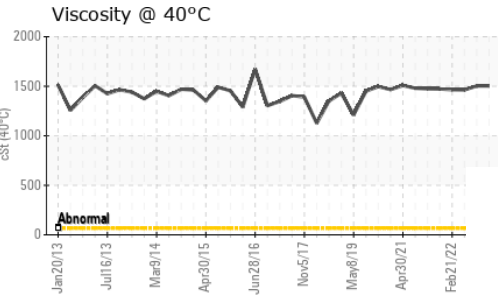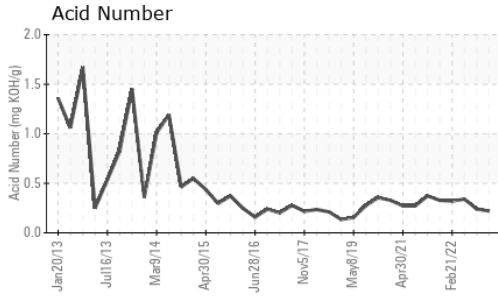

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		<b>1503</b>	1503	1463

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color




Bottom






## GRAPHS

### Ferrous Alloys

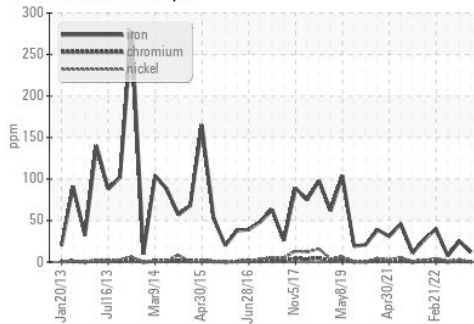

### Non-ferrous Metals

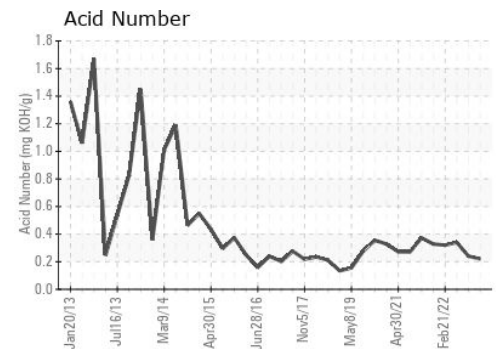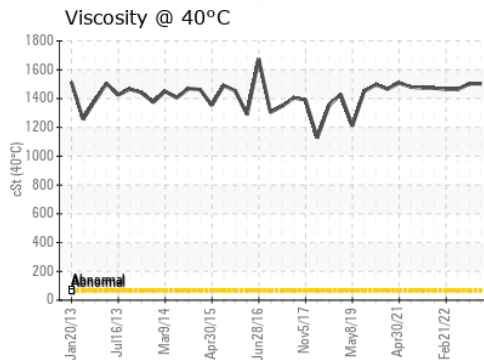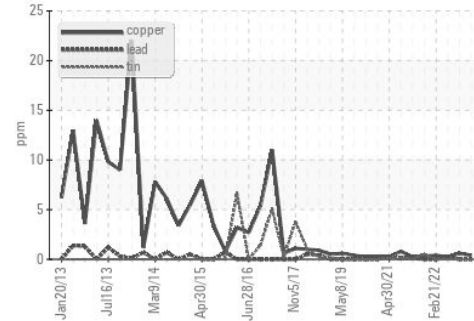

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0676805 **Received** : 23 May 2022  
**Lab Number** : 05551512 **Diagnosed** : 25 May 2022  
**Unique Number** : 9985879 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

### INTERNATIONAL PAPER

865 JOHN L REGEL RD  
 RIEGELWOOD, NC  
 US 28456  
 Contact: Zach Lizana  
 zachary.lizana@ipaper.com  
 T: (910)362-4775  
 F: