




OIL ANALYSIS REPORT

Sample Rating Trend

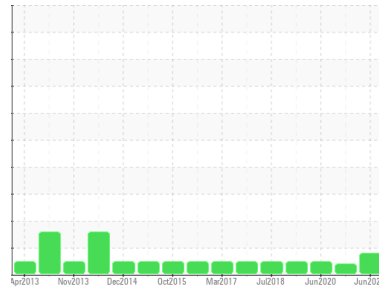

WEAR



Area

EVA CREEK

Machine Id

WEC 14 - 91977 (S/N 26113)

Component

Wind Turbine Gearbox

Fluid

CASTROL OPTIGEAR SYNTHETIC A ISO 320 (475 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

Gear wear is indicated.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0634818	WC0544197	WC0373049
Sample Date	Client Info		01 Jun 2022	29 Jul 2021	03 Jun 2020
Machine Age	hrs	Client Info	79043	74129	66097
Oil Age	hrs	Client Info	0	74129	66097
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			ABNORMAL	ATTENTION	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>80	27	36	29	
Iron	ppm	ASTM D5185m	>90	▲ 245	247	204
Chromium	ppm	ASTM D5185m	>4	4	4	3
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	2	1
Lead	ppm	ASTM D5185m	>11	<1	<1	<1
Copper	ppm	ASTM D5185m	>55	6	6	5
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		<1	<1	<1
Cadmium	ppm	ASTM D5185m		0	<1	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	2	6	2
Barium	ppm	ASTM D5185m	0	4	0	3
Molybdenum	ppm	ASTM D5185m	1150	1186	1275	1155
Manganese	ppm	ASTM D5185m		4	3	3
Magnesium	ppm	ASTM D5185m	1800	1820	1931	1724
Calcium	ppm	ASTM D5185m	20	15	17	14
Phosphorus	ppm	ASTM D5185m	1450	1382	1494	1282
Zinc	ppm	ASTM D5185m	1650	1638	1729	1455
Sulfur	ppm	ASTM D5185m	4900	5768	5956	4927

CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>35	17	16	17
Sodium	ppm	ASTM D5185m	>25	6	6	6
Potassium	ppm	ASTM D5185m	>20	0	2	2
Water	%	ASTM D6304	>.110	0.052	0.048	0.018
ppm Water	ppm	ASTM D6304	>1100	524.6	483.8	182.1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	406	● 3466	579
Particles >6µm	ASTM D7647	>640	68	● 159	101
Particles >14µm	ASTM D7647	>80	9	● 10	25
Particles >21µm	ASTM D7647	>20	4	● 5	20
Particles >38µm	ASTM D7647	>4	1	● 0	2
Particles >71µm	ASTM D7647	>3	0	● 0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	16/13/10	● 19/14/10	16/14/12



OIL ANALYSIS REPORT

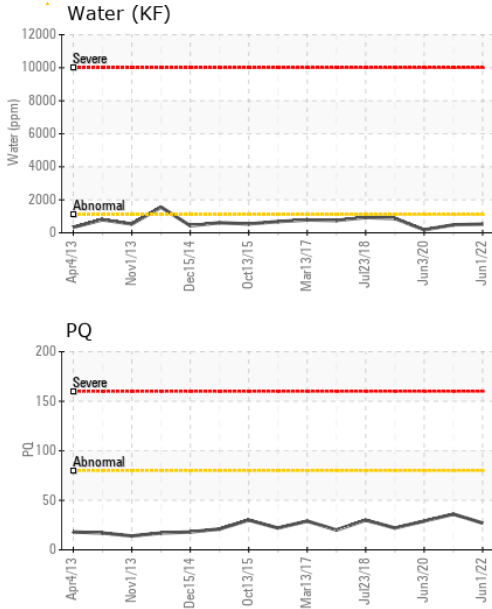

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	3.3	2.33	3.221	2.774


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.110	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	305	329	331	329




SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

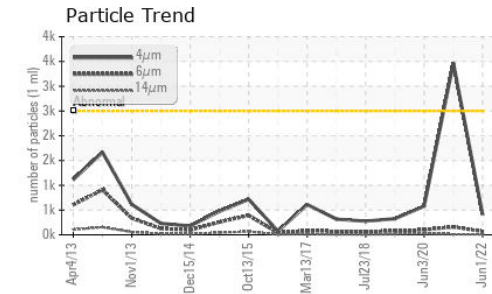

GRAPHS

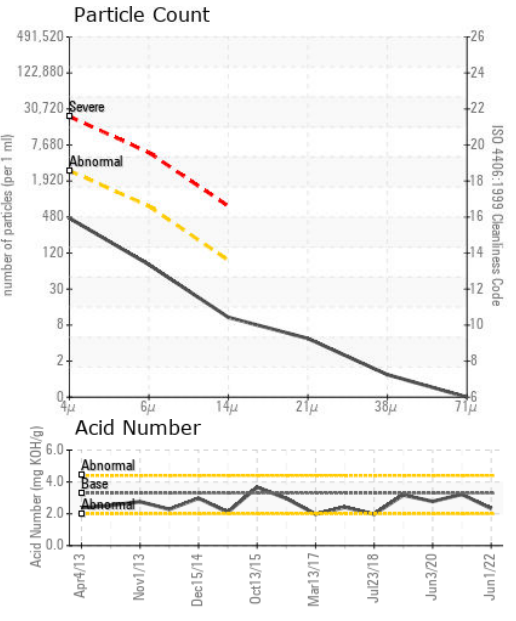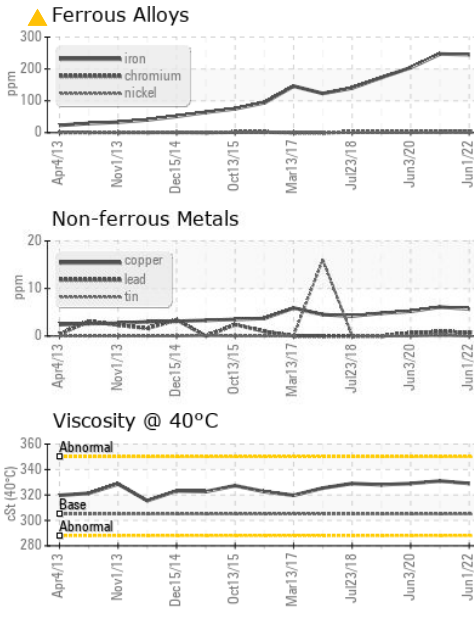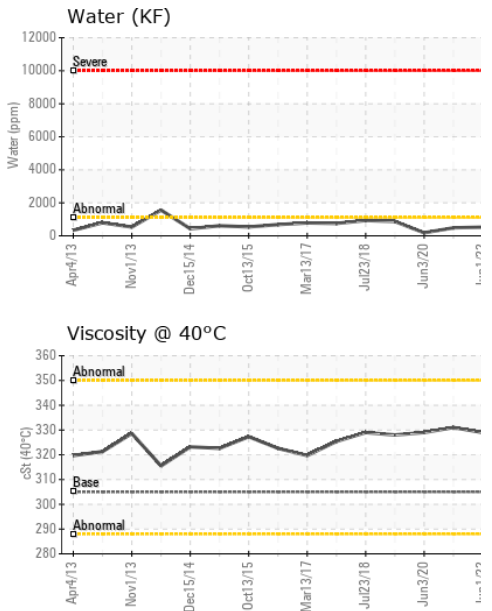

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0634818 **Received** : 16 Jun 2022
Lab Number : 05570060 **Tested** : 17 Jun 2022
Unique Number : 10019477 **Diagnosed** : 17 Jun 2022 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

GOLDEN VALLEY ELECTRIC
 MILE 2.5 HEALY SPUR RD
 HEALY, AK
 US 99743
 Contact: RYAN DEWITT
 rjdewitt@gvea.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)