




PROBLEM SUMMARY


Sample Rating Trend

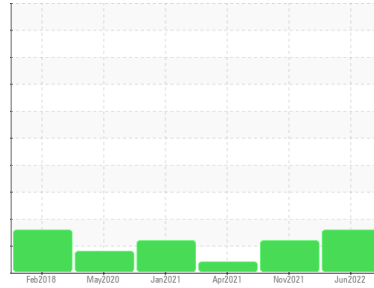

Machine Id
KAESER ASD 40T 5608914 (S/N 1180)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

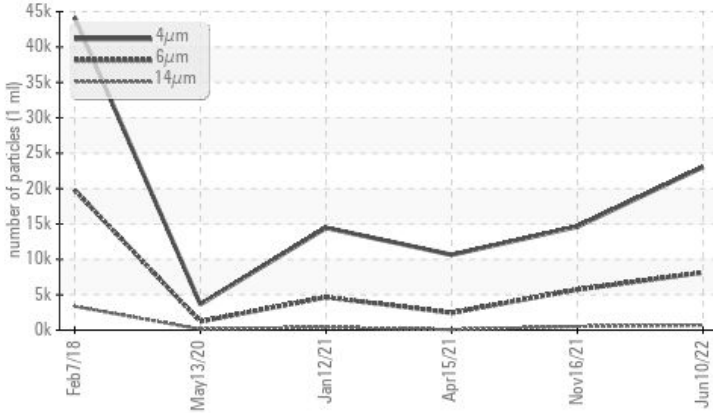

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 8149	▲ 5734	▲ 2444
Particles >14µm	ASTM D7647	>80	▲ 695	▲ 521	66
Particles >21µm	ASTM D7647	>20	▲ 168	▲ 70	14
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/17	▲ 20/16	▲ 18/13

Customer Id: AMACAR
 Sample No.: KC104200
 Lab Number: 05571674
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

16 Nov 2021 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Apr 2021 Diag: Don Baldrige

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



12 Jan 2021 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER ASD 40T 5608914 (S/N 1180)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

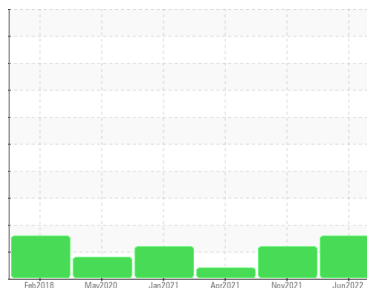

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC104200	KC73492	KC89943
Sample Date	Client Info			10 Jun 2022	16 Nov 2021	15 Apr 2021
Machine Age	hrs	Client Info		28068	24841	21182
Oil Age	hrs	Client Info		3524	223	1247
Oil Changed	Client Info			Changed	Not Changd	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	<1	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	3	6
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	9
Barium	ppm	ASTM D5185m	90	0	33	26
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	33	74	46
Calcium	ppm	ASTM D5185m	2	0	<1	<1
Phosphorus	ppm	ASTM D5185m		36	<1	8
Zinc	ppm	ASTM D5185m		40	26	18

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	<1	0
Sodium	ppm	ASTM D5185m		9	12	20
Potassium	ppm	ASTM D5185m	>20	0	6	3
Water	%	ASTM D6304	>0.05	0.016	0.026	0.020
ppm Water	ppm	ASTM D6304	>500	169.7	268.1	208.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		23051	14621	10643
Particles >6µm		ASTM D7647	>1300	▲ 8149	▲ 5734	▲ 2444
Particles >14µm		ASTM D7647	>80	▲ 695	▲ 521	66
Particles >21µm		ASTM D7647	>20	▲ 168	▲ 70	14
Particles >38µm		ASTM D7647	>4	5	3	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/20/17	▲ 20/16	▲ 18/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.367	0.376

OIL ANALYSIS REPORT

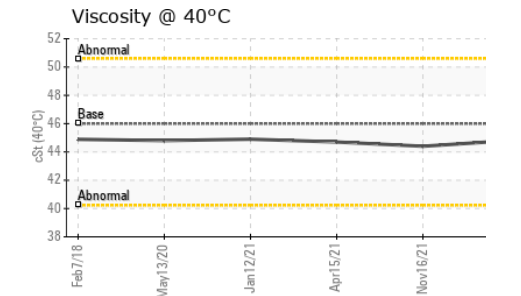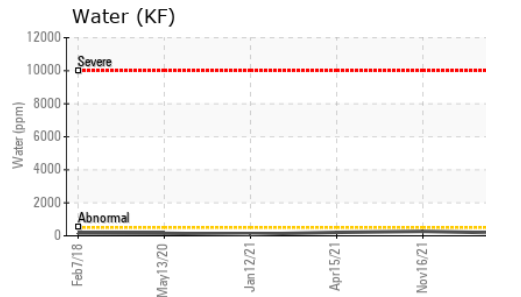
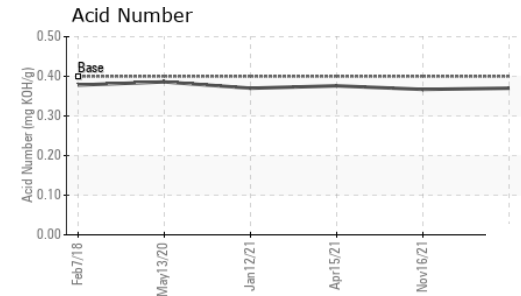
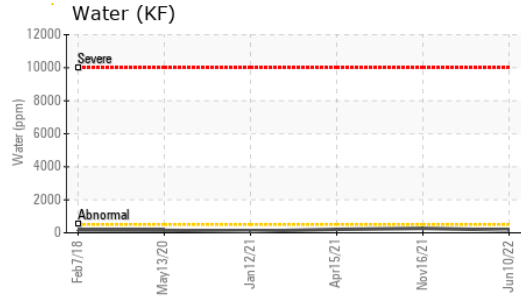
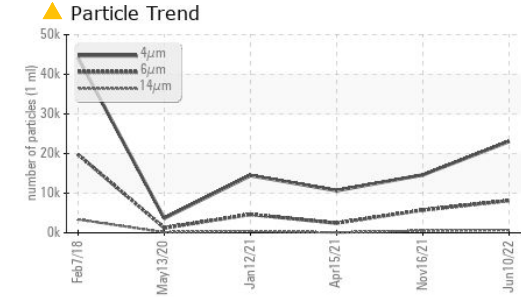


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.8	44.4	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

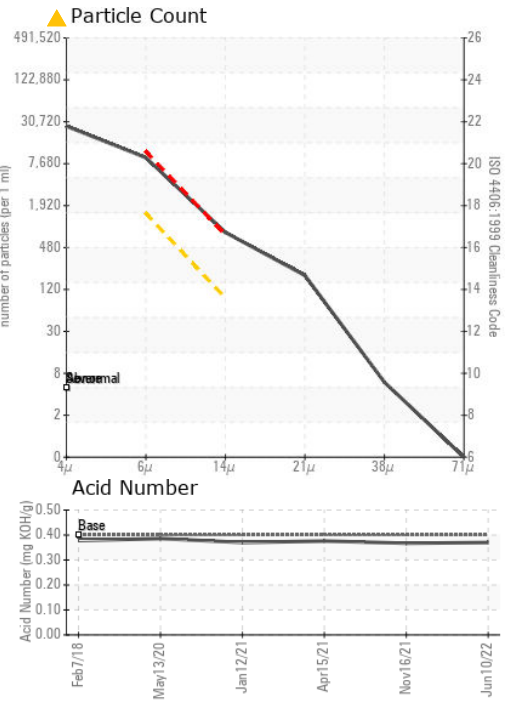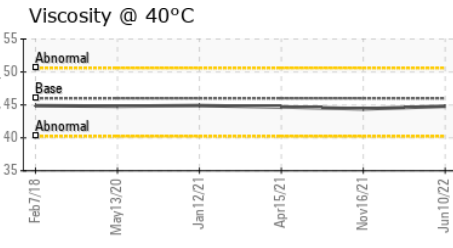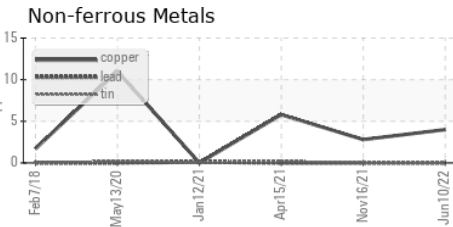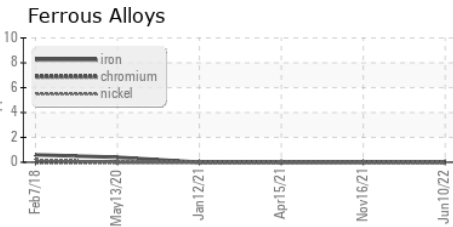

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC104200 **Received** : 17 Jun 2022
Lab Number : 05571674 **Diagnosed** : 20 Jun 2022
Unique Number : 10021091 **Diagnostician** : Angela Borella
Test Package : IND 2

AMAZON.COM PHL4
 21 ROADWAY DR
 CARLISLE, PA
 US 17015
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: