PROBLEM SUMMARY

Sample Rating Trend

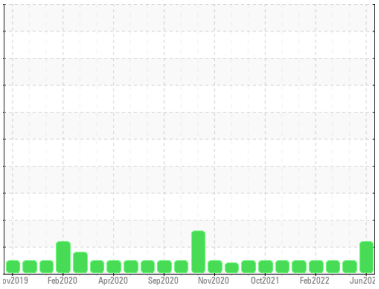

ISO

Machine Id
WHITE
Component
Reciprocating Compressor
Fluid
TULCO LUBSOIL IND MP R&O 150 (--- GAL)

COMPONENT CONDITION SUMMARY

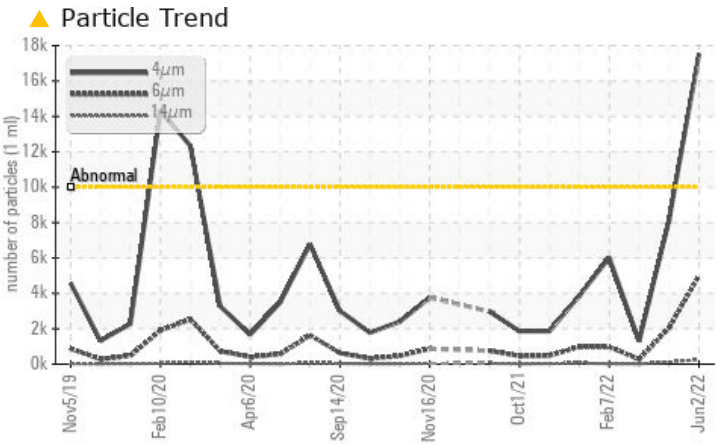

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	NORMAL
Particles >4µm		ASTM D7647	>10000	▲ **17519**	8144	1297
Particles >6µm		ASTM D7647	>2500	▲ **4999**	2050	273
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ **21/19/15**	20/18/14	17/15/11

Customer Id: CAMFORAR
Sample No.: TO70000006
Lab Number: 05573175
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldridge +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

02 May 2022 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

04 Apr 2022 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

07 Feb 2022 Diag: Doug Bogart

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

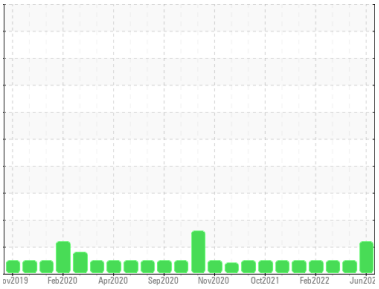

ISO

Machine Id
WHITE
Component
Reciprocating Compressor
Fluid
TULCO LUBSOIL IND MP R&O 150 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO70000006**	TO70000003	TO70000001
Sample Date		Client Info		**02 Jun 2022**	02 May 2022	04 Apr 2022
Machine Age	wks	Client Info		**0**	0	0
Oil Age	wks	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ATTENTION**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	<1	0
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	<1
Aluminum	ppm	ASTM D5185m	>25	**<1**	0	<1
Lead	ppm	ASTM D5185m	>25	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**0**	0	<1
Tin	ppm	ASTM D5185m	>15	**0**	0	<1
Antimony	ppm	ASTM D5185m		**---**	---	---
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**<1**	<1	<1
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m	0	**0**	0	0
Calcium	ppm	ASTM D5185m	0	**0**	0	<1
Phosphorus	ppm	ASTM D5185m	0	**20**	20	22
Zinc	ppm	ASTM D5185m	0	**10**	5	4
Sulfur	ppm	ASTM D5185m	2400	**2193**	1964	2309

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**4**	5	5
Sodium	ppm	ASTM D5185m		**0**	0	0
Potassium	ppm	ASTM D5185m	>20	**0**	0	0
Water	%	ASTM D6304	>0.1	**0.007**	0.00	0.001
ppm Water	ppm	ASTM D6304	>1000	**78.5**	0.00	5.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ **17519**	8144	1297
Particles >6µm		ASTM D7647	>2500	▲ **4999**	2050	273
Particles >14µm		ASTM D7647	>320	**254**	109	14
Particles >21µm		ASTM D7647	>80	**36**	23	2
Particles >38µm		ASTM D7647	>20	**2**	0	0
Particles >71µm		ASTM D7647	>4	**1**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ **21/19/15**	20/18/14	17/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.067**	0.041	0.17

OIL ANALYSIS REPORT

Particle Trend

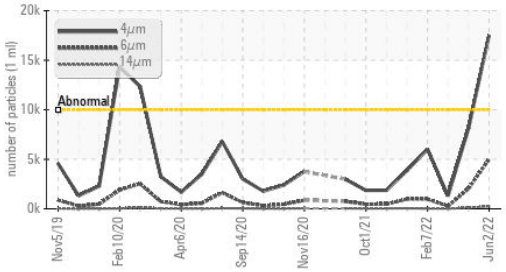

Water

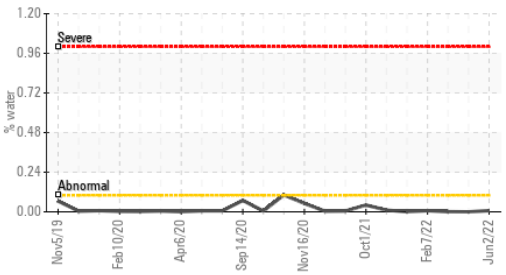

Viscosity @ 100°C

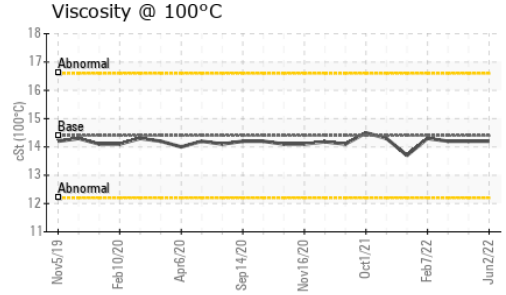

Water

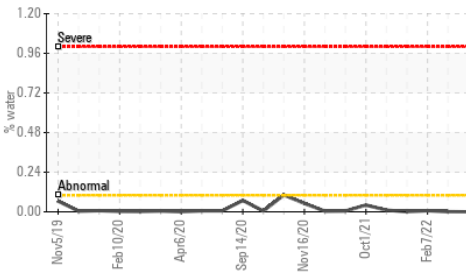

Viscosity @ 100°C

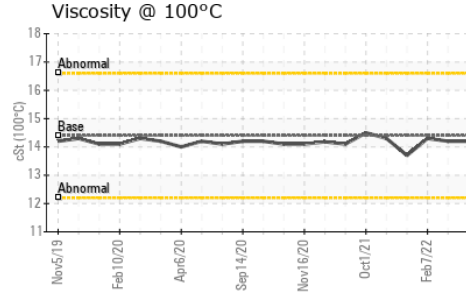

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**LIGHT**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	**142**	142	142
Visc @ 100°C	cSt	ASTM D445	14.4	**14.2**	14.2	14.2
Viscosity Index (VI)	Scale	ASTM D2270	92	**97**	97	97

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

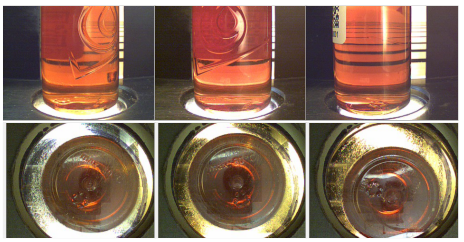

GRAPHS

Ferrous Alloys

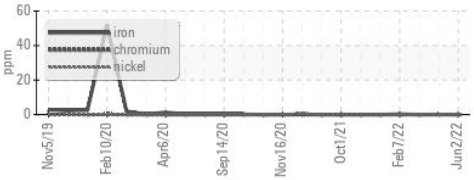

Non-ferrous Metals

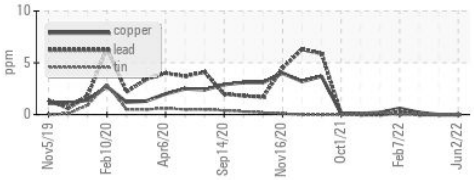

Viscosity @ 40°C

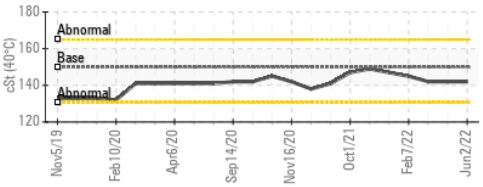

Particle Count

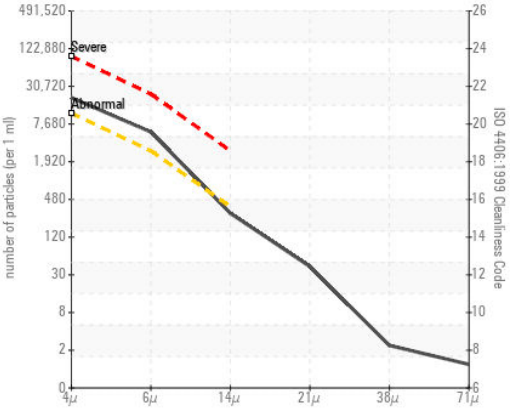

Acid Number

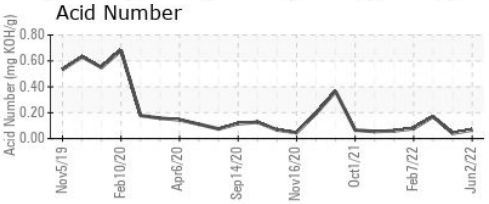

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO70000006 **Received** : 21 Jun 2022
Lab Number : 05573175 **Diagnosed** : 22 Jun 2022
Unique Number : 10022592 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CAMBRIAN ENERGY-SOUTH TEX FT. SMITH TREATERS
5950 COMMERCE RD
FORT SMITH, AR
US 72916
Contact: DUSTIN FRY
dustin@morrowenergy.com
T: (479)221-7571
F:

Report Id: CAMFORAR [WUSCAR] 05573175 (Generated: 07/19/2023 16:02:32) Rev: 1

Submitted By: BRANDON HUTCHERSON