




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

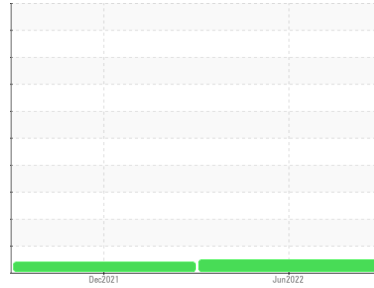

Machine Id  
**7435246 (S/N 1123)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC85728</b>	KC96418	---
Sample Date	Client Info			<b>28 Jun 2022</b>	06 Dec 2021	---
Machine Age	hrs	Client Info		<b>4756</b>	3129	---
Oil Age	hrs	Client Info		<b>1527</b>	1870	---
Oil Changed	Client Info			<b>Changed</b>	Not Changd	---
Sample Status				<b>NORMAL</b>	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>10</b>	5	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>10</b>	36	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	6	---
Zinc	ppm	ASTM D5185m		<b>37</b>	32	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	14	---
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	7	---
Water	%	ASTM D6304	>0.05	<b>0.017</b>	0.009	---
ppm Water	ppm	ASTM D6304	>500	<b>177.9</b>	95.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1002</b>	6041	---
Particles >6µm		ASTM D7647	>1300	<b>185</b>	▲ 1857	---
Particles >14µm		ASTM D7647	>80	<b>20</b>	72	---
Particles >21µm		ASTM D7647	>20	<b>5</b>	11	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>15/11</b>	▲ 18/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.37</b>	0.335	---


# OIL ANALYSIS REPORT

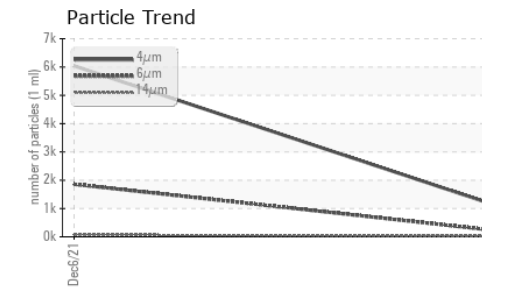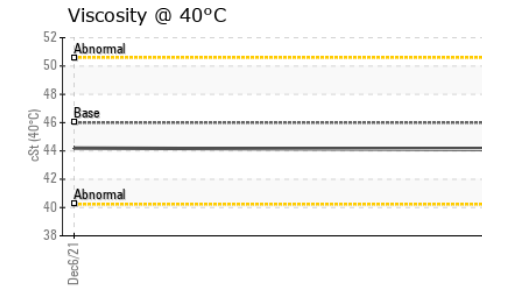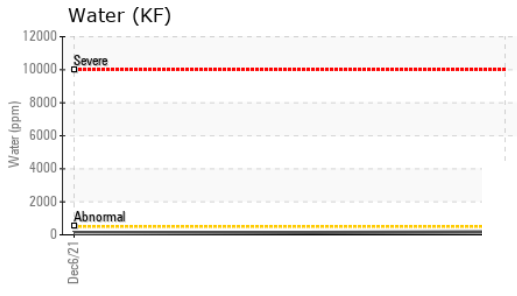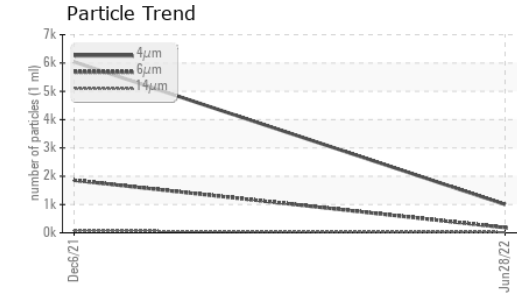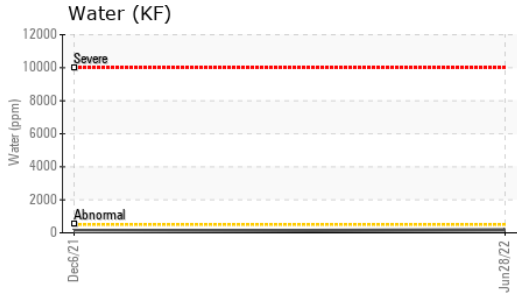






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	VLITE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	VLITE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	44.1	44.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

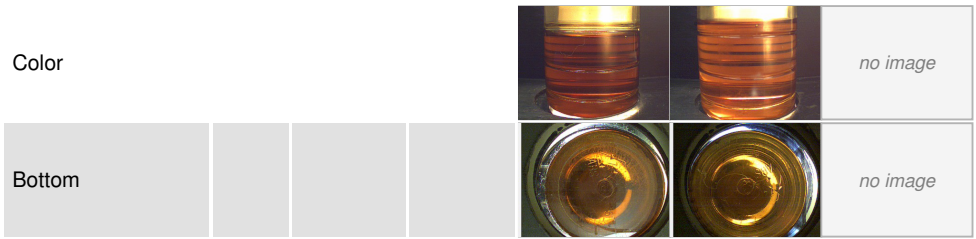

## GRAPHS

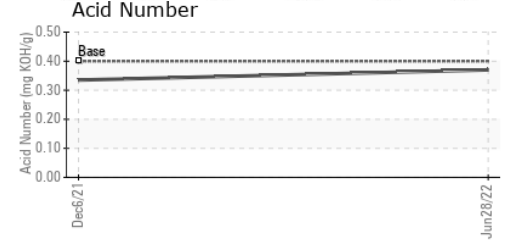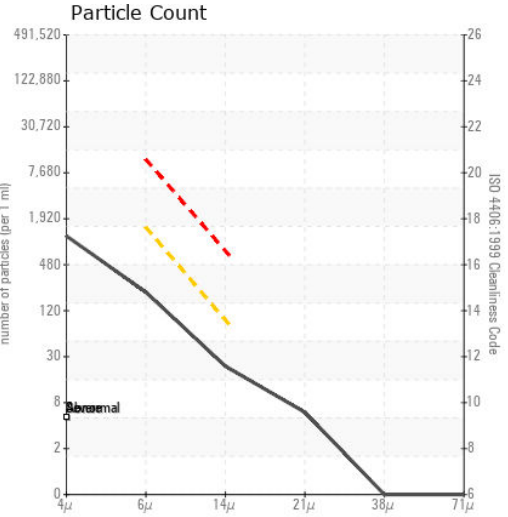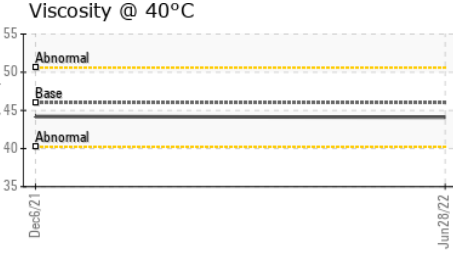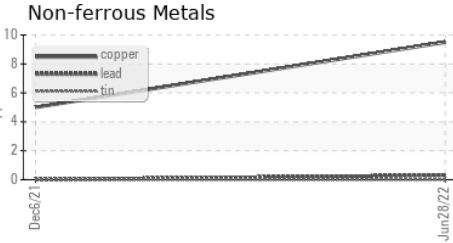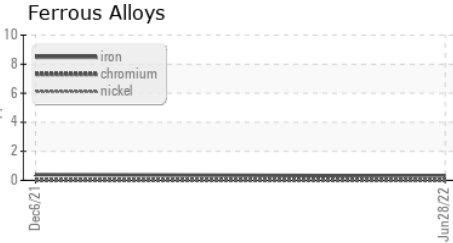

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC85728 **Received** : 05 Jul 2022  
**Lab Number** : 05584157 **Diagnosed** : 07 Jul 2022  
**Unique Number** : 10038583 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**UMICORE PRECIOUS METALS**  
 1305 MAIN PARKWAY  
 CATOOSA, OK  
 US 74015  
 Contact: DAVID JOHNSON  
 david.johnson@am.umicore.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)