




# OIL ANALYSIS REPORT

## Sample Rating Trend

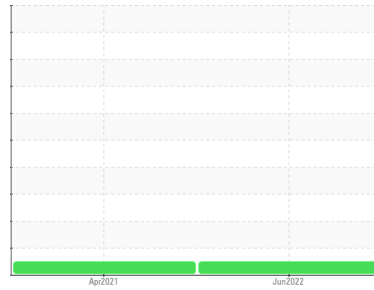

Machine Id  
**KAESER 7336132**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP51237</b>	KCP28249	---
Sample Date	Client Info			<b>20 Jun 2022</b>	20 Apr 2021	---
Machine Age	hrs Client Info			<b>6987</b>	3628	---
Oil Age	hrs Client Info			<b>3300</b>	3628	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	---
Barium	ppm	ASTM D5185m	90	<b>4</b>	44	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>80</b>	79	---
Calcium	ppm	ASTM D5185m	2	<b>2</b>	3	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	4	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m		<b>19942</b>	17132	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	---
Sodium	ppm	ASTM D5185m		<b>15</b>	15	---
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	13	---
Water	%	ASTM D6304	>0.05	<b>0.039</b>	0.028	---
ppm Water	ppm	ASTM D6304	>500	<b>391.0</b>	280.5	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>505</b>	4031	---
Particles >6µm		ASTM D7647	>1300	<b>153</b>	639	---
Particles >14µm		ASTM D7647	>80	<b>21</b>	49	---
Particles >21µm		ASTM D7647	>20	<b>6</b>	17	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>16/14/12</b>	16/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.36</b>	0.328	---


# OIL ANALYSIS REPORT

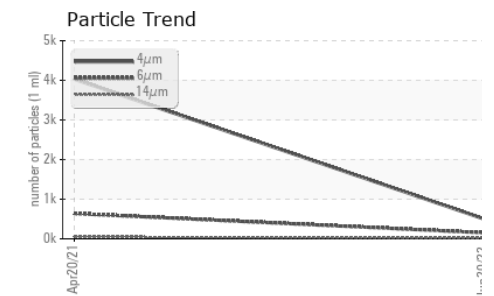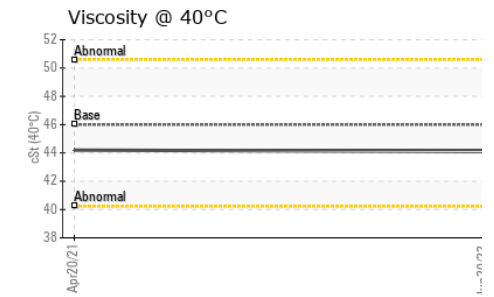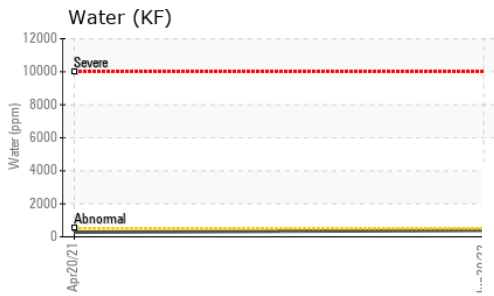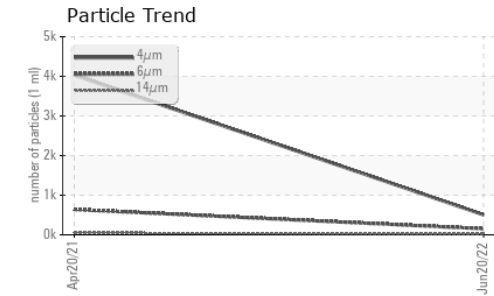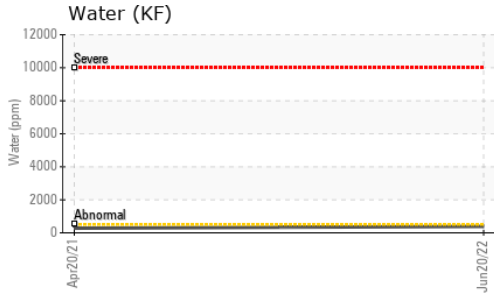






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

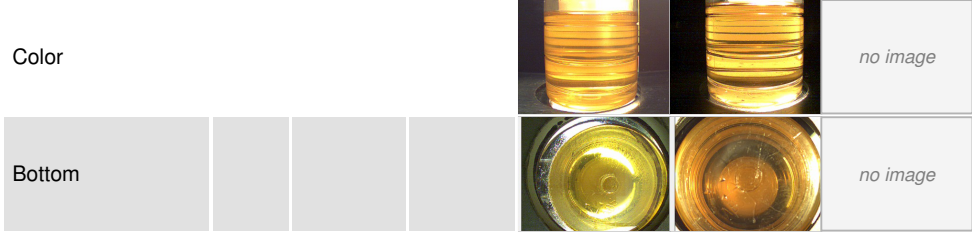

## GRAPHS

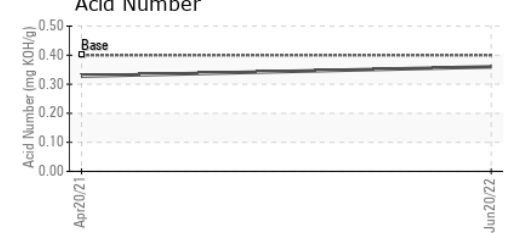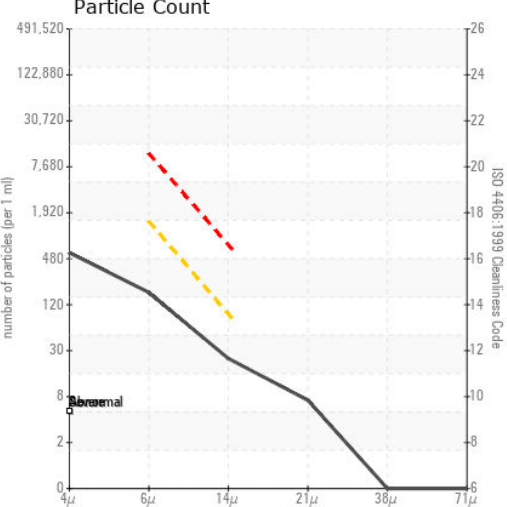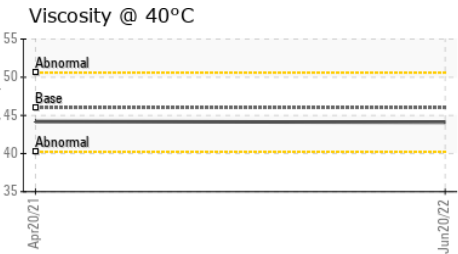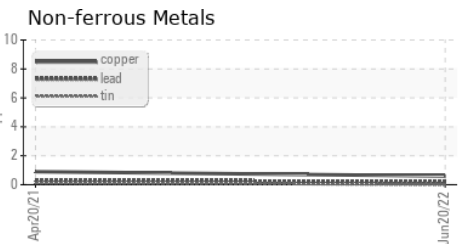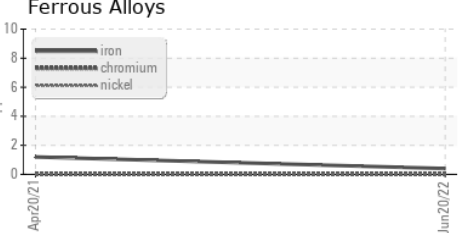

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP51237 **Received** : 05 Jul 2022  
**Lab Number** : 05584161 **Tested** : 07 Jul 2022  
**Unique Number** : 10038587 **Diagnosed** : 07 Jul 2022 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON**  
 280 BRIDGEPORT BLVD  
 NEWNAN, GA  
 US 30263  
 Contact: A. RIOMATH  
 ariomath@mazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)